


# 2020

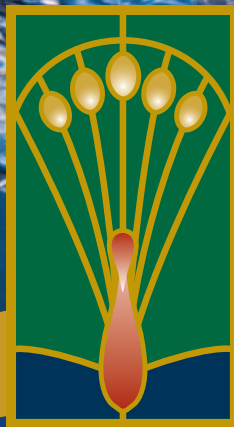

CITY OF  
ARCADIA



## Water Quality Report

The City of Arcadia is committed to keeping you informed on the quality of your drinking water and is dedicated to providing you with a safe and reliable supply of high-quality water. This report is provided to you annually and includes information describing where your drinking water comes from, the constituents found in your drinking water and how the water quality compares with the regulatory standards. The drinking water provided by the City of Arcadia in 2020 complies with all Federal and State drinking water standards.

City Council meetings provide an opportunity for public participation in decisions that may affect the quality of your water. Regularly scheduled meetings of the City Council are held on the first and third Tuesday of each month at 7:00 PM in the City Council Chambers located at 240 West Huntington Drive in Arcadia.

## Where Does My Drinking Water Come From?

The water supply for the City of Arcadia comes from two sources: (1) groundwater from wells in the Main San Gabriel Basin; and (2) groundwater from wells in the Raymond Basin.

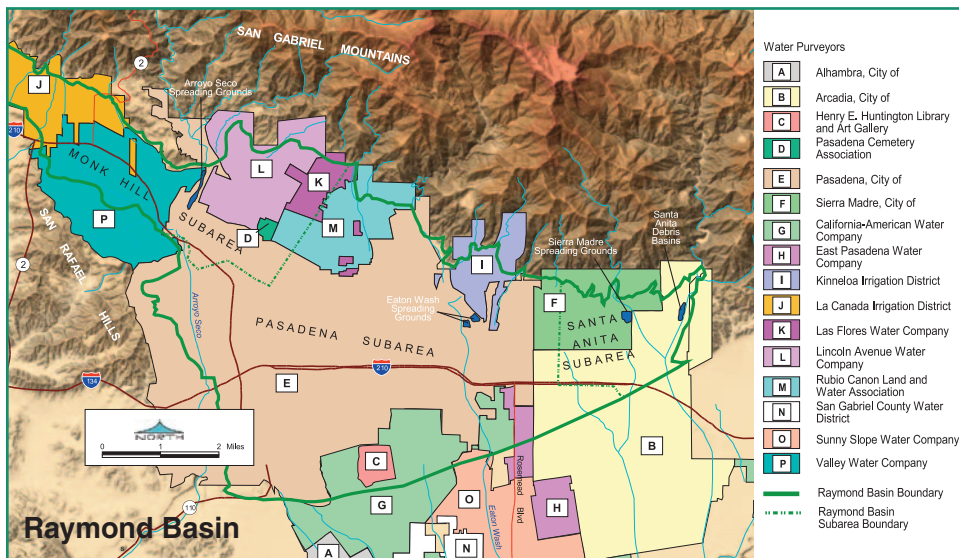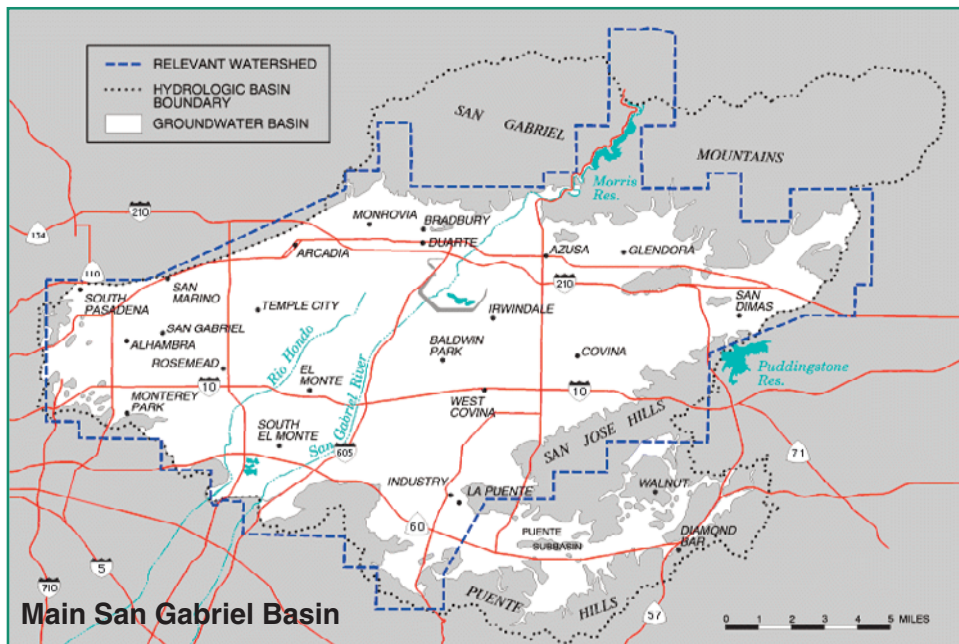

Groundwater comes from natural underground aquifers that are replenished with local rainwater and imported water. The groundwater basins from which the City of Arcadia pumps its water lay beneath the San Gabriel Valley. More than 30 retail water systems draw from the basins to provide water to residents and businesses.

## What are Water Quality Standards?

In order to ensure that tap water is safe to drink, the United States Environmental Protection Agency (USEPA) and the State Water Resources Control Board, Division of Drinking Water (DDW) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking water standards established by USEPA and DDW set limits for substances that may affect consumer health or aesthetic qualities of drinking water. The chart in this report shows the following types of water quality standards:

- Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
- Maximum Residual Disinfectant Level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial pathogens.
- Primary Drinking Water Standard:** MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.
- Regulatory Action Level (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.
- Notification Level (NL):** An advisory level which, if exceeded, requires the drinking water system to notify the governing body of the local agency in which users of the drinking water reside (i.e. City Council, Board of Directors, and County Board of Supervisors).

# What is in My Drinking Water?

**Your drinking water is regularly tested using DDW-approved methods to ensure its safety. The table in this report lists all the constituents detected in your drinking water that have Federal and State drinking water standards. Detected unregulated constituents and other constituents of interest are also included. The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data, though representative, are more than one year old.**

## Arsenic

While your drinking water meets the 10 micrograms per liter ( $\mu\text{g/l}$ ) MCL for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the cost of removing arsenic from drinking water. The USEPA continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

## Nitrate

Although nitrate in your drinking water never exceeds the MCL of 10 milligrams per liter ( $\text{mg/l}$ ), nitrate levels may rise quickly for short periods of time because of rainfall or agricultural activity. Nitrate in drinking water at levels above 10  $\text{mg/l}$  is a health risk for infants of less than six months of age. Such nitrate levels in drinking water can interfere with the capacity of the infant's blood to carry oxygen, resulting in a serious illness; symptoms include shortness of breath and blueness of the skin. Nitrate levels above 10  $\text{mg/l}$  may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant women and those with certain specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask for advice from your health care provider.

## Lead in Tap Water

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The City of Arcadia is dedicated to providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <https://www.epa.gov/lead>.

## Coliform Bacteria

This Consumer Confidence Report reflects changes in drinking water regulatory requirements since 2016. All water systems are required to comply with the state Total Coliform Rule. Effective April 1, 2016, all water systems are also required to comply with the federal Revised Total Coliform Rule. The new federal rule maintains the purpose to protect public health by ensuring the integrity of the drinking water distribution system and monitoring for the presence of microbials (i.e., total coliform and E. coli bacteria). The USEPA anticipates greater public health protection as the new rule requires water systems that are vulnerable to microbial contamination to

identify and fix problems. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment to determine if any sanitary defects exist. If found, these must be corrected by the water system

## Drinking Water Source Assessment

In accordance with the Federal Safe Drinking Water Act, an assessment of the drinking water sources for the City of Arcadia was completed in December 2002. The purpose of the drinking water source assessment is to promote source water protection by identifying types of activities in the proximity of the drinking water sources which could pose a threat to the water quality. The assessment concluded that the City of Arcadia's sources are considered vulnerable to the following activities or facilities associated with contaminants detected in the water supply: gasoline stations, automobile repair shops, chemical/petroleum pipelines, utility stations, electrical/electronic manufacturing, waste dumps/landfills, high density housing and dry cleaners. In addition, the sources are considered most vulnerable to the following activities or facilities not associated with contaminants detected in the water supply: sewer collection systems, car washes, transportation corridors, junk/scrap/salvage yards and above or below ground storage tanks. A copy of the complete drinking water source assessment is available at the City of Arcadia, Public Works Services Department located at 11800 Goldring Road, in Arcadia. You may request a summary of the assessment to be sent to you by contacting the City of Arcadia, Public Works Services Department at (626) 254-2700.

## Fluoride in Drinking Water

Our local groundwater is not supplemented with fluoride. Fluoride levels in drinking water are limited under California state regulations at a maximum dosage of 2 parts per million (ppm).

## Groundwater Facts

Groundwater is water from rainfall and snowmelt that seep down through layers of soil, becoming trapped between rock particles and saturating in aquifers. This freshwater is stored between rock formations like an underground lake, forming a groundwater basin. Groundwater slowly flows underground, generally at a downward angle, and may eventually seep into streams, lakes, and oceans. The City of Arcadia relies almost exclusively on groundwater pumped from the Main San Gabriel and Raymond Basins.

Groundwater is a fragile resource that can be easily polluted. It is slow moving, difficult to monitor, expensive to treat, and slow to recharge. Protecting Arcadia's drinking water source is everyone's responsibility. You can help protect our water by eliminating or reducing excess use of fertilizers and pesticides, picking up after your pets, using water efficiently, and disposing of chemicals properly.

For more information on our local groundwater basins, visit <https://www.thewatersthatconnectus.com/>

## Runoff

Water runoff from washing your car, leaking sprinklers, and excessive irrigation picks up hazardous substances such as fertilizer, chemicals, oil, and pet waste that flows into the City's storm drain system. This runoff flows to the ocean, carrying chemicals into it and harming sea life. By limiting the amount of water running off your property, you can help protect the environment and save water at the same time!

# City of Arcadia - 2020 Water Quality Table

Constituent and (units)	MCL or (MRDL)	PHG (MCLG) or (MRDLG)	DLR	LOCAL GROUNDWATER Result (a)	Range (Min-Max)	Typical Origins
<b>PRIMARY DRINKING WATER STANDARDS - Health-Related Standards</b>						
<b>Microbiological</b>						
Total Coliform (b)	5.0%	(0)	NA	1.2%	–	Naturally present in the environment
<b>Disinfectant and Disinfection Byproducts (c)</b>						
Total Trihalomethanes (TTHM) (µg/l)	80	NA	0.5	13	4 - 20	Byproduct of drinking water chlorination
Haloacetic acids (five) (HAA5) (µg/l)	60	NA	1-2	2.1	ND - 2.3	Byproduct of drinking water disinfection
Chlorine Residual (mg/l)	[4]	[4]	NA	0.89	0.44 - 1.7	Drinking water disinfectant
<b>Organic Chemicals</b>						
Tetrachloroethylene (PCE) (µg/l)	5	0.06	0.5	<0.5	ND - 2.4	Discharge from industrial activities
Trichloroethylene (TCE) (µg/l)	5	1.7	0.5	<0.5	ND - 1.9	Discharge from industrial activities
<b>Inorganic Chemicals</b>						
Aluminum (mg/l)	1	0.6	0.05	<0.05	ND - 0.12	Erosion of natural deposits
Arsenic (µg/l)	10	0.004	2	<2	ND - 5.7	Erosion of natural deposits
Fluoride, Naturally-occurring (mg/l)	2	1	0.1	0.61	0.24 - 1.4	Erosion of natural deposits
Nitrate as N (mg/l)	10	10	0.4	2.2	0.59 - 5.5	Runoff and leaching from fertilizer use
<b>Radioactivity (c)</b>						
Gross Alpha Particle Activity (pCi/l)	15	(0)	3	<3	ND - 5.4	Erosion of natural deposits
Uranium (pCi/l)	20	0.43	1	2.4	ND - 5.3	Erosion of natural deposits
<b>SECONDARY DRINKING WATER STANDARDS - Aesthetic Standards, Not Health-Related</b>						
Aluminum (µg/l)	200	600	50	<50	ND - 120	Erosion of natural deposits
Chloride (mg/l)	500	NA	NA	26	8.5 - 42	Runoff/leaching from natural deposits
Color (color units)	15	NA	NA	<3	ND - 3	Naturally-occurring organic materials
Iron (µg/l)	300	NA	100	<100	ND - 120	Runoff/leaching from natural deposits
Odor (threshold odor number)	3	NA	1	<1	ND - 1	Runoff/leaching from natural deposits
Sulfate (mg/l)	500	NA	0.5	50	18 - 73	Runoff/leaching from natural deposits
Specific Conductance (µmho/cm)	1600	NA	NA	520	320 - 700	Substances that form ions in water
Total Dissolved Solids (mg/l)	1000	NA	NA	320	190 - 430	Runoff/leaching from natural deposits
Turbidity (NTU)	5	NA	0.1	0.41	ND - 3.3	Runoff/leaching from natural deposits
<b>UNREGULATED CONSTITUENTS OF INTEREST</b>						
Hardness as CaCO3 (mg/l)	NA	NA	NA	200	26 - 270	Runoff/leaching from natural deposits
Perfluorohexane Sulfonic Acid (PFHxS) (ng/l)	NA	NA	NA	<4	ND - 4.6	Discharge from industrial activities
Perfluorooctane Sulfonic Acid (PFOS) (ng/l)	NL = 6.5	NA	NA	6.4	ND - 9.3	Discharge from industrial activities
Sodium (mg/l)	NA	NA	NA	31	17 - 54	Runoff/leaching from natural deposits
<b>UNREGULATED CONSTITUENTS REQUIRING MONITORING</b>						
Bromide (µg/l)	NA	NA	NA	65	26 - 100	Industrial discharge
<b>UNREGULATED CONSTITUENTS REQUIRING MONITORING AT ENTRY POINTS INTO THE DISTRIBUTION SYSTEM</b>						
Manganese (µg/l) (f)	50	NA	NA	<0.4	ND - 0.66	Erosion of natural deposits
<b>LEAD AND COPPER TESTING AT RESIDENTIAL TAPS</b>						
Lead/Copper	Action Level (AL)	PHG		90th Percentile Value		Typical Origins
Copper (mg/l) (g)	1.3	0.3		0.36		Corrosion of household plumbing system
Lead (µg/l) (g)	15	0.2		ND		Corrosion of household plumbing system
<b>UNREGULATED CONSTITUENTS REQUIRING MONITORING IN THE DISTRIBUTION SYSTEM</b>						
Haloacetic acids (HAA5) (µg/l)	NA	NA	NA	1.9	1.4 - 2.7	Byproduct of drinking water disinfection
Haloacetic acids (HAA6Br) (µg/l)	NA	NA	NA	2.7	2.1 - 3.5	Byproduct of drinking water disinfection
Haloacetic acids (HAA9) (µg/l)	NA	NA	NA	3.3	2.5 - 4.5	Byproduct of drinking water disinfection

## Notes

mg/l	=	parts per million or milligrams per liter	(a) The results reported in the table are average concentrations of the constituents detected in your drinking water during year 2019 or from the most recent tests done in compliance with regulations (2011-2018), except for TTHM, HAA5, lead and copper which are described below.	(c) Four (4) locations in the distribution system are tested quarterly for disinfection byproducts. The highest locational running annual averages for TTHM and HAA5 are reported as "Result." The maximum and minimum of the individual results for TTHM and HAA5 are reported as "Range." Twenty (20) locations are tested weekly for chlorine residual.
µg/l	=	parts per billion or micrograms per liter		
pCi/l	=	picoCuries per liter		
µmho/cm	=	micromhos per centimeter		
NTU	=	Nephelometric Turbidity Units		
AL	=	Action Level		
DLR	=	Detection Limit for the Purpose of Reporting	(b) The result is the highest percentage of positive samples collected in a month during 2018. Coliforms are bacteria used as an indicator that if present, indicates other potentially harmful organisms may be present. According to the State Water Resources Control Board, Division of Drinking Water (DDW), no more than 5.0% of the monthly samples may be Total Coliform-positive. Total Coliforms were detected in one sample collected in the distribution system in February 2019. However, all follow-up confirmation samples were negative for Total Coliforms and Fecal/E. Coli bacteria. A routine sample and a repeat sample that are Total Coliform positive and where one of these is also Fecal/E. Coli positive constitutes an MCL violation. Therefore, the MCL was not violated in 2019.	(d) Not all sources were sampled for radioactivity in 2019; sources were sampled between 2011 to 2019. The most recent results are included.
MCL	=	Maximum Contaminant Level		(e) Total chromium was included as part of the unregulated constituents requiring monitoring
MCLG	=	Maximum Contaminant Level Goal		(f) Manganese is regulated with a secondary standard of 50 µg/l but was not detected, based on the DL of 20 µg/l Manganese was included as part of the unregulated constituents requiring monitoring.
MRDL	=	Maximum Residual Disinfectant Level		(g) Thirty (30) residences were sampled in June 2019, July 2019, and August 2019. Concentrations were measured at the tap. Copper was detected at twenty-eight (28) locations; none exceeded the copper Action Level. Lead was not detected at any of the locations. The next round of lead and copper samples will be collected in 2022. In 2019, no school submitted request to be sampled for lead.
MRDLG	=	Maximum Residual Disinfectant Level Goal		
ND	=	Not Detected at DLR		
NA	=	No Applicable Limit		
NL	=	Notification Level		
PHG	=	Public Health Goal		
SMCL	=	Secondary MCL		
<	=	Detected but average is below the DLR		

# What is a Water Quality Goal?

In addition to mandatory water quality standards, USEPA and DDW have set voluntary water quality goals for some contaminants. Water quality goals are often set at such low levels that they are not achievable in practice and are not directly measurable. Nevertheless, these goals provide useful guideposts and direction for water management practices. The chart in this report includes three types of water quality goals:

- **Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by USEPA
- **Maximum Residual Disinfectant Level Goal (MRDLG):** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- **Public Health Goal (PHG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

## What Contaminants May be Present in Sources of Drinking Water?

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that maybe present in source water include:

- **Microbial contaminants**, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

- **Inorganic contaminants**, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.
- **Pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- **Radioactive contaminants**, that can be naturally-occurring or be the result of oil and gas production and mining activities.
- **Organic chemical contaminants**, including synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application and septic systems.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at (800) 426-4791.

## Are There Any Precautions the Public Should Consider?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline (800) 426-4791.

## Capital Improvement Projects - Water Utility

Every day, Arcadia's city-owned wells pump water from the Main San Gabriel and Raymond Basins into the water distribution system, serving high-quality drinking water to the community. As part of the City's Capital Improvement Program (CIP), maintenance projects improving reliability and efficiency of the City's water utility infrastructure are implemented on an annual basis. These projects are vital in preserving infrastructure reliability, ensuring that safe and clean water is delivered with minimal service interruption.

Each year, the City's Public Works Services Department completes scheduled CIP projects. In 2020, the following projects were completed:

- Two 6-inch water mains on Camino Real Avenue between Sixth Avenue and Eighth Avenue were replaced with 10-inch ductile iron mains to improve reliability and minimize main breaks.
- The Cities of Arcadia and Sierra Madre signed a joint agreement to construct a new well at the Arcadia Public Works Services Department location. This new well will improve reliability in both agencies' distribution system by adding supply redundancy. Construction is slated to begin in the first quarter of 2022.
- The Live Oak Well TCE Treatment Project was completed in 2020. With the completion of this treatment system, Live Oak Well is expected to return to service in the summer of 2021 and greatly enhance supply reliability as one of the City's most productive wells.



# PLEASE OBSERVE THE CITY'S SEASONAL WATERING SCHEDULES



## Know Your Watering Days

	Mon	Tues	Wed	Thur	Fri	Sat	Sun
<b>SUMMER</b> Watering Schedule May 1-October 31							
<b>WINTER</b> Watering Schedule November 1-April 30							
<b>No watering between 9:00 AM and 6:00 PM • Limit 10 minutes per station</b>							

Since outdoor irrigation accounts for more than half of household water used, the City's seasonal watering schedules, codified in the Municipal Code, is in effect. Outdoor irrigation is permitted before 9:00 a.m. and after 6:00 p.m. to minimize evaporation. Limit overhead sprinklers to 10 minutes per station. Trees and shrubs may be irrigated any day of the week within permitted hours using a hand-held hose attached with shut-off nozzle.

The City's Water Conservation Program offers a variety of excellent resources to help our customers be water smart! For information on rebates, events, and giveaways, visit [www.ArcadiaCA.gov](http://www.ArcadiaCA.gov). Follow @ShapeArcadia on Twitter to keep up to date on City projects and smart strategies that promote sustainability.

## Water Conservation

Arcadia is located in a warm environment characterized by hot, dry summers. The San Gabriel Valley region has not been receiving consistent, above-average rainfall needed to sufficiently recharge local groundwater basins. In fact, the Main San Gabriel Basin reached a new historic low in November 2018. According to the Main San Gabriel Basin Watermaster, many more consecutive years of above-average rainfall would be required for the basin to reach healthy levels. Since our local climate is dry and unpredictable, water efficiency is important in preserving our local water supply.

Since 2015, the City of Arcadia has partnered with WaterSmart Software to provide customers with a more complete understanding of their water use. An educational quarterly Home Water Report is sent to single-family residential customers providing information about their home water use. The online portal is also accessible for free to customers, simply register at [arcadia.watersmart.com](http://arcadia.watersmart.com).

The report and the companion online portal will help you to:

- View and understand your recent water use in gallons and how it compares to similar households throughout Arcadia.
- Find easy and effective tips to save water and money, with step-by-step advice.
- Register your account in the portal to update your information and access special features.
- Sign-up to receive notifications and e-mail alerts if your water consumption indicates a possible leak.
- Stay up-to-date on City of Arcadia water conservation news, programs, and events!



## Questions?

For more information or questions regarding this report, please contact the City of Arcadia, Public Works Services Department at (626) 254-2700

Este informe contiene información muy importante sobre su agua potable. Para mas información ó traducción, favor de contactar the City of Arcadia, Public Works Services Department. Telefono: (626) 254-2700.

此份有關你的食水報告,內有重要資料和訊息,請找他人為你翻譯及解釋清楚。