

Consumer Confidence Report Certification Form

(To be submitted with a copy of the CCR)

Water System Name:	Kinneloa Irrigation District
Water System Number:	1910035

The water system named above hereby certifies that its Consumer Confidence Report was distributed on 06/03/2026, to customers (and appropriate notices of availability have been given). Further, the system certifies that the information contained in the report is correct and consistent with the compliance monitoring data previously submitted to the State Water Resources Control Board, Division of Drinking Water (DDW).

Certified by:

Name: Melanie Timoteo	Title: Admin. Assistant
Signature: <i>Melanie Timoteo</i>	Date: 06/03/2026
Phone number: 626-797-6295	

To summarize report delivery used and good-faith efforts taken, please complete this page by checking all items that apply and fill-in where appropriate:

- CCR was distributed by mail or other direct delivery methods (attach description of other direct delivery methods used).
- CCR was distributed using electronic delivery methods described in the Guidance for Electronic Delivery of the Consumer Confidence Report (water systems utilizing electronic delivery methods must complete the second page).
- "Good faith" efforts were used to reach non-bill paying consumers. Those efforts included the following methods:
 - Posting the CCR at the following URL:
<https://tinyurl.com/KID2025CCR>
 - Mailing the CCR to postal patrons within the service area (attach zip codes used)
 - Advertising the availability of the CCR in news media (attach copy of press release)
 - Publication of the CCR in a local newspaper of general circulation (attach a copy of the published notice, including name of newspaper and date published)
 - Posted the CCR in public places (attach a list of locations)

- Delivery of multiple copies of CCR to single-billed addresses serving several persons, such as apartments, businesses, and schools
- Delivery to community organizations (attach a list of organizations)
- Publication of the CCR in the electronic city newsletter or electronic community newsletter or listserv (attach a copy of the article or notice)
- Electronic announcement of CCR availability via social media outlets (attach list of social media outlets utilized)
- Other (attach a list of other methods used)
- For systems serving at least 100,000 persons:* Posted CCR on a publicly-accessible internet site at the following URL: www._____
- For privately-owned utilities:* Delivered the CCR to the California Public Utilities Commission

Consumer Confidence Report Electronic Delivery Certification

Water systems utilizing electronic distribution methods for CCR delivery must complete this page by checking all items that apply and fill-in where appropriate.

- Water system mailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available website where it can be viewed (attach a copy of the mailed CCR notification). URL:
<https://tinyurl.com/KID2025CCR>
- Water system emailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available site on the Internet where it can be viewed (attach a copy of the emailed CCR notification). URL:
<https://tinyurl.com/KID2025CCR>
- Water system emailed the CCR as an electronic file email attachment.
- Water system emailed the CCR text and tables inserted or embedded into the body of an email, not as an attachment (attach a copy of the emailed CCR).
- Requires prior DDW review and approval.* Water system utilized other electronic delivery method that meets the direct delivery requirement.

Provide a brief description of the water system's electronic delivery procedures and include how the water system ensures delivery to customers unable to receive electronic delivery.

KID distributed the 2025 CCR via a dedicated water service statement that had a direct URL to the 2025 CCR to all our paper bill customers. KID also distributed the 2025 CCR

via electronic notification that had a direct URL to all our paperless customers.
Hard copy mailed to any customer or non-bill paying customer unable to receive
electronic delivery.
Any customer or non-bill paying customer who contacts the office for the 2025 CCR
will be offered the option of receiving the report via email attachment or mailed a hard
copy.

This form is provided as a convenience and may be used to meet the certification requirement of section 64483(c) of the California Code of Regulations.



2025 CONSUMER CONFIDENCE REPORT

WATER SYSTEM INFORMATION

Water System Name: KINNELOA IRRIGATION DISTRICT

Report Date: July 2026

Kinneloa Irrigation District (KID) is pleased to provide you with this Consumer Confidence Report (CCR), which contains information about the quality of drinking water that is delivered to you. This report meets the California requirements for reporting water quality information to customers of public water systems and addresses frequently asked questions.

Type of Water Source(s) in Use: Two vertical wells and one groundwater source tunnel.

Name and General Location of Source(s):

In 2025, the Kinneloa Irrigation District (KID) distributed approximately 521 acre-feet of water to its customers—equal to about 169.9 million gallons. For context, one acre-foot of water is enough to cover an acre of land one foot deep, or about 325,851 gallons. Your tap water came from two deep vertical wells. The wells draw from the Raymond Basin, reaching depths of 244 and 443 feet below the ground. Water from these sources is delivered to reservoirs, where it is blended. Chlorine disinfectant is added at this stage to prevent bacterial growth both in the reservoirs and throughout the distribution system. KID also maintains emergency interconnections with the City of Pasadena, providing backup supply options when needed.

Drinking Water Source Assessment Information:

An assessment of Kinneloa Irrigation District's drinking water sources was completed in August 2002. The assessment concluded that KID's sources are considered most vulnerable to nitrate contamination. A copy of the full assessment is available for review at the District office, located at 1999 Kinclair Drive, Pasadena, CA. To request access, contact us at (626) 797- 6295.

Time and Place of Regularly Scheduled Board Meetings for Public Participation:

The Board meets on the fourth Tuesday of every month at the District office located at 1999 Kinclair Drive, Pasadena, CA. Members of the public are welcome to attend.

For More Information, Contact:

Kinneloa Irrigation District General Manager, Tom Majich, (626) 797- 6295

ABOUT THIS REPORT

We test the drinking water quality for many constituents as required by state and federal regulations. This report shows the results of our monitoring for the period of **January 1 to December 31, 2025**, and may include earlier monitoring data.

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien. Favor de comunicarse con Kinneloa Irrigation District a 1999 Kinclair Drive, Pasadena, CA 91107 a (626) 797-6295 para más información.

DEFINITIONS

Primary Drinking Water Standards (PDWS)	MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.
Maximum Contaminant Level Goal (MCLG)	Level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency (U.S. EPA).
Maximum Contaminant Level (MCL)	The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
Maximum Residual Disinfectant Level (MRDL)	Highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
Maximum Residual Disinfectant Level Goal (MRDLG)	Level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
Notification Level (NL)	An advisory level which, if exceeded, requires the drinking water system to notify the governing body of the local agency in which users of the drinking water reside (i.e., city council, county board of supervisors).
Public Health Goal (PHG)	Level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.
Regulatory Action Level (AL)	Concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.
Secondary Drinking Water Standards (SDWS)	MCLs for contaminants that affect taste, odor, or appearance of drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.
Treatment Technique (TT)	A required process intended to reduce the level of a contaminant in drinking water.
SWRCB	State Water Resources Control Board of California

SOURCES OF DRINKING WATER & CONTAMINANTS THAT MAY BE PRESENT IN SOURCE WATER

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals, can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- Radioactive contaminants, that can be naturally occurring or be the result of oil and gas production and mining activities.

ABOUT YOUR DRINKING WATER QUALITY

DRINKING WATER CONTAMINANTS DETECTED

The data tables below list all the drinking water contaminants that were detected during the most recent sampling for the constituent. The presence of these contaminants in the water does not necessarily indicate that the water poses a health risk. The State Board allows us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of the data, though representative of the water quality, are more than one year old. Any violation of an AL, MCL, MRDL, or TT is asterisked.

CHEMICAL	MCL	PHG (MCLG)	AVERAGE AMOUNT	RANGE OF DETECTION	MCL VIOLATION	RECENT TEST YEAR	TYPICAL SOURCE OF CONTAMINANT
PRIMARY DRINKING WATER STANDARDS - Health - Related Standards							
RADIOLOGICALS							
Gross Alpha Particle Activity (pCi/L)	15	0	ND	7.51	No	2024	Erosion of natural deposits
Uranium (pCi/L)	20	0.43	ND	15	No	2024	Erosion of natural deposits
SYNTHETIC ORGANIC CHEMICALS							
1,2,3 Trichloropropane [TCP] (ng/L)	5	0.7	ND	ND	No	2024	Industrial & Agricultural chemical discharge
Perchlorate (µg/L)	6	1	2	ND - 2.0	No	2025	Industrial environmental contamination
INORGANIC CHEMICALS							
Arsenic (ppb)	10	0.004	4.37	ND - 8.00	No	2022	Erosion of natural deposits
Fluoride (ppm) <i>Naturally Occurring</i>	2*	1	1.34	0.83 - 1.90	No	2025	Erosion of natural deposits
Hexavalent Chromium (µg/L)	10	0.02	2.3	2.2 - 2.4	No	2025	Runoff/leaching from natural deposits
Nitrate (ppm)	10	10	4.8	4.8	No	2025	Leaching from fertilizer use
*See Page 4 for more information on Fluoride							

SECONDARY DRINKING WATER STANDARDS - Aesthetic Standards, Not Health-Related							
Aluminum (ppb)	200	NA	ND	ND	No	2022	Erosion of natural deposits
Chloride (ppm)	500	NA	19.43	7.5 - 38	No	2022	Runoff/leaching from natural deposits
Iron (ppb)	300	NA	ND	ND	No	2022	Leaching from natural deposits
Odor - Threshold (units)	3	NA	1	1	No	2022	Naturally-occurring organic materials
Specific Conductance (µmhos/cm)	1600	NA	360	360	No	2022	Substances that form ions in water
Sulfate (ppm)	500	NA	38	17 - 77	No	2022	Runoff/leaching from natural deposits
Total Dissolved Solids (ppm)	1000	NA	250	190 - 380	No	2022	Runoff/leaching from natural deposits
Turbidity (NTU)	5	NA	0.22	ND - 0.55	No	2022	Soil runoff

UNREGULATED CHEMICALS OF INTEREST							
Hardness as CaCO ₃ (ppm)	NR	NA	181.48	80.9 - 296	NA	2022	Runoff/leaching from natural deposits
Sodium (ppm)	NR	NA	23.20	11 - 55	NA	2022	Runoff/leaching from natural deposits
MRDLG = maximum residual disinfectant level goal; MRDL = maximum residual disinfectant level; MCL = maximum contaminant level; MCLG = maximum contaminant level goal; N/A = not applicable; ND = not detected; NR = not regulated; PHG = public health goal; NL = Notification Level; ppb = parts per billion or micrograms per liter; ppm = parts per million or milligrams per liter; SMCL = secondary MCL; µmho/cm = micromhos per centimeter; < = average is less than the reporting limit; pCi/l = picocuries per liter ±UCMR require reporting for five years. Detections for UCMR (Unregulated Contaminant Monitoring Rule) contaminants are removed from the report once they have reached the fifth year							

CHEMICAL	ACTION LEVEL (AL)	PHG	90TH PERCENTILE	SITE EXCEEDING AL/NUMBER OF SITES	AL VIOLATION	NO. OF SCHOOLS REQUESTING LEAD SAMPLING	TYPICAL SOURCE OF CONTAMINANT
LEAD AND COPPER CONCENTRATIONS AT RESIDENTIAL TAPS							
Copper (ppm)	1.3	0.3	0.24	0/10	No	NA	Corrosion of household plumbing
Lead (ppb)	15	0.2	ND	0/10	No	0	Corrosion of household plumbing

The most recent set of samples (10 residences) were collected in July 2025. Copper was detected in 9 out of the 10 samples. None exceeded the regulatory action level (AL). Lead was not detected (ND) in any samples. None exceeded the regulatory AL. AL is the concentration of lead or copper which if exceeded in more than 10 percent of the samples tested, triggers treatment or other requirements that a water system must follow. In 2025, no schools submitted a request to be sampled for lead.

CHEMICAL	MCL (MRDL/MRDLG)	AVERAGE	RANGE OF DETECTION	MCL VIOLATION	RECENT TEST YEAR	TYPICAL SOURCE OF CONTAMINANT
DISTRIBUTION SYSTEM WATER QUALITY						
Chlorine Residual (ppm)	4	1.37	0.67 - 2.1	No	2025	Drinking water disinfectant
Haloacetic Acids (5) (HAA5) (ppb)	60	2.55	1.20 - 3.90	No	2025	Byproduct of chlorine disinfection
Fluoride (ppm)	2*	1.13	0.82 - 2.0	No	2025	Byproduct of drinking water disinfection
Total Trihalomethanes (TTHMs) (ppb)	80	18.5	11.0 - 26.0	No	2025	Byproduct of chlorine disinfection
Turbidity (ntu)	5**	0.1	ND - 0.37	No	2025	Soil runoff
Odor (ton)	3**	1	1	No	2025	Byproduct of drinking water disinfection

*Six locations in KID's distribution system are tested quarterly for fluoride at the request of the State Board. ** Contaminant is regulated by a secondary standard to maintain aesthetic qualities (taste, odor, color).

CHEMICAL	MCL	PHG (MCLG)	HIGHEST NO. OF DETECTIONS	NO. OF MONTHS IN VIOLATION	MCL VIOLATION	RECENT TEST YEAR	TYPICAL SOURCE OF CONTAMINANT
REVISED TOTAL COLFIORM RULE - Detection of Coliform Bacteria							
MICROBIOLOGICAL							
<i>E. Coli</i> (state RTCR)	(a)	0	0	0	No	2025	Human and animal fecal waste

Health Effects Language: E. coli are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Human pathogens in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a greater health risk for infants, young children, some of the elderly, and people with severely-compromised immune systems.

Any violation of an AL, MCL, MRDL, or TT is asterisked. (a) routine and repeat samples are total coliform-positive and either is E. coli-positive.

CHEMICAL	MCL	PHG (MCLG)	HIGHEST NO. OF DETECTIONS	NO. OF MONTHS IN VIOLATION	MCL VIOLATION	SAMPLE DATES	TYPICAL SOURCE OF CONTAMINANT
GROUND WATER RULE - Fecal Indicator-Positive Groundwater Source							
MICROBIOLOGICAL							
Fecal Indicator <i>E. Coli</i> (GWR)	0	(0)	0	0	No	2025	Human and animal fecal waste
Enterococci	TT	NA	0	0	No	2025	Human and animal fecal waste
Coliphage	TT	NA	0	0	No	2025	Human and animal fecal waste
Health Effects Language: Fecal coliforms and <i>E. coli</i> are bacteria whose presence indicates that the water may be contaminated with human or animal wastes. Microbes in these wastes can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a special health risk for infants, young children, some of the elderly, and people with severely compromised immune systems.							

SUMMARY INFORMATION for contaminants exceeding an MCL, MRDL, AL, or violation of any TT or monitoring or reporting requirements

Kinneloa Irrigation District had no violations of any primary or secondary drinking water standard, maximum residual disinfectant level, action level, treatment technique, or monitoring and reporting requirement during the 2025 reporting period.

EATON FIRE WATER QUALITY

In January 2025, the Eaton Fire caused significant destruction in and around the Kinneloa Irrigation District service area. In coordination with the State Water Resources Control Board (SWRCB), the District issued a Do Not Drink advisory on January 8, 2025. Per an order from the Division of Drinking Water (DDW), the District developed sampling & monitoring plans to test for volatile organic compounds (VOCs), particularly benzene throughout the distribution system. Benzene is a chemical compound released during the burning of structures and materials that can potentially enter a water distribution system through damaged pipes or loss of system pressure, posing serious health risks if consumed. All samples were analyzed by an accredited laboratory and confirmed that the District's potable water supply met all drinking water standards. The advisory was promptly lifted on January 21, 2025, following receipt of the results.

In accordance with DDW's post-fire ongoing monitoring recommendations, the District continued testing for bacteriological quality, benzene, other VOCs, and asbestos throughout the distribution system for the remainder of 2025. All samples were analyzed by an accredited laboratory, and results confirmed the District's potable water supply met all drinking water standards throughout the ongoing recovery process.

CROSS CONNECTION CONTROL PROGRAM

In June 2025, Kinneloa Irrigation District updated its Cross-Connection Control Program to comply with the latest requirements set forth by the State of California, including Title 17 of the California Code of Regulations and the SWRCB's Cross-Connection Control Policy Handbook. Customers whose plumbing systems pose a potential hazard to the public water supply may be required by the District to install an approved backflow prevention assembly. Residential, commercial, and industrial customers with a high potential for contamination must install and maintain backflow prevention assemblies. Customers who receive an annual testing notice from the District must have their assembly tested by a KID-authorized certified tester at the customer's expense, and results must be submitted to kid@kidwater.info. For more information, visit <https://www.kinneloirrigationdistrict.info/cross-connection-control-program>

DISTRICT UPDATE ON FLUORIDE

KID's fluoride variance from the State Water Resources Control Board expired on December 13, 2023. KID is now required to meet the California fluoride maximum contaminant level (MCL) of 2 mg/L. In response, the District underwent necessary system changes to remain in compliance. All gravity-fed groundwater tunnels were removed from the distribution system and redirected to groundwater recharge (spreading). In 2025, all remaining active water sources tested at or below 2 mg/L for fluoride.

LEAD & COPPER RULE - LEAD SERVICE LINE INVENTORY

RULE, REVISIONS, AND IMPROVEMENTS

In compliance with the SWRCB's Lead and Copper Rule requirements, Kinneloa Irrigation District maintains a Lead Service Line Inventory (LSLI) of all service line materials within the District's distribution system. Based on a thorough review of historical records and field investigations, the District has determined that there are no lead or galvanized service lines requiring replacement within its distribution system. This determination includes both District-owned and customer-owned service lines. During 2025, no service lines were identified, replaced, or reclassified for lead or galvanized requiring replacement. To view the District's written statement on the Lead Service Line Inventory, visit <https://tinyurl.com/KIDLSLI25>

REGULATION OF DRINKING WATER AND BOTTLED WATER QUALITY

In order to ensure that tap water is safe to drink, the U.S. EPA and the State Board prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

ADDITIONAL GENERAL INFORMATION ON DRINKING WATER

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline (1-800-426-4791).

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. U.S. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Lead: If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Kinneloa Irrigation District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or [athttp://www.epa.gov/lead](http://www.epa.gov/lead).

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and/or flush your tap for 30 seconds to 2 minutes before using tap water. Additional information is available from the U.S. EPA Safe Drinking Water Hotline (1-800-426-4791).

Nitrate: Testing conducted in 2025 found detectable levels of nitrate in KID's groundwater sources; however, the concentrations were well below the regulatory action threshold.

Nitrate in drinking water at levels above 10 mg/L is a health risk for infants of less than six months of age. Such nitrate levels in drinking water can interfere with the capacity of the infant's blood to carry oxygen, resulting in a serious illness; symptoms include shortness of breath and blueness of the skin. Nitrate levels above 10 mg/L may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant women and those with specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask advice from your health care provider. Nitrate levels may rise quickly for short periods of time because of rainfall or agricultural activity.

Arsenic: While your drinking water meets the federal and state standards for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the cost of removing arsenic from drinking water. The U.S. Environmental Protection Agency continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

Cryptosporidium: Groundwater is protected from many infectious organisms, such as the parasite cryptosporidium, by the natural filtration action of water percolating through soils. There is no indication that Cryptosporidium has breached this natural soil filter and entered the KID water supply.

Chromium (hexavalent): Testing conducted in 2025 found detectable levels of hexavalent chromium in the District's groundwater sources; however, the concentrations were well below the regulatory action threshold.




You have a 1 1/2" meter.

The 2025 Consumer Confidence Report is now available for viewing. Learn more about your drinking water by visiting the following link: <https://tinyurl.com/KID2025CCR>

To request a copy by mail, call the office at (626) 797- 6295. Este informe contiene informacion muy importante sobre su agua potable. Favor de comunicarse con Kinneoloa Irrigation District a 1999 Kinclair Drive Pasadena CA 91107 - (626) 797-6295 para asistirlo en espanol.

ACCOUNT #	1762-01
Location	P1762
Amount Due Now	0.00
DUE UPON PRESENTATION	

Monthly Usage (CCF)

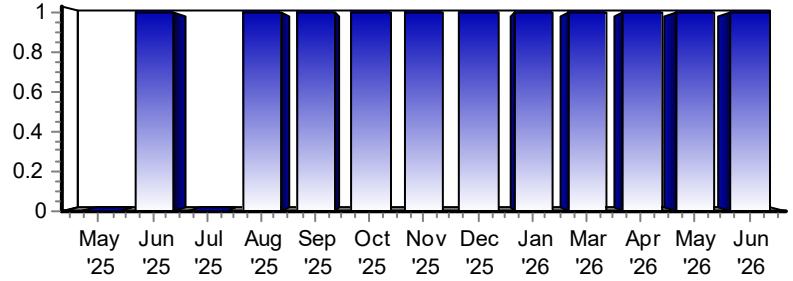

See reverse side for Water Rates.

ACCOUNT #	LOCATION #	SERVICE ADDRESS				SERVICE DATES	
1762-01	P1762	1999 KINCLAIR DR				5/6/2026 - 6/5/2026	
POSTED DATE	DESCRIPTION	CURRENT	PREVIOUS	USAGE (CCF)	READING DATES	DAYS	AMOUNT
5/31/2026	Balance Forward: 05/31/2026						0.00
6/3/2026	*Water Usage Charge	1403	1402	1	4/30/2026 - 5/31/2026	31	0.00
STATEMENT DATE						PAY THIS AMOUNT	
6/3/2026						0.00	

PLEASE RETURN BOTTOM PORTION IF MAILING PAYMENT

Customer: KINNELOA IRRIGATION DISTRICT
Service For: 1999 KINCLAIR DR

ACCOUNT #	1762-01
Location	P1762
Amount Due Now	0.00
DUE UPON PRESENTATION	

Electronic Debit - DO NOT PAY



1999 Kinclair Drive
Pasadena, CA 91107-1017

Kinneoloa Irrigation District
1999 Kinclair Dr
Pasadena, CA 91107-1017

Payable to: KID or Kinneoloa Irrigation District

Payment Login Portal:
<https://kinneoloa.utilitybillingsystem.us>

IMPORTANT INFORMATION

2026 Water Rates:

Water Usage Charge = \$8.22 per CCF (1 CCF = 748 gallons)

Daily Service Charge is based on customer meter size

5/8" - 3/4" - \$3.19 **1"** - \$3.19 **1-1/2"** - \$6.00 **2"** - \$9.37

Water Usage Charge: Water usage is measured in CCF. 1 CCF equals one hundred cubic feet or 748 gallons.

Daily Service Charge: This charge covers a portion of infrastructure and maintenance costs needed to ensure the water system is ready to serve customers 24 hours per day, 365 days of the year, and is computed on the actual number of days between meter readings.

Paying Your Bills: Payment can be made by check or money order and mailed to the Kinneloa Irrigation District office or deposited in any of the courtesy drop boxes listed at the bottom. **Do not mail or deposit cash.** Account access and payment options are available at www.kinneloa Irrigation District info. Register your account using your Full Name on Bill and account number exactly as shown on your billing statement. Registering your account gives you access to many features: view your billing transactions or bill statement; make credit card payments; or request automatic payment from your checking or savings account. **Credit card payments cannot be made at the office. To pay by phone, call (877) 235-3182.** Payments not received on or before the last office business day of the month are not shown on this statement. **Failure to receive a bill will not excuse the responsibility for nonpayment penalties.** Call the office at (626) 797-6295 for any questions regarding payment.

Balance Forward: The balance shown on your water service statement that includes all previous charges and payments up to and including the "Balance Forward Date"

Balance Forward Date: The last calendar day of the month. This date reflects the last day payments, credits, and adjustments are posted. Any payments made or processed after this date will not be displayed on your water service statement for the current monthly billing cycle.

Delinquent Bills: Bills for service are due and payable upon presentation and become delinquent if not paid within 30 calendar days from the date of issue. On the twenty-first (21st) day of the month following presentation, which is approximately forty-five (45) days from the billing date, a penalty will be charged and a Past Due Notice will be

mailed to the water service Customer. If a payment of at least the past due balance is not made by the shut off date on the Past Due Notice, the water service is subject to termination. At least forty-eight (48) hours prior to actual termination, the District shall make a reasonable, good faith effort to contact an adult of the residence.

Water Code 22282.1: A District may refuse service to any land if outstanding charges for services already rendered such land have not been paid within a reasonable time.

Water Code 25806: Any charge for services not paid shall constitute a lien on the land upon which the service was rendered, even though the indebtedness may have been incurred by other than the owner.

Disputed Bills: Should you question this bill, please request an explanation and/or investigation by writing the District office within 10 days of the billing date. Nonpayment of a disputed or protested bill is not an excuse or mitigating circumstance. All bills must be paid on time. Your complaint should include the following: 1. A copy of your bill; 2. A letter explaining why you think the bill is incorrect; 3. A check or money order for the amount owed the District.

Rejected Payments: The Kinneloa Irrigation District will make demand upon the maker for a payment rejected by the financial institution for any reason. Rejected items are subject to a minimum \$30.00 service charge. Water service may be discontinued if a replacement payment is not made in a timely manner upon demand.

Late Charge: Any water service which is delinquent in payment will be charged a one time amount of \$15.00 and a simple interest amount at the rate of 10% per annum on the unpaid balance.

Service Charge: There will be a minimum charge of \$50.00 to begin water service or to reconnect any meter to the system for nonpayment of a bill or any other reason. There is no service charge if the customer requires the meter shut off/turned on to repair leaks. Please call the office if you need the water turned off at the meter.

Fluoride: The District staff is available to answer any questions or concerns about the existence of fluoride in the water system. Information about fluoride can be found in the Consumer Confidence Report which is available online at the District's website or a copy can be obtained by calling the office.

HOW TO CONTACT THE KINNELOA IRRIGATION DISTRICT

Office and Mailing Address: 1999 Kinclair Drive, Pasadena CA 91107-1017

Telephone: (626) 797-6295 • Fax: (626) 608-3168 • **24 Hour Emergency Service:** (626) 797- 6295 Option "9"

EMERGENCIES...Call 911

(Sheriff / Police / Fire / Medical)

OTHER COMMUNITY PHONE NUMBERS

USC Arcadia Hospital.....(626) 898-8000
Fire, Los Angeles County - Business (323) 881-2411
Fire, Los Angeles County Station 66 - Business.... (626) 798-3739
Fire, Pasadena – Business (626) 744-4655
Huntington Memorial Hospital.....(626) 397-5000

Pasadena Unified School District.....(626) 396-3600
Police, Pasadena – Business(626) 744-4241
Public Works, Los Angeles County(626) 458-5100
Sheriff, Los Angeles County - Altadena, Business...(626) 798-1131
California Highway Patrol.....(800) 835-5247

Make check or money order payable to:
KID or Kinneloa Irrigation District

The Kinneloa Irrigation District has 3 courtesy drop boxes:
❶ on the west side of Sierra Madre Villa north of Villa Knolls Drive
❷ on Kinneloa Canyon Road near Eaton Canyon Drive
❸ next to the driveway at 1999 Kinclair Drive

Comments

New Mailing Address

STREET _____
CITY _____ STATE _____ ZIP _____
DAY PHONE _____
EVENING PHONE _____
CELL PHONE _____ FAX _____
EMAIL _____

The Kinneloa Irrigation District: Formed in October of 1953 by Resolution of the Los Angeles County Board of Supervisors. It is a Public Water Agency operating under the rules and regulations of Division 11 of the State of California Water Code and **is not under the jurisdiction of the Public Utilities Commission.**



Melanie Timoteo <mt@kidwater.info>

Your Billing Statement from KINNELOA IRRIGATION DISTRICT is Available to View

1 message

noreply@utilitybillingsystem.us <noreply@utilitybillingsystem.us>
To: kid@kidwater.info

Wed, Jun 3, 2026 at 12:55 PM

Account Number: 2147-00 (IRR)
Customer Name: BROWN WELL

Billing Name: BROWN WELL
Service Address: 1993 SIERRA MADRE VILLA
Balance Due: \$0.00
Balance Forward: \$0.00
Statement Date: 6/3/2026

A new bill is available to view. Please click the link below to login and view your statement.

<https://kinneloa.utilitybillingsystem.us/Default.aspx?CompanyID=37327a67-bda3-4721-8ce3-c1b24aff2ef9>

YOUR STATEMENT BALANCE IS DUE UPON PRESENTATION

The 2025 Consumer Confidence Report is now available for viewing. Learn more about your drinking water by visiting the following link:
<https://tinyurl.com/KID2025CCR>

To request a copy by mail, call the office at (626) 797- 6295.
Este informe contiene informacion muy importante sobre su agua potable. Favor de comunicarse con Kinneloa Irrigation District a [1999 Kinclair Drive Pasadena CA 91107](#) - (626) 797-6295 para asistirlo en espanol.



To view Important Information about your bill click here:
<https://www.kinneloirrigationdistrict.info/important-information-about-your-water-bill>



[Subscribe](#)

[Contact Us](#)

- [Home](#)
- [About Us ▾](#)
- [Customers ▾](#)
- [Water Quality ▾](#)
- [Water Use Efficiency ▾](#)
- [District News ▾](#)
- [Contact Us](#)

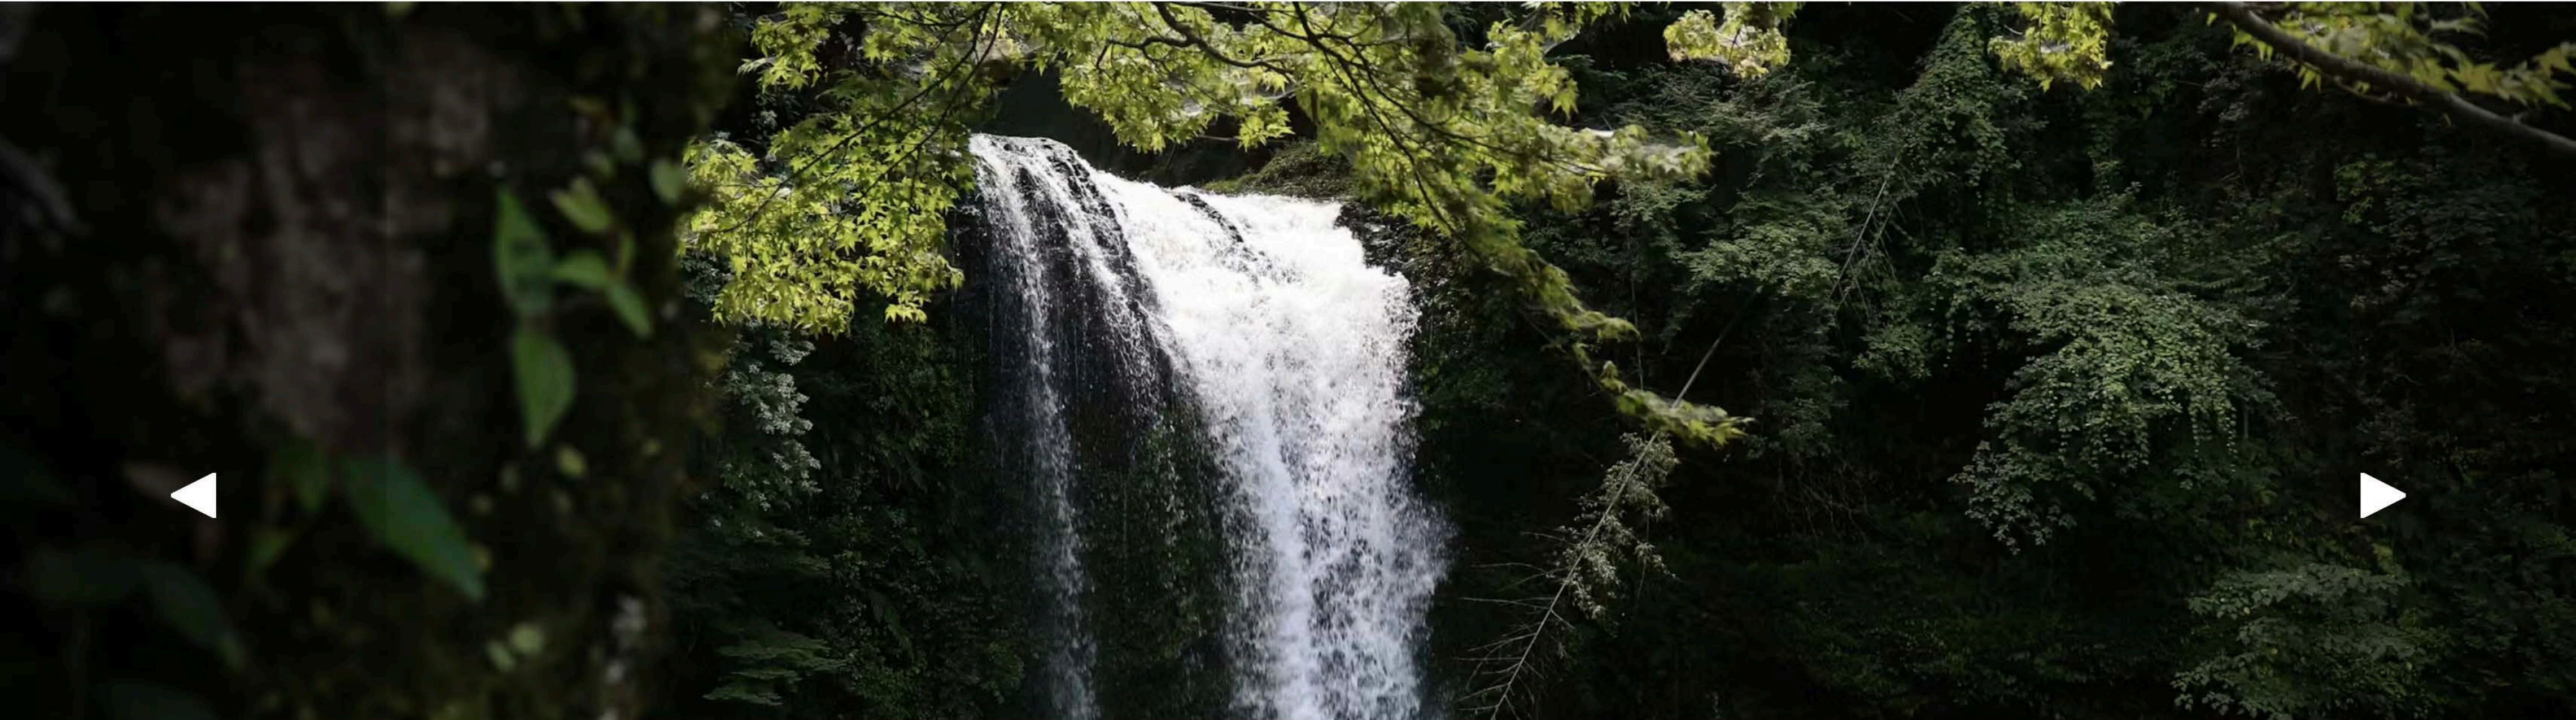

2025 Consumer Confidence Report Now Available