



THE SANTA CLARITA VALLEY 2018 WATER QUALITY REPORT

The State Water Resources Control Board Division of Drinking Water (DDW) requires community water systems to publish and make available an annual Consumer Confidence Report to provide background on the quality of your water and to show compliance with federal and state drinking water standards.

This 2018 Annual Water Quality Report is a snapshot of last year's water quality. It describes in detail the quality of local water supplies in the Santa Clarita Valley during 2017. Included are details about where your water comes from, what it contains and how it compares to strict State standards. We are committed to providing you with information because informed customers are our best allies.

Last year, your tap water again met all U.S. EPA and California State drinking water health standards. Castaic Lake Water Agency (CLWA) and the local water retailers (CLWA Santa Clarita Water Division (SCWD), Los Angeles County Waterworks District #36 (LACWW#36), Newhall County Water District (NCWD) and Valencia Water Company (VWC)) continuously work to ensure you have a reliable and safe drinking water supply at a reasonable cost. We are committed to maintaining and delivering safe drinking water for you, our customers.

On January 1, 2018, CLWA, NCWD, SCWD and VWC merged to become the Santa Clarita Valley Water Agency (SCV Water). Our mission is providing responsible water stewardship to ensure the Santa Clarita Valley has reliable supplies of high quality water at a reasonable cost. The new agency is founded on three principles: 1) Economics, with one-time and ongoing savings; 2) Efficiencies and Effectiveness, with even better customer service; and 3) Enhanced water management, working together to modernize and enhance water service for our region.


Water quality is only one component of the total value of water. Through a unified approach, SCV Water is better positioned to take a holistic approach to major initiatives and mandates in the coming years, such as groundwater sustainability and watershed management.

If you have any questions about this report or water quality, please contact SCV Water, or your retail division directly. Contact information is provided at the end of this report.

Sincerely,

Matthew G. Stone | General Manager | SCVWA
Website: www.yourscvwater.com

Adam Ariki | District Engineer | LACWW #36
Website: www.lacwaterworks.org



NOTE: All of the test results in this report were analyzed in 2017 unless noted otherwise. Any chemical not listed in this report was not detected or was detected below the detection level for purposes of reporting. Your local water supplier is in compliance with all drinking water regulations unless a specific violation is noted.

MICROBIOLOGICAL

Microbial contaminants, such as viruses and bacteria, can be naturally occurring or result from urban storm water runoff, sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

Drinking water is tested throughout the distribution systems weekly for Total Coliform (TC) bacteria. TC are naturally occurring in the environment and are indicators for finding possible pathogenic contamination of a drinking water system. The MCL for TC is 5% of all monthly tests showing positive results for larger systems and two positive samples per month in smaller systems. If TC is positively identified through routine testing, the water is further analyzed for *Escherichia coli* (*E. coli*) which indicates the potential of fecal contamination. No *E. coli* was detected in any drinking water system in the Santa Clarita Valley (SCV) last year and no water system was out of compliance with the Total Coliform Rule. Additional tests did not detect the water-borne parasites *Cryptosporidium parvum* or *Giardia lamblia* in any sample of Castaic Lake water.

This report reflects changes in drinking water regulatory requirements during 2016. All water systems are required to comply with the state Total Coliform Rule. Effective April 1, 2016, all water systems are also required to comply with the federal Revised Total Coliform Rule. The new federal rule maintains the purpose to protect public health by ensuring the integrity of the drinking water distribution system and monitoring for the presence of microbes (i.e., TC and *E. coli* bacteria). The U.S. EPA anticipates greater public health protections as the new rule requires water systems that are vulnerable to microbial contamination to identify and fix problems. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment to determine if any sanitary defects exist. If found, these must be corrected by the water system.

METALS AND SALTS

Metals and salts are required to be tested in groundwater once every three years and in Castaic Lake water every month. Small quantities of naturally occurring arsenic are found in Castaic Lake and in some groundwater wells. Arsenic, a metalloid, is present due to the natural erosion of the rocks that water travels over or through. While your drinking water meets the federal and state standard for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. The US Environmental Protection Agency (USEPA) continues to research the health effects of low levels of arsenic which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

A number of naturally occurring salts are found in both surface and groundwater. These include chloride, fluoride, nitrate, nitrite, calcium, magnesium, potassium and sodium. Collectively, these are referred to as Total Dissolved Solids (TDS). Calcium and magnesium make up what is known as water hardness which can cause scaling as a result of calcium and magnesium precipitates. Fluoride is not added to your drinking water. Any fluoride detection is naturally occurring in the groundwater.

Nitrate in drinking water at levels above 10 mg/L (as nitrogen) is a health risk for infants less than six months of age. Such nitrate levels in drinking water can interfere with the capacity of the infant's blood to carry oxygen, resulting in a serious illness; symptoms include shortness of breath and blueness of the skin. Nitrate levels above 10 mg/L (as nitrogen) may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant woman and those with certain specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask advice from your health care provider. Nitrate was not detected above the MCL in any sample.

LEAD AND COPPER

Every three years, local water retailers are required to sample for lead and copper at specific customer taps as part of the Lead and Copper Rule. Lead and copper is also tested in source water supplies (i.e., groundwater and surface water). If present, elevated levels of lead can cause serious health problems especially for pregnant women and young children. No traces of lead were detected in any source waters in the Santa Clarita Valley by any of the local water retailers. Lead in drinking water is primarily

from materials and components associated with service lines and home plumbing systems. Your water retailer is responsible for providing high quality drinking water but cannot control the variety of materials used in customer plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your home's water, you can have your water tested by a private laboratory. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the USEPA's Safe Drinking Water Hotline or at www.epa.gov/lead.

In January 2017, the DDW established a voluntary program for lead testing in school drinking water. The number of schools that requested lead be tested in their drinking water is shown in the following table:

	NCWD	SCWD	VWC	WW #36
Number of schools that requested lead testing	1	10	4	0

ORGANIC COMPOUNDS

Organic chemical contaminants including synthetic and volatile organic compounds (VOC) are by-products of industrial processes and petroleum production. Castaic Lake and local groundwater wells are tested at least annually for VOCs. Trichloroethylene (TCE) and Tetrachloroethylene (PCE) were found in trace amounts (below the MCL) at a few locations. Consumption of water containing TCE or PCE in excess of the MCL over many years may lead to liver problems and an increased risk of cancer.

TURBIDITY

Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of water quality. High turbidity can hinder the effectiveness of disinfectants. Furthermore, at the treatment plants, turbidity is monitored because it is a good indicator of the effectiveness of our filtration systems.

DRINKING WATER SOURCE ASSESSMENT AND PROTECTION

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.


Contaminants that may be present in source water include:

- Microbial contaminants such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides that may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application and septic systems.
- Radioactive contaminants that can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the USEPA and the State Water Resources Control Board (SWRCB) Division of Drinking Water (DDW) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide protection for public health. Additional information on bottled water is available on the California Department of Public Health website (<https://www.cdph.ca.gov/programs/CEH/DFDCS/Pages/fdbprograms/foodsafetyprogram/water.aspx>).

The local water retailers completed the Drinking Water Source Assessment and Protection (DWSAP) program for existing groundwater sources in 2002. DWSAPs are also completed for each new groundwater well placed into service by the retailers. Each DWSAP looks at vulnerability to contamination and assesses potential sources of contamination from sources such as: dry cleaners, auto repair shops, gas stations, medical facilities, schools and other facilities located in the vicinity of each groundwater source. For more information regarding DWSAPs, contact your local water retailer whose contact information is included in this report or visit the following website: https://www.waterboards.ca.gov/drinking_water/certlic/drinking_water/DWSAP.html. You may request a summary of the assessment be sent to you by contacting the SWRCB, DDW district engineer at (818) 551-2004.

CLWA PROVIDES WATER TO LOCAL RETAILERS

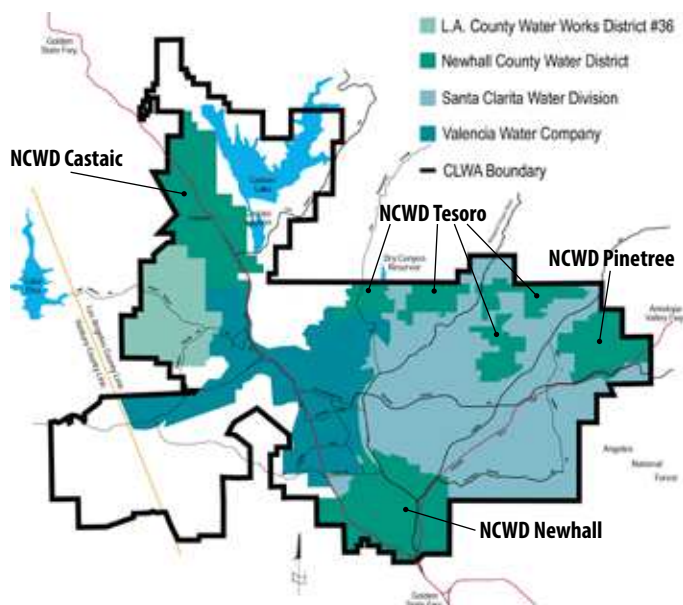

CLWA receives and treats surface water from the State Water Project (SWP) and other imported sources. The SWP consists of facilities operated by the California Department of Water Resources to transfer water to SWP contractors for agricultural or urban supply uses. CLWA operates two water treatment plants, the Earl Schmidt Filtration Plant in Castaic and the Rio Vista Water Treatment Plant in Saugus. The SCV's four water retailers distribute the treated imported water together with groundwater from the Alluvial Aquifer and the Saugus Formation. Water quality information for your area is presented in the table contained in this report.

CLWA Santa Clarita Water Division provides water to a portion of the City of Santa Clarita and unincorporated areas of Los Angeles County including Saugus, Canyon Country and Newhall. Customers received approximately 88% imported water and 12% local groundwater in 2017.

Los Angeles County Waterworks District #36 serves customers located in Hasley Canyon and Val Verde. Customers received 0% imported water and 100% local groundwater in 2017.

Newhall County Water District serves customers located in the Castaic, Newhall, Pinetree and Tesoro del Valle areas. In 2017, Castaic customers received 55% imported water and 45% local groundwater, Newhall customers received 64% imported water and 36% local groundwater. Pinetree customers received 99.7% imported water and 0.3% groundwater, and Tesoro del Valle customers received 100% imported water.

Valencia Water Company supplies water to customers in Valencia, Stevenson Ranch, and parts of Castaic, Saugus, and Newhall. In 2017, customers received 65% imported water, 33% local groundwater and 2% recycled water (delivered to large landscape customers).

CHEMICALS IN THE NEWS – PERCHLORATE

Perchlorate is an inorganic chemical used in solid rocket propellant, fireworks, explosives and a variety of industries. It usually gets into drinking water as a result of environmental contamination from historic industrial operations that used, stored, or disposed of perchlorate and its salts. Perchlorate has been shown to interfere with uptake of iodide by the thyroid gland, and thereby reduce the production of thyroid hormones leading to adverse affects associated with inadequate hormone levels.

A known perchlorate contaminant plume has been identified and several wells have tested positive for perchlorate. In October 2007, the DDW adopted an MCL of 6 ug/L for perchlorate. DDW issued an amendment to CLWA's Domestic Water Supply Permit on December 30, 2010, authorizing the use of the perchlorate-treatment facility and, on January 25, 2011, CLWA introduced the treated water into the distribution system in full compliance with the requirements of its amended water-supply permit.

RADIOLOGICAL TESTS

Radioactive compounds can be found in both ground and surface waters, and can be naturally occurring or be the result of oil and gas production and mining activities. Testing is conducted for two types of radioactivity: alpha and beta. If none is detected at concentrations above five picoCuries per liter (pCi/L) no further testing is required. If it is detected above 5 pCi/L, the water must be checked for uranium and/or radium. Monitoring for radionuclides can be different for each groundwater well. Because of this, not all data may be from the 2017 calendar year.

WATER QUALITY DEFINITIONS

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants and are available from the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

USEPA, DDW and the California Environmental Protection Agency (CalEPA) set goals and legal standards for the quality of drinking water. These standards are intended to protect consumers from contaminants in drinking water. Most of the standards are based on the concentration of contaminants, but a few are based on a Treatment Technique (TT), a required process intended to reduce the level of a contaminant in drinking water. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

The following definitions and acronyms are used for drinking water compliance and reporting purposes:

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG) or Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by Cal/EPA. MCLGs are set by the USEPA.

Primary Drinking Water Standard (PDWS): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Detection Limit for Purposes of Reporting (DLR): The smallest concentration of a contaminant that can be measured and reported. DLRs are set by the DDW (same as MRL, Minimum Reporting Level, set by USEPA).

Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Notification Level (NL): State guidelines developed by DDW that address the concentration of a contaminant which, if exceeded, triggers public notification.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Primary Drinking Water Contaminants: Contaminants associated with the protection of public health and that have enforceable standards.

Secondary Drinking Water Contaminants: Contaminants associated with aesthetic considerations such as taste, color and odor, and that have non-enforceable guidelines.

DISINFECTION BY-PRODUCTS

CLWA uses ozone and chloramines to disinfect its water while the water retailers use various forms of chlorine and chloramines to disinfect their groundwater sources. Disinfection By-Products (DBPs), which include Total Trihalomethanes (TTHMs) and Haloacetic Acids (HAA5), are generated by the interaction between naturally occurring organic matter and disinfectants such as chlorine. TTHMs and HAA5 are measured at multiple locations throughout the distribution system. Each location is averaged once per quarter and reported as a running average by location. The DBP bromate is formed when the primary disinfectant ozone is applied converting bromide to bromate. Bromate is measured weekly in the surface water treatment plant and compliance is based on a running annual average.

UNREGULATED CONTAMINANT MONITORING RULE

The USEPA requires utilities to sample for emerging contaminants as part of the Unregulated Contaminant Monitoring Rule (UCMR). Every five (5) years the USEPA prepares a list of unregulated contaminants for drinking water suppliers to analyze. UCMR results are then used to assist in the development of future drinking water regulations. The third round of UCMR sampling (UCMR 3) was completed by all water retailers between 2013-2015. Currently, the USEPA is preparing for UCMR 4. For more information please contact your local water retailer or visit the USEPA website www.epa.gov/dwucmr/learn-about-unregulated-contaminant-monitoring-rule.



Este informe contiene información muy importante sobre su agua potable.

Si usted quisiera información de este reporte traducido en español, comuníquese con su distribuidor local de agua que se muestra arriba.

Castaic Lake Water Agency (now Santa Clarita Valley Water Agency (SCVWA))

Jeff Koelwyn | 661-297-1600 x223

E-mail: jkoelwyn@scvwa.org | Website: www.yourscvwater.com

The Board of Directors meets at 6:30 pm generally on the first and third Tuesdays of each month at the Rio Vista Administration Building at 27234 Bouquet Canyon Road, Santa Clarita, 91350. Dates may vary; please visit website at <http://yourscvwater.com/index.php/governance/#board-meetings> for the Board calendar.

CLWA Santa Clarita Water Division (now SCVWA Santa Clarita Water Division)

Ryan Bye | 661-255-8223 x117

E-mail: rbye@scvwa.org | Website: www.yourscvwater.com

Newhall County Water District (now SCVWA Newhall Water Division)

Ernesto Velazquez | 661-259-3610 x216

E-mail: evelazquez@scvwa.org | Website: www.yourscvwater.com

Valencia Water Company (now SCVWA Valencia Water Division)

Jenny Anderson | 661-295-6579

E-mail: janderson@scvwa.org | Website: www.yourscvwater.com

The Finance and Operations Committee (for all three SCVWA Divisions) meets at 5:30 pm on the second Thursday of each month at the SCWD office at 26521 Summit Circle, Santa Clarita, 91350

Los Angeles County Waterworks District No. 36

Bing Hua, P.E. | 626-300-3337

County of Los Angeles/ Waterworks Division

E-mail: bhua@dpw.lacounty.gov | Website: www.lacwaterworks.org

Waterworks District No. 36 is governed by the Los Angeles County Board of Supervisors that meets every Tuesday at 9:30 am at the Kenneth Hahn Hall of Administration, 500 West Temple Street Room 381B, Los Angeles, 90012

On Tuesdays following a Monday holiday, the meetings begin at 1:00 pm.

