




CITY OF LYNWOOD

2023 CONSUMER CONFIDENCE REPORT

Since 1991, California water utilities have been providing information on water served to its consumers. This report, prepared in May 2024, is a snapshot of the tap water quality that we provided last year. Included are details about where your water comes from, how it is tested, what is in it, and how it compares with state and federal limits. We strive to keep you informed about the quality of your water, and to provide a reliable and economic supply that meets all regulatory requirements.

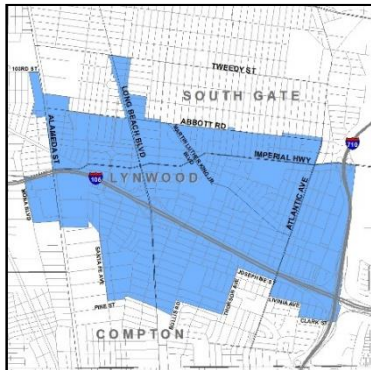

Where Does My Tap Water Come From?

Your tap water comes from two (2) sources: local groundwater and imported surface water. The City pumps local groundwater from deep wells within the Central Basin. The City also imports water from the Metropolitan Water District of Southern California's (MWD), which supplies water from both the Colorado River and the State Water Project in Northern California. These water sources supply our service area shown on the adjacent map. The quality of local groundwater delivered to your home is presented in this report.

How is My Drinking Water Tested?

Your drinking water is tested regularly for unsafe levels of chemicals, radioactivity and bacteria at the source and in the distribution system. We test weekly, monthly, quarterly, annually or less often depending on the substance. State and Federal laws allow us to test some substances less than once per year because their levels do not change frequently. Some of the data, though representative, are more than one year old. All water quality tests are conducted by specially trained technicians in state-certified laboratories.

What Are Drinking Water Standards?

The Federal Environmental Protection Agency (EPA) limits the amount of certain substances allowed in tap water. In California, the State Water Resources Control Board (State Water Board) regulates tap water quality by enforcing limits that are at least as stringent as the USEPA's. Historically, California limits are more stringent than the Federal regulations.

There are two types of these limits, also known as standards. Primary standards protect you from substances that could potentially affect your health. Secondary standards regulate substances that affect the aesthetic qualities of water.

Regulations set a Maximum Contaminant Level (MCL) for each of the primary and secondary standards. The MCL is the highest level of a substance that is allowed in your drinking water.

Public Health Goals (PHGs) are set by the California Environmental Protection Agency. PHGs provide more information on the quality of drinking water to customers, and are similar to their federal counterparts, Maximum Contaminant Level Goals (MCLGs).

PHGs and MCLGs are advisory levels that are nonenforceable. Both PHGs and MCLGs are concentrations of a substance below which there are no known or expected health risks.

How Do I Read the Water Quality Table?

Although we test for over 100 substances, regulations require us to report only those found in your water. The first column of the water quality table lists substances detected in your water. The next columns list the average concentration and range of concentrations found in your drinking water. Following are columns that list the MCL and PHG or MCLG, if appropriate. The last column describes the likely sources of these substances in drinking water.

To review the quality of your drinking water, compare the highest concentration and the MCL. Check for substances greater than the MCL. Exceedance of a primary MCL does not usually constitute an immediate health threat. Rather, it requires testing the source water more frequently for a short duration. If test results show that the water continues to exceed the MCL, the water must be treated to remove the substance, or the source must be removed from service.

Why Do I See So Much Coverage in the News About the Quality Of Tap Water?

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, including viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals that can be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.
- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the USEPA and the State Water Board prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Water Board regulations also establish limits for contaminants in bottled water that must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Federal EPA's Safe Drinking Water Hotline (1-800-426-4791). You can also get more information on tap water by logging on to these helpful web sites:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information> - (USEPA)
- http://www.waterboards.ca.gov/drinking_water/certlic/dinkingwater/Chemicalcontaminants.html - (State Board)

Lead: If present, elevated levels of lead can cause serious health problem, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with services lines and home plumbing.

The City of Lynwood is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components.

When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/lead>.

Arsenic: While your drinking water meets the federal and state standard for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. The U.S. Environmental Protection Agency continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems

Should I Take Additional Precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections.

These people should seek advice about drinking water from their health care providers. The EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection of *Cryptosporidium* and other microbial contaminants are available from the Federal EPA's Safe Drinking Water Hotline (1-800-426-4791).

Source Water Assessment

MWD completed an assessment of its Colorado River and State Water Project supplies in 2002. Colorado River supplies are considered most valuable to recreation, urban/storm water runoff, increasing urbanization in the watershed, and wastewater. State Water Project supplies are considered most vulnerable to urban/storm water runoff, wildlife, agriculture, recreation and wastewater.

A copy of the assessment can be obtained by contacting MWD at (213) 217- 6850.

The City of Lynwood completed its source water assessment in 2003. A copy of the approved assessment may be obtained by mailing a request to Utility Services Manager, Water Division at 11330 Bullis Road, Lynwood CA 90262 or available online at Lynwoodca.gov.

How Can I Participate in Decisions On Water Issues That Affect Me?

The public is welcome to attend City Council meetings located at Lynwood City Hall, 11330 Bullis Road, Lynwood, CA 90262.

Meetings are held on the 1st and 3rd Tuesday of each month at 6:00 pm.

How Do I Contact My Water Agency If I Have Any Questions About Water Quality?

If you have specific questions about your tap water quality, please contact George Cambero at (310) 603-0220 ext. 804.

Some Helpful Water Conservation Tips

Did you know that the average U.S. household uses approximately 400 gallons of water per day or 100 gallons per person per day? Luckily, there are many low-cost and no-cost ways to conserve water. Small changes can make a big difference – try one today and soon it will become second nature.

- Take short showers – a 5 minutes shower uses 4 to 5 gallons of water compared to up to 50 gallons for a bath.
- Shut off water while brushing your teeth, washing your hair, and shaving and save up to 500 gallons a month.
- Use a water-efficient showerhead. They are inexpensive, easy to install, and can save you up to 750 gallons a month.
- Run your clothes washer and dishwasher only when they are full. You can save up to 1,000 gallons a month.
- Fix leaking toilets and faucets. Faucet washers are inexpensive and take only a few minutes to replace. To check your toilet for a leak, place a few drops of food coloring in the tank and
- Adjust your sprinklers so that water lands on your lawn/garden, not the sidewalk/driveway – save 500 gallons per month.
- Use organic mulch around plants to reduce evaporation – save hundreds of gallons a year.
- Visit <https://www.bewaterwise.com> for more information on water conservation, available rebates and native landscaping ideas.

Perfluoroheptanoic Acid

Visit us at www.lynwoodca.gov

CITY OF LYNWOOD

2023 CONSUMER CONFIDENCE REPORT

Results are from the most recent testing performed in accordance with State and Federal drinking water regulations. The State allows the City of Lynwood to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently.
Some of the data, though representative, are more than one year old.

PRIMARY STANDARDS MONITORED AT THE SOURCE - MANDATED FOR PUBLIC HEALTH								
ORGANIC CHEMICALS	Sampled 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Tetrachloroethylene (PCE) (µg/l)		0.89	ND - 1.9	ND	ND	5	0.06 ^(a)	Discharge from factories, dry cleaners, and auto shops (metal degreaser)
Trichloroethylene (TCE) (µg/l)		0.66	ND - 1.9	ND	ND	5	1.7 ^(a)	Discharge from metal degreasing sites and other factories
PRIMARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - MANDATED FOR PUBLIC HEALTH								
INORGANICS	Sampled from 2021 to 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Aluminum (mg/l) ^(d)		ND	ND	0.11	ND - 0.07	1	0.6 ^(a)	Erosion of natural deposits; residue from surface water treatment processes
Arsenic (µg/l) ^(c)		3.3	2.1 - 5.4	ND	ND	10	0.004 ^(a)	Erosion of natural deposits; glass/electronics production wastes; runoff
Barium (mg/l)		0.13	0.12 - 0.16	ND	ND	1	2 ^(a)	Discharges of oil drilling wastes and from metal refineries; erosion of natural deposits
Chromium (µg/l)		5.8	0.49 - 11	ND	ND	50	(100)	Discharge from steel and pulp mills and chrome plating; erosion of natural deposits
Fluoride (mg/l) ^(k)		0.32	0.26 - 0.37	0.70	0.6 - 0.8	2.0	1 ^(a)	Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories
Nickel (µg/l)		1.1	ND - 2.1	ND	ND	100	12	Erosion of natural deposits; discharge from metal factories
Nitrate (mg/l as N)		1.5	1.1 - 1.6	ND	ND	10	10 ^(a)	Runoff and leaching from fertilizer use/septic tanks/sewage, natural erosion
Selenium (µg/l)		1.7	ND - 2.2	ND	ND	50	30	Discharge from petroleum, glass, and metal refineries; erosion of natural deposits; discharge from mines and chemical manufacturers; runoff from livestock lots (feed additive)
RADIOLOGICAL	Sampled from 2021 to 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Gross Alpha (pCi/l) ^(d)		4.9	ND - 5.3	ND	ND - 5.0	15 ^(e)	0	Erosion of natural deposits
Gross Beta (pCi/l)		NA	NA	ND	ND	50 ^(e)	0	Decay of natural and man-made deposits
Radium 226 (pCi/l)		ND	ND	ND	ND	5 ^{(e)(i)}	0.05	Erosion of natural deposits
Radium 228 (pCi/l)		0.7	ND - 0.7	ND	ND		0.019	Erosion of natural deposits
Uranium (pCi/l)		3.4	1.6 - 4.6	0.5	ND - 3.0	20 ^(e)	0.5 ^(a)	Erosion of natural deposits
PRIMARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - MANDATED FOR PUBLIC HEALTH								
MICROBIALS	Sampled 2023	DISTRIBUTION SYSTEM				PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE % POSITIVE		RANGE % POSITIVE				
Total Coliform Bacteria		0.3%		0% - 2.1%		5%	0%	Naturally present in the environment
Fecal Coliform and <i>E.coli</i> Bacteria		0%		0%		0%	0%	Human and animal fecal waste
No. of Acute Violations		0		0		-	-	
DISINFECTION BY-PRODUCTS AND DISINFECTION RESIDUALS ^(f)	Sampled 2023	DISTRIBUTION SYSTEM				PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE		RANGE				
Trihalomethanes-TTHMS (µg/l)		23.2		ND - 16.3		80	-	By-product of drinking water chlorination
Haloacetic Acids (µg/l)		4.6		ND - 1.5		60	-	By-product of drinking water disinfection
Total Chlorine Residual (mg/l)		1.3		0.7 - 2.6		4.0 ^(g)	4.0 ^(h)	Drinking water disinfectant added for treatment
AT THE TAP PHYSICAL CONSTITUENTS	32 sites sampled in 2021	DISTRIBUTION SYSTEM				PRIMARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		90 th ile		# OF SITES ABOVE THE AL				
Copper (mg/l)		0.60 ⁽ⁱ⁾		0		1.3 AL	0.17 ^(a)	Internal corrosion of household plumbing, erosion of natural deposits
Lead (µg/l)		ND ⁽ⁱ⁾		0		15 AL	2 ^(a)	Internal corrosion of household plumbing, industrial manufacturer discharges

SECONDARY STANDARDS MONITORED AT THE SOURCE - FOR AESTHETIC PURPOSES

SECONDARY STANDARDS	Sampled from 2021 to 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		SECONDARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Aggressiveness Index (corrosivity)		12.4	12.2 - 12.5	12.3	12.1 - 12.6	Non-corrosive	-	Natural/industrially-influenced balance of hydrogen/carbon/oxygen in water
Aluminum (µg/l) ⁽ⁱ⁾		ND	ND	110	ND - 71	200	600 ^(a)	Erosion of natural deposits, surface water treatment process residue
Chloride (mg/l)		50	32 - 61	55	34 - 91	500	-	Runoff/leaching from natural deposits, seawater influence
Color (color units)		1.1	ND - 5.0	1.5	1.0 - 2.0	15	-	Naturally-occurring organic materials
Iron (ug/l)		94	ND - 140	ND	ND	300	-	Leaching from natural deposits; industrial wastes
Manganese (µg/l)		15.3	9.9 - 18.0	ND	ND	50	-	Leaching from natural deposits
Specific Conductance (uS/cm)		703	590 - 760	537	357 - 859	1,600	-	Substances that form ions when in water, seawater influence
Odor (threshold odor number)		ND	ND	2.0	2.0	3	-	Naturally-occurring organic materials.
Sulfate (mg/l)		97	66 - 110	92	51 - 175	500	-	Runoff/leaching from natural deposits, industrial wastes
Total Dissolved Solids (mg/l)		428	360 - 460	395	210 - 642	1,000	-	Runoff/leaching from natural deposits
Turbidity (NTU)		0.38	ND - 0.55	ND	ND	5	-	Soil runoff

SECONDARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - FOR AESTHETIC PURPOSES

SECONDARY STANDARDS	Sampled 2023 ^(b)	DISTRIBUTION SYSTEM		SECONDARY MCL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE			
Color (color units)		3.0	<0.3 - 5.0	15	-	Naturally-occurring organic materials
Odor (threshold odor number)		1.1	1.0 - 2.0	3	-	Naturally-occurring organic materials
Turbidity (NTU)		0.4	ND - 1.3	TT	-	Soil runoff

ADDITIONAL CHEMICALS OF INTEREST

ADDITIONAL CHEMICALS OF INTEREST	Sampled from 2021 to 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		NOTIFICATION LEVEL	PHG or (MCLG)	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Alkalinity (mg/l)		194	180 - 210	78	65 - 102	NA	-	Runoff or Leaching from Natural Deposits
Boron (mg/l)		NA	NA	135	130 - 140	1	-	Runoff or Leaching from Natural Deposits
Calcium (mg/l)		77	63 - 85	31	20 - 52	-	-	Runoff or Leaching from Natural Deposits
1,4-Dioxane (ug/l) ^(m)		1.4	0.64 - 2.4	NA	NA	1	-	Found in some cosmetics, detergents, and shampoos
Chlorate (ug/l)		NA	NA	19	19	800	-	Byproduct of Drinking Water Chlorination
Lithium (ug/l)		NA	NA	7.5	ND - 30	-	-	Various natural and manmade sources
Magnesium (mg/l)		15.3	9.9 - 18	12.5	7.8 - 21.0	-	-	Runoff or Leaching from Natural Deposits
N-Nitrosodimethylamine (ng/l)		NA	NA	2.2	ND - 5.3	10	-	Manufacturing of rocket fuel, rubber products, and other industrial process
pH (standard unit)		7.7	7.6 - 7.9	8.6	8.5 - 8.6	-	-	Acidity, Hydrogen Ions
Potassium (mg/l)		3.2	2.6 - 3.7	3.1	2.6 - 4.3	-	-	Runoff or Leaching from Natural Deposits
Sodium (mg/l)		43	40 - 45	58	39 - 91	-	-	Runoff or Leaching from Natural Deposits
Total Hardness (mg/l)		256	200 - 280	131	81 - 220	-	-	Runoff or Leaching from Natural Deposits
Total Organic Carbon (mg/l)		NA	NA	2.4	1.8 - 3.0	-	-	Various natural and manmade sources
Vanadium (ug/l)		NA	NA	3.3	3.1 - 3.4	50	-	Runoff or Leaching from Natural Deposits

PER- AND POLYFLUOROALKYL SUBSTANCES (PFAS) MONITORING

PFAS MONITORING	Sampled 2023 ^(b)	GROUNDWATER		MWD'S SURFACE WATER		NL	MRL	MAJOR SOURCES IN DRINKING WATER
		AVERAGE	RANGE	AVERAGE	RANGE			
Perfluorobutanesulfonic Acid (PFBS) (ng/l)		1.18	ND - 2.6	ND	ND	500	0.003	Notification of PFOA/PFOS: PFOA and PFOS are manmade fluorinated organic chemicals that are part of a larger group of chemicals referred to as per- and poly-fluoroalkyl substances (PFASs). These substances have been synthesized for water and lipid resistance and have been used extensively in consumer products such as carpets, clothing, fabrics for furniture, paper packaging for food, and other materials (e.g., cookware) designed to be waterproof, stain-resistant or non-stick. In addition, they have been used in fire-retarding foam and various industrial processes.
Perfluorohexane Sulfonic Acid (PFHxS) (ng/l)		2.68	ND - 5.9	ND	ND	3	0.003	
Perfluoroheptanoic Acid (PFHpA) (ng/l)		0.70	ND - 2.1	ND	ND	-	0.003	
Perfluorohexanoic Acid (PFHxA) (ng/l)		1.44	ND - 3.1	ND	ND	-	0.003	
Perfluorooctane Sulfonic Acid (PFOS) (ng/l)		13	ND - 25	ND	ND	6.5	0.004	
Perfluorooctanoic Acid (PFOA) (ng/L)		3.92	ND - 8.2	ND	ND	5.1	0.004	

United States Environmental Protection Agency (US EPA) & California State Water Resources Control Board, Division of Drinking Water (DDW) PFAS Monitoring Notes:

U.S. EPA has not established enforceable drinking water standards, also called *maximum contaminant levels* for these chemicals.

May 2016 - U.S. EPA issued a lifetime health advisory for PFOS and PFOA for drinking water, advising municipalities that they should notify their customers of the presence of levels over 70 parts per trillion (ppt) or nanograms per liter (ng/L) in community water supplies.

August 2019 - DDW revised the notification levels for PFOS to 6.5 ppt and PFOA to 5.1 ppt for PFOA. The single health advisory response level for the combined values of PFOS and PFOA remained at 70 ppt. Perfluorobutane sulfonic acid [PFBS] notification level remained the same at 500 ppt. PFHxS - Perfluorohexane Sulfonic Acid was added as part of the group of Perfluorochemicals (PFCs).

February 2020 - DDW issued updated drinking water response levels for PFOA of 10 ppt and PFOS of 40 ppt based on a running four-quarter average.

Exposure to PFOA and PFOS over certain levels may result in adverse health effects, including developmental effects to fetuses during pregnancy or to breastfed infants (e.g., low birth weight, accelerated puberty, skeletal variations), cancer (e.g., testicular, kidney), liver effects (e.g., tissue damage), immune effects (e.g., antibody production and immunity), thyroid effects and other effects (e.g., cholesterol changes).

PFHxS, PFOS and PFOA share similar chemical structure and uses (i.e., surface treatment agents for textiles, paper, and furniture etc. for its excellent waterproofing and oil-resistance performance). PFHxS have been detected in endangered species and the human blood of the general population and the response level for PFHxS is 20 ppt.

For additional information on PFOA, PFOS, and other PFAS, including possible health outcomes, you may visit these websites: <https://www.epa.gov/pfas>.

ABBREVIATIONS

mg/l or ppm = milligrams per liter or parts per million (equivalent to 1 drop in 42 gallons)

ND = constituent not detected at the testing limit

µg/l or ppb = micrograms per liter or parts per billion (equivalent to 1 drop in 42,000 gallons)

NA = constituent not analyzed

ng/l or ppt = nanograms per liter or parts per trillion (equivalent to 1 drop in 42,000,000 gallons)

pCi/l = picoCuries per liter (a measure of radiation)

NTU = nephelometric turbidity units

< = less than

SI = saturation index

µS/cm = microSiemens per centimeter

NL = Notification Level - Non-regulatory State advisory levels for contaminants that are established as precautionary measures

MRL = Minimum Reporting Level

DEFINITIONS:

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the US EPA

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Notification Level (NL): The level at which notification of the public water system governing body is required. A health-based advisory level for an unregulated contaminant.

Primary Drinking Water Standard (PDWS): MCLs and MRDLs and treatment techniques (TTs) for contaminants that affect health, along with their monitoring and reporting requirements.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Secondary Drinking Water Standards (SDWS): MCLs and MRDLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Variances and Exemptions: Department permission to exceed an MCL or not comply with a treatment technique under certain conditions.

FOOTNOTES:

(a) California Public Health Goal (PHG). Other advisory levels listed in this column are federal Maximum Contaminant Level Goals (MCLGs).

(b) Indicates dates sampled from groundwater sources only.

(c) While your drinking water meets the current standard for arsenic, it does contain low levels of arsenic. The standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. The State Water Resources Control Board continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

(d) Gross Alpha standard also includes the Radium-226 standard.

(e) MCL compliance based on 4 consecutive quarters of sampling.

(f) Running annual average used to calculate average, range, and MCL compliance.

(g) Maximum Residual Disinfectant Level (MRDL)

(h) Maximum Residual Disinfectant Level Goal (MRDLG)

(i) 90th percentile from the most recent sampling at selected customer taps.

(j) Aluminum has primary and secondary standards

(k) Starting June 1, 2015, the fluoride levels at the treatment plants were adjusted to achieve an optimal fluoride level of 0.7 ppm and a control range of 0.6 ppm to 1.2 ppm to comply with the existing State's Water Fluoridation Standards. Metropolitan was in compliance with all provisions of the State's Fluoridation System Requirements.


(l) Combined Radium 226 + Radium 228 has a Maximum Contaminant Level (MCL) of 5 pCi/L.

(m) The Notification Level of 1 µg/l for 1,4-Dioxane was exceeded in several wells in 2023. Some people who use water containing 1,4-dioxane in excess of the Notification Level over many years may experience liver or kidney problems and may have an increased risk of getting cancer, based on studies in laboratory animals.

CIUDAD DE LYNWOOD

INFORME DE CONFIANZA DE CONSUMIDOR de 2023

Desde 1991, las agencias proveedoras de recursos hidráulicos de California han emitido información sobre el agua que se provee al consumidor. Este informe, preparado en mayo de 2024, es una instantánea de la calidad del agua del grifo que proporcionamos el año pasado. Incluimos detalles sobre el origen del agua que toma, cómo se analiza, que contiene, y cómo se compara con los límites estatales y federales. Nos esforzamos por mantenerle informado sobre la calidad de su agua, y proveerle un abastecimiento confiable y económico que cumpla con todos los requisitos.

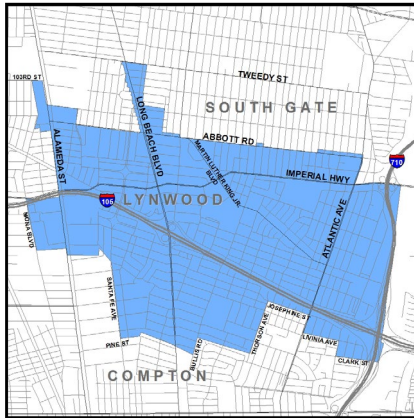

¿De Dónde Proviene el Agua que Tomo?

Su agua de la llave proviene de 2 fuentes: de las aguas naturales (subterránea) y de aguas superficiales (de los ríos). Bombeamos aguas naturales de profundos pozos locales. También usamos agua superficial de la

agencia Metropolitan Water District del Sur de California (MWD) importada del Río Colorado y del proyecto State Water Project del Norte de California. Estas dos fuentes de agua nos abastecen en las áreas de servicio que se muestran en el mapa adjunto. Este reporte informa sobre la calidad de nuestra agua subterránea y el abastecimiento del agua superficial de la

¿Cómo Se Analiza Mi Agua Potable?

El agua que toma se analiza regularmente para asegurarnos de que no halla niveles altos de sustancias químicas, de radioactividad o de bacteria en el sistema de distribución y en las tomas de servicios. Estos análisis se llevan a cabo semanal, mensual, trimestral, y anualmente o con más frecuencia, dependiendo de la sustancia analizada. Bajo las leyes estatales y federales, se nos permite analizar algunas sustancias menos frecuentemente que los periodos anuales porque los resultados no cambian.

¿Cuales Son Los Estándares del Agua Potable?

La Agencia federal de Protección al Medio Ambiente (USEPA) impone los límites de las cantidades de ciertos contaminantes en el agua potable. En California, la Junta de Control de Recursos Hídricos del Estado (State Water Board) regula la calidad del agua de beber siguiendo normas que sean al menos tan estrictas como las normas USEPA'S. Historicamente, los estándares de California han sido más estrictos que los federales.

Hay dos tipos de límites conocidos como estándares. Los estándares primarios lo protegen de sustancias que potencialmente podrían afectar su salud. Las normas establecen los Niveles Contaminantes Máximos (MCL, en inglés) que se permite del contaminante primario o secundario en el agua de beber. Los abastecedores de agua deben asegurarse de que la calidad de esta cumpla con los Niveles Contaminantes Máximos (o MCLs, en inglés). No todas las

sustancias tienen un Nivel Contaminante Máximo. El plomo y el cobre, por ejemplo, son regulados, por cierto nivel de acción. Si cualquier sustancia química sobrepasa el nivel de acción, se dará la necesidad de un proceso de tratamiento para rebajar los niveles en el agua de beber. Los abastecedores de agua deben cumplir con los Niveles Contaminantes Máximos para asegurar la calidad del agua.

Las Metas para la Salud Pública (MSP [o PHGs, en inglés]) son establecidas por la agencia estatal de California-EPA. Las PHGs proveen más información con respecto a la calidad del agua, y son similares a los reglamentos federales nombrados Metas para Los Niveles de Contaminante *Maximos* (MNCM [o MCLGs, en inglés]). Las PHGs y MCLGs son metas a nivel recomendable. Las PHG y MCLG son ambas definidas como los niveles de contaminantes en el agua potable por debajo de los niveles donde no se esperan riesgos a la salud y no enforzables. Ambos niveles PHG y MCLG son concentraciones de una sustancia en las que no hay riesgos a la salud aún conocidos.

¿Cómo Interpreto Mi Informe de Calidad del Agua?

Aunque analizamos más de 100 sustancias, las normas nos requieren que reportemos solo aquellas que se encuentran en el agua. La primera columna en la tabla de la calidad de agua muestra la lista de las sustancias detectadas en el agua. La siguiente columna muestra la lista de la concentración promedio y el rango de concentraciones que se hallan encontrado en el agua que usted toma. En seguida están las listas de el MCL, el PHG y el MCLG, si estos son apropiados. La última columna describe las probables fuentes u origen de las sustancias detectadas en el agua potable.

Para revisar la calidad de su agua de beber, compare los valores por encima del promedio, mínimos y máximos y el Nivel Contaminante Máximo. Revise todos los químicos que se encuentran por encima del Nivel Contaminante Máximo. Si los químicos sobrepasan el Nivel Contaminante Máximo no significa que sea detrimental a la salud de inmediato. Más bien, se requiere que se realicen análisis más frecuentemente en el abastecimiento del agua por un corto período. Si los resultados muestran sobrepasar el MCL, el agua debe ser tratada para remover esa sustancia, o el abastecimiento de esta debe decomisionarse.

¿Por Qué Hay Tanta Publicidad Sobre La Calidad Del Agua Potable?

Las fuentes del agua potable (de ambas agua de la llave y agua embotellada) incluye ríos, lagos, arroyos, lagunas, embalses, manantiales, y pozos. Al pasar el agua por la superficie de los suelos o por la tierra, se disuelven minerales que ocurren al natural, y en algunas ocasiones, material radioactivo, al igual que pueden levantar sustancias generadas por la presencia de animales o por actividades humanas.

Entre los contaminantes que pueden existir en las fuentes de agua se incluyen:

- Contaminantes microbiales como los virus y la bacteria, los que pueden venir de las plantas de tratamiento de aguas negras, de los sistemas sépticos, de las operaciones de ganadería, y de la vida salvaje;

- Contaminantes inorgánicos, como las sales y los metales, los cuales pueden ocurrir naturalmente o como resultado del desagüe pluvial, industrial, o de alcantarillado, producción de gas natural y petróleo, minas y agricultura.
- Pesticidas y herbicidas, los cuales pueden venir de varias fuentes tales como la agricultura, del desagüe pluvial, y de usos residenciales;
- Contaminantes de otras sustancias químicas orgánicas, incluyendo químicos orgánicos volátiles y sintéticos que son productos de procesos industriales y de la producción de petróleo, y que pueden provenir de las estaciones de gasolina, desagües pluviales urbanos, y agricultura aplicación y de sistemas sépticos;
- Contaminantes radioactivos, los cuales pueden ocurrir naturalmente o que pueden ser resultados de las actividades de la producción de gas natural y minería.

Con el fin de garantizar que el agua del grifo es segura para beber, la USEPA y la Junta de Control de Recursos Hídricos del Estado (Consejo de Estado) prescriben regulaciones que limitan la cantidad de ciertos contaminantes en el agua suministrada por los sistemas públicos de agua. El Reglamento del Consejo de Estado también establecen límites de contaminantes en el agua embotellada que debe proporcionar la misma protección para la salud pública.

Toda el agua potable, incluyendo el agua embotellada, puede contener cantidades pequeñas de ciertos contaminantes. La presencia de contaminantes no necesariamente indica que haya algún riesgo de salud. Para más información acerca de contaminantes y riesgos a la salud favor de llamar a la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791). Usted puede obtener más información sobre el agua potable al conectarse al Internet en los siguientes domicilios:

- <https://www.epa.gov/ground-water-and-drinking-water/safe-drinking-water-information>
(página federal de la USEPA)
- http://www.waterboards.ca.gov/drinking_water/certification/drinkingwater/Chemicalcontaminants.html
(sitio Web estatal)

Plomo: Si presente, los niveles elevados del plomo pueden causar el problema de salud serio, sobre todo para mujeres embarazadas y chiquitos. El plomo en el agua potable es principalmente de materiales y componentes asociados con líneas de servicios y a casa fontanería. La Ciudad de Lynwood es responsable de proporcionar el agua potable de alta calidad, pero no puede controlar la variedad de materiales usados en la fontanería de componentes. Cuando su echar agua ha estado sentándose durante varias horas, usted puede minimizar el potencial para la exposición de plomo limpiando con agua su grifo durante 30 segundos a 2 minutos antes de usar el echar agua para beber o cocinarse. Si usted está preocupado por el plomo en su echar agua, usted puede desear hacer probar su echar agua. La información en el plomo en el agua potable, probando métodos, y pasos que usted puede tomar para minimizar la exposición está disponible de la Línea directa de Agua Potable Segura o en <http://www.epa.gov/lead>.

¿Debería Tomar Otras Precauciones?

Algunas personas pueden ser más vulnerables a los contaminantes en el agua potable que el público en general. Las personas que tienen problemas inmunológicos, o sea esas

personas que estén en tratamiento por medio de quimioterapia cancerosa; personas que tienen órganos transplantados, o personas con SIDA o desordenes inmunológicos, personas de edad avanzada, y los bebés que son particularmente susceptibles a ciertas infecciones. Estas personas deben de consultar a sus proveedores de salud médica. Las guías de la USEPA/Centros de Control de Enfermedades aconsejan cómo disminuir los riesgos para prevenir la infección de Cryptosporidium y otros contaminantes microbiales están disponibles por teléfono de la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791).

Valoración de su Abastecimiento de Agua

El distrito Metropolitano de agua del Sur de California completo una valoración de su abastecimiento del Río Colorado y del Proyecto de Agua del Estado en el 2002. El abastecimiento del Río Colorado es considerado más vulnerable a la recreación, al agua que corre de la ciudad después de una tormenta, a la creciente urbanización en la cuenca, y aguas residuales. El Proyecto de abastecimiento de agua del Estado es considerado más vulnerable al agua que corre de la ciudad después de una tormenta, a la fauna, la agricultura, la recreación, y aguas residuales. Teléfono el distrito Metropolitano de agua del Sur de California para un copie de una valoración al (213) 217-6850.

La ciudad de Lynwood había completado su evaluación de agua de la fuente en el año 2003. Se puede obtener una copia de la evaluación aprobada enviando una solicitud por escrito a George Cambero, Gerente de Servicios Públicos, División de Agua en 11330 Bullis Road, Lynwood CA 90262 o envíe un correo electrónico a gcambero@lynwoodca.gov.

¿Cómo Puedo Participar en las Decisiones Sobre Asuntos Acerca del Agua Que Me Puedan Afectar ?

El público puede asistir a las juntas del Consejo Municipal el primer y el tercer martes de cada mes a las 6 p.m. al ayuntamiento.

¿Cómo Me Pongo En Contacto Con Mi Agencia del Agua Si Tengo Preguntas Sobre La Calidad Del Agua?

Si usted tiene preguntas específicas sobre la calidad del agua potable, por favor llame a George Cambero (310) 603-0220.

Algunas Puntas de Conservación de Echar agua Provechosas

- Arreglar los grifos que gotean en su hogar - excepto hasta 20 galones cada día por cada detenido de fugas
- Guardar entre 15 y 50 galones por cada vez que el lavado sólo cargas completas de ropa
- Ajuste sus regaderas de modo que el agua caiga en su césped / jardín, no la acera / calzada - excepto 500 galones por mes
- Utilice pajote orgánico alrededor de las plantas para reducir la evaporación - guardar cientos de galones por año
- Visite <http://www.epa.gov/watersense> para obtener más información.

Visitanos en www.lynwoodca.gov

CITY OF LYNWOOD
11330 BULLIS ROAD
LYNWOOD, CA 90262

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien. Para obtener una copia en Español, llame a (310) 603-0220 x 804

