

APPENDIX G: Certification Form (Suggested Format)


Consumer Confidence Report Certification Form

(to be submitted with a copy of the CCR)

(To certify electronic delivery of the CCR, use the certification form on the State Water Board's website at
http://www.swrcb.ca.gov/drinking_water/certlic/drinkingwater/CCR.shtml)

Water System Name:	Maywood Mutual Water Company No. 3
Water System Number:	CA1910086

The water system named above hereby certifies that its Consumer Confidence Report was distributed on June 11, 2021 (date) to customers (and appropriate notices of availability have been given). Further, the system certifies that the information contained in the report is correct and consistent with the compliance monitoring data previously submitted to the State Water Resources Control Board, Division of Drinking Water.

Certified by:	Name:	Robert C. Rohlf	
	Signature:		
	Title:	Director of Operations	
	Phone Number:	(323) 560-3657	Date: 6/11/2021

To summarize report delivery used and good-faith efforts taken, please complete the below by checking all items that apply and fill-in where appropriate:

- ☒ CCR was distributed by mail or other direct delivery methods. Specify other direct delivery methods used: 2020 Water Quality Report Distribution Notice Availability,
Mailed to each Customer with, their July 1st Billing on June 29th 2021
- ☐ "Good faith" efforts were used to reach non-bill paying consumers. Those efforts included the following methods:
- ☒ Posting the CCR on the Internet at www.Maywoodmutualwatercompanyno3
 - ☐ Mailing the CCR to postal patrons within the service area (attach zip codes used)
 - ☐ Advertising the availability of the CCR in news media (attach copy of press release)
 - ☐ Publication of the CCR in a local newspaper of general circulation (attach a copy of the published notice, including name of newspaper and date published)
 - ☐ Posted the CCR in public places (attach a list of locations)
 - ☐ Delivery of multiple copies of CCR to single-billed addresses serving several persons, such as apartments, businesses, and schools

- ☐ Delivery to community organizations (attach a list of organizations)
- ☐ Other (attach a list of other methods used)
- ☐ *For systems serving at least 100,000 persons:* Posted CCR on a publicly-accessible internet site at the following address: www._____
- ☐ *For investor-owned utilities:* Delivered the CCR to the California Public Utilities Commission

This form is provided as a convenience for use to meet the certification requirement of the California Code of Regulations, section 64483(c).

MAYWOOD MUTUAL WATER COMPANY NUMBER 3 DBA, TRI-CITY MUTUAL WATER COMPANY 2020 CONSUMER CONFIDENCE REPORT

Since 1991, California water utilities have been providing information on water served to its consumers. This report is a snapshot of the tap water quality that we provided last year. Included are details about where your water comes from, what it contains, and how it compares to State standards. We strive to keep you informed about the quality of your water, and to provide a reliable and economic supply that meets all regulatory requirements.

Where Does My Tap Water Come From?

Your tap water comes from local, deep groundwater wells located in our service area. These wells supply our service area shown on the adjacent map. The quality of groundwater delivered to your home is presented in this report.



Public Health Goals (PHGs) are set by the California Environmental Protection Agency. PHGs provide more information on the quality of drinking water to customers, and are similar to their federal counterparts, Maximum Contaminant Level Goals (MCLGs). PHGs and MCLGs are advisory levels that are non-enforceable. Both PHGs and MCLGs are concentrations of a substance below which there are no known or expected health risks.

How Do I Read the Water Quality Table?

Although we test for over 100 substances, regulations require us to report only those found in your water. The first column of the water quality table lists substances detected in your water. The next columns list the average concentration and range of concentrations found in your drinking water. Following are columns that list the MCL and PHG or MCLG, if appropriate. The last column describes the likely sources of these substances in drinking water.

To review the quality of your drinking water, compare the highest concentration and the MCL. Check for substances greater than the MCL. Exceedance of a primary MCL does not usually constitute an immediate health threat. Rather, it requires testing the source water more frequently for a short duration. If test results show that the water continues to exceed the MCL, the water must be treated to remove the substance, or the source must be removed from service.

How is My Drinking Water Tested?

Your drinking water is tested regularly for unsafe levels of chemicals, radioactivity and bacteria at the source and in the distribution system. We test weekly, monthly, quarterly, annually or less often depending on the substance. State and Federal laws allow us to test some substances less than once per year because their levels do not change frequently. All water quality tests are conducted by specially trained technicians in state-certified laboratories.

What Are Drinking Water Standards?

The U.S Environmental Protection Agency (USEPA) limits the amount of certain substances allowed in tap water. In California, the State Water Resources Control Board (State Water Board) regulates tap water quality by enforcing limits that are at least as stringent as the USEPA's. Historically, California limits are more stringent than the Federal ones.

There are two types of these limits, known as standards. Primary standards protect you from substances that could potentially affect your health. Secondary standards regulate substances that affect the aesthetic qualities of water. Regulations set a Maximum Contaminant Level (MCL) for each of the primary and secondary standards. The MCL is the highest level of a substance that is allowed in your drinking water.

Why Do I See So Much Coverage in the News About the Quality Of Tap Water?

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, including viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife;
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming;
- Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses;
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems;

- Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the United States Environmental Protection Agency (USEPA) and the State Water Resources Control Board (State Water Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Water Board regulations also establish limits for contaminants in bottled water that must provide the same protection for public health.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1-800-426-4791). You can also get more information on tap water by logging on to these helpful web sites:

- <http://www.epa.gov/dwstandardsregulations/2018-drinking-water-standards-and-advisory-tables> (USEPA's web site)
- http://www.waterboards.ca.gov/drinking_water/certification/drinkingwater/NotificationLevels.shtml (State Water Board web site)

If present, elevated levels of lead can cause serious health problem, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Maywood Mutual Water Company No. 3 is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/lead>.

Should I Take Additional Precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The USEPA/Centers for Disease Control guidelines on appropriate means to lessen the risk of infection of *Cryptosporidium* and other microbial contaminants are available from the USEPA's Safe Drinking Water Hotline (1-800-426-4791).

Source Water Assessment

Maywood Mutual Water Company No. 3 conducted an assessment of its groundwater supplies in 2001.

Groundwater supplies are considered most vulnerable to chemical/petroleum processing/storage, chemical/petroleum pipelines, metal plating/finishing/fabricating, plastics/synthetics producers, parks, known contaminant plumes, confirmed leaking underground storage tanks, automobile body shops, automobile repair shops, electrical/electronic manufacturing, machine shops, photo processing/printing, furniture repair/manufacturing, home manufacturing, hardware/lumber/parts stores, parking lots/malls with more than 50 spaces, freeways/state highways, railroads, roads/streets, monitoring wells/test holes, automobile gas stations, high density housing (> 1 house/0.5 acre), medical/dental offices/clinics, apartments and condominiums, wood preserving/treating, and wood/pulp/paper processing and mills. A copy of the approved assessment may be obtained by contacting Mr. Robert Rohlf at (323) 560-3657.

How Can I Participate in Decisions On Water Issues That Affect Me?

Shareholders are welcome to attend the Board meetings held the last Tuesday of each month, except November and December, at 4:30 pm at 6151 Heliotrope Ave. Maywood, CA 90270.

How Do I Contact My Water Agency If I Have Any Questions About Water Quality?

If you have specific questions about your tap water quality, please contact Mr. Robert Rohlf at (323) 560-3657.

Some Helpful Water Conservation Tips

- Fix leaky faucets in your home – save up to 20 gallons every day for every leak stopped
- Save between 15 and 50 gallons each time by only washing full loads of laundry
- Adjust your sprinklers so that water lands on your lawn/garden, not the sidewalk/driveway – save 500 gallons per month
- Use organic mulch around plants to reduce evaporation – save hundreds of gallons a year
- Use a water-efficient showerhead. They're inexpensive, easy to install, and can save you up to 750 gallons a month.
- Visit <http://www.epa.gov/watersense> for more information.

www.maywoodmutualwatercompanyno3.com

MAYWOOD MUTUAL WATER COMPANY NUMBER 3

DBA, TRI-CITY MUTUAL WATER COMPANY

2020 CONSUMER CONFIDENCE REPORT

Results are from the most recent testing performed in accordance with state and federal drinking water regulations. The State allows the Water Company to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of the data, though representative, are more than one year old.

PRIMARY STANDARDS MONITORED AT THE SOURCE-MANDATED FOR PUBLIC HEALTH						
ORGANIC CHEMICALS (µg/l) Sampled in 2020	GROUNDWATER		PRIMARY MCL	MCLG or PHG	MAJOR SOURCES IN DRINKING WATER	
	AVERAGE	RANGE				
Trichloroethylene (TCE) (c)	1.8	ND - 5.0	5	1.7 (a)	Discharge from metal degreasing sites and other factories. Some people who use water containing trichloroethylene in excess of the MCL over many years may experience liver problems and may have an increased risk of getting cancer.	
INORGANICS Sampled in 2018 - 2020 (b)						
Aluminum (mg/L)	ND	ND	1	0.6	Erosion of natural deposits; residue from some surface water treatment processes.	
Barium (mg/L)	0.04	ND - 0.12	1	2	Discharge of oil drilling wastes and from metal refineries; erosion of natural deposits.	
Fluoride (mg/l)	0.27	0.2 - 0.3	2.0	1 (a)	Erosion of natural deposits, water additive that promotes strong teeth	
Nitrate (mg/l as N)	1.6	ND - 2.8	10	10 (a)	Runoff and leaching from fertilizer use/septic tanks/sewage, natural erosion	
Perchlorate (ug/l)	ND	ND	6	6	Perchlorate is an inorganic chemical used in solid rocket propellant, fireworks, explosives, flares, matches, and a variety of industries. It usually gets into drinking water as a result of environmental contamination from historic aerospace or other industrial operations that used or use, store, or dispose of perchlorate and its salts.	
RADIOLOGICAL - (pCi/l) (results are from 2020) (b)						
Gross Alpha	1.8	ND - 3.5	15	0	Erosion of natural deposits	
Radium 226	ND	ND	5 (d)	0.05	Erosion of natural deposits	
Radium 228	ND	ND		0.019	Erosion of natural deposits	
Uranium	1.2	ND - 2.4	20	0.5	Erosion of natural deposits	

PRIMARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM - MANDATED FOR PUBLIC HEALTH					
MICROBIALS	DISTRIBUTION SYSTEM		PRIMARY	MCLG	Naturally present in the environment Human and animal fecal waste
	AVERAGE # POSITIVE	RANGE OF # POSITIVE	MCL	or PHG	
	0	0	< 1 positive	0	
	0	0	0	0	
	0	0	-	-	
Turbidity (NTU)	DISTRIBUTION SYSTEM		PRIMARY	MCLG	Soil runoff
	AVERAGE	RANGE	MCL	or PHG	
	0.5	0.1 - 4.1	TT	-	
DISINFECTION BY-PRODUCTS AND DISINFECTION RESIDUALS (e)	DISTRIBUTION SYSTEM		PRIMARY	MCLG	By-product of drinking water disinfection. By-product of drinking water disinfection Drinking water disinfectant added for treatment
	AVERAGE	RANGE	MCL	or PHG	
	20.8	2.3 - 47.3	80	-	
	3.4	0.0 - 8.9	60	-	
	0.8	0.3 - 1.1	4.0 (f)	4.0 (g)	
AT THE TAP PHYSICAL CONSTITUENTS 20 sites sampled in 2020	DISTRIBUTION SYSTEM		ACTION LEVEL	MCLG	Internal corrosion of household plumbing, erosion of natural deposits; leaching from wood preservatives Internal corrosion of household plumbing systems; industrial manufacturer discharges; erosion of natural deposits
	90th PERCENTILE	NUMBER OF SITES ABOVE THE AL	AL	or PHG	
	0.070 (h)	0	1.3 AL	0.3 (a)	
	ND (h)	0	15 AL	0.2 (a)	

SECONDARY STANDARDS MONITORED AT THE SOURCE-FOR AESTHETIC PURPOSES				
Sampled in 2018-2020 (b)	GROUNDWATER		SECONDARY	MCLG
	AVERAGE	RANGE	MCL	or PHG
Aggressiveness Index (corrosivity)	12.3	12.2 - 12.4	Non-corrosive	-
Chloride (mg/l)	61.7	52.0 - 72.0	500	-
Color (color units)	ND	ND	15	-
Specific Conductance (uS/cm)	716.7	620 - 810	1,600	-
Manganese (µg/l)	24.2	ND - 38	50	-
Odor (threshold odor number)	0.3	1	3	-
Sulfate (mg/l)	97.3	62 - 120	500	-
Total Dissolved Solids (mg/l)	430	360 - 510	1,000	-
Turbidity (NTU)	ND	ND	5	-

SECONDARY STANDARDS MONITORED IN THE DISTRIBUTION SYSTEM-FOR AESTHETIC PURPOSES				
GENERAL	DISTRIBUTION SYSTEM		SECONDARY	MCLG
	AVERAGE	RANGE	MCL	or PHG
PHYSICAL CONSTITUENTS				
Color (color units)	<4	<3 - 30	15	-
Odor (threshold odor number)	1	1.0 - 2.0	3	-

ADDITIONAL CHEMICALS OF INTEREST		
Sampled in 2018-2020 (b)	GROUNDWATER	
	AVERAGE	RANGE
Alkalinity (mg/l)	180	170 - 190
Calcium (mg/l)	67.7	50 - 77
1,4-Dioxane (ug/l) (i)	4	2.6 - 6.0
Magnesium (mg/l)	16.3	12 - 21
pH (standard unit)	7.9	7.7 - 8.0
Potassium (mg/l)	3.4	3.3 - 3.5
Sodium (mg/l)	56.7	49.0 - 63.0
Total Hardness (mg/l)	236.7	170.0 - 280.0

FOOTNOTES
(a) California Public Health Goal (PHG). Other advisory levels listed in this column are federal Maximum Contaminant Level Goals (MCLGs). (b) Indicates dates sampled for groundwater sources only. (c) While one well had one detection at the MCL in 2020, the sampling average for the wells remains below the MCL with no violation and this well system continues to monitor samples on a quarterly basis to ensure compliance. The MCL for trichloroethylene is 5 ug/l. (d) Combined Radium 226 + Radium 228 has a Maximum Contaminant Level (MCL) of 5 pCi/L. (e) Running annual average used to calculate average, range, and MCL compliance. (f) Maximum Residual Disinfectant Level (MRDL) (g) Maximum Residual Disinfectant Level Goal (MRDLG) (h) 90th percentile from the most recent sampling at selected customer taps. *****In January 2020, a Monitoring Violation was issue to the water system because it failed to collect any samples during the months of June through September in 2019. The violation and corrective action is described the notice included in this report.***** (i) The Notification Level of 1 ug/l for 1,4-Dioxane was exceeded in two out of three wells in 2020. Some people who use water containing 1,4-dioxane in excess of the Notification Level over many years may experience liver or kidney problems and may have an increased risk of getting cancer, based on studies in laboratory animals.

ABBREVIATIONS
NTU = nephelometric turbidity units mg/l = milligrams per liter or (ppm) parts per million (equivalent to 1 drop in 42 gallons) ND = constituent not detected at the reporting limit SI = saturation index pCi/l = picoCuries per liter (a measure of radiation) NA = constituent not analyzed ng/l = nanograms per liter or (ppt) parts per trillion (equivalent to 1 drop in 42,000,000 gallons) µg/l = micrograms per liter or (ppb) parts per billion (equivalent to 1 drop in 42,000 gallons) uS/cm = microSiemens per centimeter

DEFINITIONS
Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water. Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants. Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants. Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency. Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water. Regulatory Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow. Primary Drinking Water Standards (PDWS): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements. Secondary Water Standards (SDWS): MCLs and MRDLs for contaminants that affect the aesthetic qualities such as taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels. Variances and Exemptions: State Board permission to exceed an MCL or not comply with a treatment technique under certain conditions.

LA COMPAÑÍA DE AGUA DE MAYWOOD MUTUAL NÚMERO 3


DBA, TRI-CITY MUTUA COMPAÑÍA DEL AGUA

INFORME DE CONFIANZA DE CONSUMIDOR de 2020

Desde 1991, las agencias proveedoras de recursos hidráulicos de California han emitido información sobre el agua que se provee al consumidor. Este informe es una copia del informe sobre la calidad del agua potable que le proveímos el año pasado. Incluimos detalles sobre el origen del agua que toma, cómo se analiza, que contiene, y cómo se compara con los límites estatales y federales. Nos esforzamos por mantenerle informado sobre la calidad de su agua, y proveerle un abastecimiento confiable y económico que cumpla con todos los requisitos.

¿De Dónde Proviene el Agua que Tomo?

Su agua del grifo viene de pozos de agua subterránea locales, profundos localizados en nuestra área de servicio. Estos pozos suministran nuestra área de servicio mostrada en el mapa adjacente. La calidad de agua subterránea entregada a su casa es presentada en este informe.

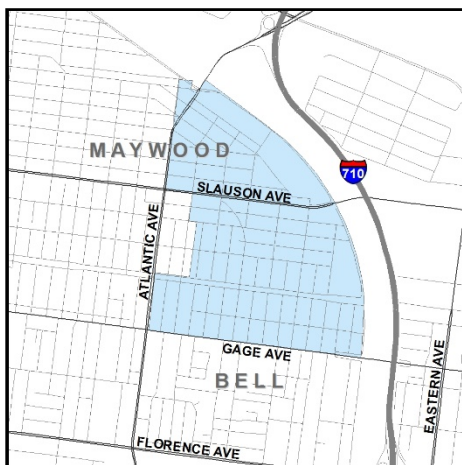

¿Cómo Se Analiza Mi Agua Potable?

El agua que toma se analiza regularmente para asegurarnos de que no halla niveles altos de sustancias químicas, de radioactividad o de bacteria en el sistema de distribución y en las tomas de servicios. Estos análisis se llevan a cabo semanal, mensual, trimestral, y anualmente o con más frecuencia, dependiendo de la sustancia analizada. Bajo las leyes estatales y federales, se nos permite analizar algunas sustancias menos frecuentemente que los periodos anuales porque los resultados no cambian.

¿Cuales Son Los Estándares del Agua Potable?

La Agencia federal de Protección al Medio Ambiente (USEPA) impone los límites de las cantidades de ciertos contaminantes en el agua potable. En California, el Tablero de Control de Recursos de Echar agua Estatal (Bordo Estatal) regula la calidad de agua del grifo haciendo cumplir límites que son al menos tan rigurosos como el USEPA'S. Historicamente, los estandares de California han sido más estrictos que los federales.

Hay dos tipos de límites conocidos como estándares. Los estándares primarios lo protegen de sustancias que potencialmente podrían afectar su salud. Las normas establecen los Niveles Contaminantes Máximos (MCL, en inglés) que se permite del contaminante primario o secundario en el agua de beber. Los abastecedores de agua deben asegurarse de que la calidad de esta cumpla con los Niveles Contaminantes Máximos (o MCLs, en inglés). No todas las sustancias tienen un Nivel Contaminante Máximo. El plomo y el cobre, por ejemplo, son regulados, por cierto nivel de acción. Si cualquier sustancia química sobrepasa el nivel de

acción, se dará la necesidad de un proceso de tratamiento para rebajar los niveles en el agua de beber. Los abastecedores de agua deben cumplir con los Niveles Contaminantes Máximos para asegurar la calidad del agua.

Las Metas para la Salud Pública (MSP [o PHGs, en inglés]) son establecidas por la agencia estatal de California-EPA. Las PHGs proveen más información con respecto a la calidad del agua, y son similares a los reglamentos federales nombrados Metas para Los Niveles de Contaminante *Maximos* (MNCM [o MCLGs, en inglés]). Las PHGs y MCLGs son metas a nivel recomendable. Las PHG y MCLG son ambas definidas como los niveles de contaminantes en el agua potable por debajo de los niveles donde no se esperan riesgos a la salud y no enforzables. Ambos niveles PHG y MCLG son concentraciones de una sustancia en las que no hay riesgos a la salud aún conocidos.

¿Cómo Interpreto Mi Informe de Calidad del Agua?

Aunque analizamos más de 100 sustancias, las normas nos requieren que reportemos solo aquellas que se encuentran en el agua. La primer columna en la tabla de la calidad de agua muestra la lista de las sustancias detectadas en el agua. La siguiente columna muestra la lista de la concentracion promedio y el rango de concentraciones que se hallan encontrado en el agua que usted toma. En seguida están las listas de el MCL, el PHG y el MCLG, si estos son apropiados. La última columna describe las probables fuentes u origen de las sustancias detectadas en el agua potable.

Para revisar la calidad de su agua de beber, compare los valores por encima del promedio, mínimos y máximos y el Nivel Contaminante Máximo. Revise todos los químicos que se encuentran por encima del Nivel Contaminante Máximo. Si los químicos sobrepasan el Nivel Contaminante Máximo no significa que sea detrimental a la salud de inmediato. Más bien, se requiere que se realicen análisis más frecuentemente en el abastecimiento del agua por un corto período. Si los resultados muestran sobrepasar el MCL, el agua debe ser tratada para remover esa sustancia, o el abastecimiento de esta debe decomisionarse.

¿Por Qué Hay Tanta Publicidad Sobre La Calidad Del Agua Potable?

Las fuentes del agua potable (de ambas agua de la llave y agua embotellada) incluye ríos, lagos, arroyos, lagunas, embalses, manantiales, y pozos. Al pasar el agua por la superficie de los suelos o por la tierra, se disuelven minerales que ocurren al natural, y en algunas ocasiones, material radioactivo, al igual que pueden levantar sustancias generadas por la presencia de animales o por actividades humanas.

Entre los contaminantes que pueden existir en las fuentes de agua se incluyen:

- Contaminantes microbiales como los virus y la bacteria, los que pueden venir de las plantas de tratamiento de aguas negras, de los sistemas sépticos, de las operaciones de ganadería, y de la vida salvaje;
- Contaminantes inorgánicos, como las sales y los metales, los cuales pueden ocurrir naturalmente o como resultado del desagüe pluvial, industrial, o de alcantarillado, producción de gas natural y petróleo, minas y agricultura.

- Pesticidas y herbicidas, los cuales pueden venir de varias fuentes tales como la agricultura, del desagüe pluvial, y de usos residenciales;
- Contaminantes de otras sustancias químicas orgánicas, incluyendo químicos orgánicos volátiles y sintéticos que son productos de procesos industriales y de la producción de petróleo, y que pueden provenir de las estaciones de gasolina, desagües pluviales urbanos, y agricultura aplicación y de sistemas sépticos;
- Contaminantes radioactivos, los cuales pueden ocurrir naturalmente o que pueden ser resultados de las actividades de la producción de gas natural y minería.

A fin de asegurar que el agua del grifo es segura para beber, el USEPA y el Tablero de Control de Recursos de Echar agua Estatal (Bordo Estatal) prescriben el reglamento o reglamentación que limita la cantidad de ciertos contaminantes en el echar agua proporcionado por sistemas de echar agua públicos. El reglamento o reglamentación de Bordo Estatal también establece límites para contaminantes en el echar agua embotellado que debe proporcionar la misma protección para la salud pública.

Toda el agua potable, incluyendo el agua embotellada, puede contener cantidades pequeñas de ciertos contaminantes. La presencia de contaminantes no necesariamente indica que haya algún riesgo de salud. Para más información acerca de contaminantes y riesgos a la salud favor de llamar a la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791). Usted puede obtener más información sobre el agua potable al conectarse al Internet en los siguientes domicilios:

- <http://water.epa.gov/dwstandardsregulations/2018-drinking-water-standards-and-advisory-tables> (el sitio Web del USEPA)
- http://www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/NotificationLevels.shtml (sitio Web de Bordo Estatal)

Si presente, los niveles elevados del plomo pueden causar el problema de salud serio, sobre todo para mujeres embarazadas y chiquitos. El plomo en el agua potable es principalmente de materiales y componentes asociados con líneas de servicios y a casa fontanería. Maywood Compañía de Echar agua Mutua el No 3 es responsable de proporcionar el agua potable de alta calidad, pero no puede controlar la variedad de materiales usados en la fontanería de componentes. Cuando su echar agua ha estado sentándose durante varias horas, usted puede minimizar el potencial para la exposición de plomo limpiando con agua su grifo durante 30 segundos a 2 minutos antes de usar el echar agua para beber o cocinarse. Si usted está preocupado por el plomo en su echar agua, usted puede desear hacer probar su echar agua. La información en el plomo en el agua potable, probando métodos, y pasos que usted puede tomar para minimizar la exposición está disponible de la Línea directa de Agua Potable Segura o en <http://www.epa.gov/lead>.

¿Debería Tomar Otras Precauciones?

Algunas personas pueden ser más vulnerables a los contaminantes en el agua potable que el público en general. Las personas que tienen problemas inmunológicos, o sea esas personas que estén en tratamiento por medio de quimioterapia cancerosa; personas que tienen órganos transplantados, o personas con SIDA o desordenes inmunológicos, personas de edad avanzada, y los bebés que son particularmente

susceptibles a ciertas infecciones. Estas personas deben de consultar a sus proveedores de salud médica. Las guías de la USEPA/Centros de Control de Enfermedades aconsejan cómo disminuir los riesgos para prevenir la infección de *Cryptosporidium* y otros contaminantes microbiales están disponibles por teléfono de la USEPA encargada de proteger el agua potable al teléfono (1-800-426-4791).

Valoración de su Abastecimiento de Agua

La compañía de agua de Maywood Mutual Número 3 condujo una valoración de su abastecimiento de aguas subterráneas en el 2001. El abastecimiento de aguas subterráneas es considerado mas vulnerable a químicos, procesos petroleros, y almacenaje; a líneas de petróleo; al chapado, acabado, y fabricación de metal; a plásticos y procesos sintéticos; a parques; al plomo; al escape de tanques bajo tierra; a talleres de carrocería; a talleres automotrices; a la manufactura electrónica y eléctrica; a talleres de maquinas; al proceso e imprenta de fotografías; a la manufactura y reparación de muebles; a la manufactura de casas; a tiendas de ferretería, partes, y madera; estacionamientos y centros comerciales con mas de 50 espacios para estacionamiento; autopistas y carreteras del estado; a ferrocarriles; a carreteras y calles; pozos y hoyos de supervisión; estaciones gasolineras; a viviendas de alta densidad (>1casa/0.5acre); a oficinas y clínicas medicas y dentales; a apartamentos y condominios; preservación de madera y tratamiento, y madera/pulpa/y procesamiento de papel y molinos. Una copia de la valoración aprobada puede ser obtenida llamando a Robert Rohlf al (323) 560-3657.

¿Cómo Puedo Participar en las Decisiones Sobre Asuntos Acerca del Agua Que Me Puedan Afectar ?

Los accionistas son bienvenidos asisten a las Reuniones de la junta directiva sostenidas el martes pasado de cada mes, excepto noviembre y diciembre, a las 16h30 en 6151 Avenida de Heliotropo Maywood, CA 90270.

¿Cómo Me Pongo En Contacto Con Mi Agencia del Agua Si Tengo Preguntas Sobre La Calidad Del Agua?

Si usted tiene preguntas específicas sobre la calidad del agua potable, por favor llame a Robert Rohlf al (323) 560-3657.

¿Cómo Puedo Conservar Agua en Casa?

Los · Fijan grifos agujereados en su casa – salvan hasta 20 galones cada día de cada agujero parado

Los · Ahorran entre 15 y 50 galones cada vez por sólo lavando cargas máximas del lavado de ropa

Los · Ajustan sus aspersores de modo que tierras de echar agua en su césped/jardín, no la acera/calzada – salven 500 galones por mes

Los · Usan el pajote orgánico alrededor de plantas para reducir la evaporación – salvan cientos de galones un año

Los · Usan showerhead eficiente de agua. Ellos son baratos, fáciles para instalar, y pueden salvarle hasta 750 galones por mes.

Los - Visite <http://www.epa.gov/watersense> para obtener más información.

<http://www.maywoodmutualwatercompanyno3.com>

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Este informe contiene información muy importante sobre su agua potable.
Tradúzcalo o hable con alguien que lo entienda bien.

Monitoring Requirements Not Met for Maywood Mutual Water Company No.3

Our water system failed to monitor as required for drinking water standards during the past year and, therefore, was in violation of the regulations. Even though this failure was not an emergency, as our customers, you have a right to know what you should do, what happened, and what we did to correct this situation. Nuestro sistema de agua no pudo monitorear según lo requerido para los estándares de agua potable durante el año pasado y, por lo tanto, violó las regulaciones. Aunque esta falla no fue una emergencia, como nuestros clientes, usted tiene derecho a saber qué debe hacer, qué sucedió y qué hicimos para corregir esta situación.

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During 2019 we did not test to comply with Lead and Copper rule and therefore, the 20 samples will be taken in 2020, between June and September. (Summer Months)

Estamos obligados a controlar su agua potable en busca de contaminantes específicos de forma regular. Los resultados del monitoreo regular son un indicador de si nuestra agua potable cumple o no con los estándares de salud. Durante 2019 no realizamos pruebas para cumplir con la regla de plomo y cobre y, por lo tanto, las 20 muestras se tomarán en 2020, entre junio y septiembre. (Meses de verano)

What should I do?

- There is nothing you need to do at this time. • No hay nada que deba hacer en este momento.
- The table below lists the contaminant(s) we did not properly test for during the last year, how many samples we are required to take and how often, how many samples we took, when samples should have been taken, and the date on which follow-up samples were (or will be) taken.

Contaminant	Required Sampling Frequency	Number of Samples Taken	When All Samples Should Have Been Taken	When Samples Were or Will Be Taken
Lead and Copper 2019	20 Samples every 3 years	None	June 2019-September 2019	June 2020-September 2020

What happened? What is being done?

Samples for the Lead and Copper Rule were not taken in 2019. Twenty samples are to be taken every Three years during period of June 1st to September 30th. During the hot summer months of the year. The 20 samples for the lead and copper rule will be taken between June and September 2020 to comply with the lead and copper rule.

Las muestras para la Regla de plomo y cobre no se tomaron en 2019. Se tomarán veinte muestras cada tres años durante el período del 1 de junio al 30 de septiembre. Durante los calurosos meses de verano del año. Las 20 muestras para la regla de plomo y cobre se tomarán entre junio y septiembre de 2020 para cumplir con la regla de plomo y cobre.

Samples in 1992,1993,1994,1995,1998,2001,2004,2007,2010,2013,2016 all met the requirement for the Lead and Copper Rule. We will collect the required samples in 2020 and report back the finding in our Water Quality Report for 2020.

For more information, please contact Robert Rohlf at Phone 323 560-3657 or by mail at 6151 Heliotrope Ave. Maywood, CA 90270
Para obtener más información, comuníquese con Robert Rohlf al teléfono 323 560-3657 o por correo a 6151 Heliotrope Ave. Maywood, CA 90270

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail. This

Secondary Notification Requirements / Requisitos de notificación secundaria

Upon receipt of notification from a person operating a public water system, the following notification must be given within 10 days [Health and Safety Code Section 116450(g)]:


Al recibir la notificación de una persona que opera un sistema público de agua, la siguiente notificación debe entregarse dentro de los 10 días [Código de Salud y Seguridad, Sección 116450 (g)]:

- SCHOOLS: Must notify school employees, students, and parents (if the students are minors).
- RESIDENTIAL RENTAL PROPERTY OWNERS OR MANAGERS (including nursing homes and care facilities): Must notify tenants.
- BUSINESS PROPERTY OWNERS, MANAGERS, OR OPERATORS: Must notify employees of businesses located on the property.

This notice sent to you by: Maywood Mutual Water Company No. 3. DBA Tri-City Mutual Water 6151 Heliotrope Ave. Maywood, C 90270

State Water System ID#:19-10086. Date distributed: March 1 2020.

MAYWOOD MUTUAL WATER COMPANY NUMBER 3
DBA, TRI-CITY MUTUAL WATER COMPANY
- 2020 CONSUMER CONFIDENCE REPORT

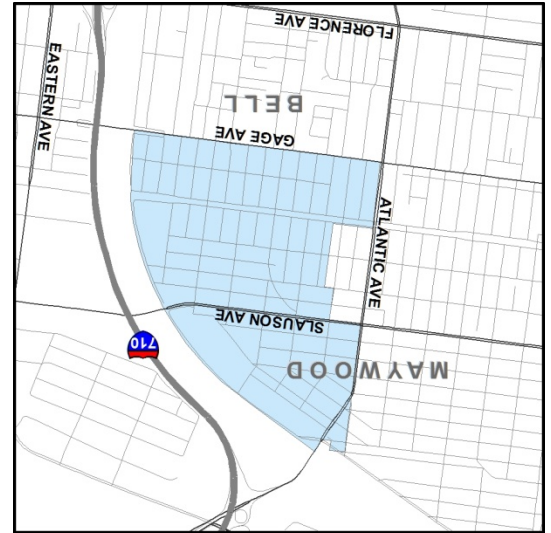

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien. Para obtener una copia en Español, llame a (323) 560-3657.

MAYWOOD MUTUAL WATER COMPANY NUMBER 3
DBA, TRI-CITY MUTUAL WATER COMPANY
6151 HELIOTROPE AVENUE
MAYWOOD, CA 90270

MAYWOOD MUTUAL WATER COMPANY NUMBER 3
DBA, TRI-CITY MUTUAL WATER COMPANY -
2020 CONSUMER CONFIDENCE REPORT

MAYWOOD MUTUAL WATER COMPANY No. 3

DBA Tri-City mutual Water Company

6151 Heliotrope Avenue • Maywood, CA 90270-0669
(323) 560-3657 • Fax (323) 560-3852

City of Maywood Council
4319 Slauson Ave.
Maywood, Ca. 90270

May 10, 2021

RE: Notification of 1,4-Dioxane

Dear **City Council**,

Well #7 was detected with an emerging contaminant known as 1,4-Dioxane. The levels of detection ND-6.0 ug/L of the test results of December 2020 are such that we are required to notify our customers of the detection. This is the purpose of this document to notify you that such contaminant was detected. The findings of the test results translate to (1ug/L = one drop in 48,000 gallons). The response level, the level at which removal of the source from service, is 35 ug/L for 1,4-dioxane.

1,4-Dioxane has been used as a stabilizer for solvents, in particular 1,1,1- trichloroethane (TCA), and a solvent in its own right, as well as in a number of industrial and commercial applications.

Our Well #7 will continue to be monitored for 1,4-Dioxane. You will also see this information included in the Annual Quality Report for 2019 (CCR's) being mailed out to our consumers before July 1, 2020.

Drinking water systems are not required by state regulations to monitor for 1,4-dioxane. Nevertheless, because of concerns about possible contamination, a number of systems have been directed by the State Water Resources Control Board, Division of Drinking Water to or have chosen to sample their supplies for 1,4-dioxane.

"Notification level" means the concentration level of a contaminant in drinking water delivered for human consumption that the department has determined, based on available scientific information, does not pose a significant health risk but warrants notification pursuant to this section, Code §116455. Notification levels are non-regulatory, health-based advisory levels established by the department for contaminants in drinking water for which maximum contaminant levels have not been established. Notification levels are established as precautionary measures for contaminants that may be considered candidates for establishment of maximum contaminant levels, but have not yet undergone or completed the regulatory standard setting process prescribed for the development of maximum contaminant levels and are not drinking water standards.

If you have any questions or concerns, please feel free to contact our office and speak to either Robert Rohlf # @323-560-3657.



Respectfully,
Maywood Mutual Water Co. #3
Board of Directors

Cc: Sutida Bergquist, PE
Central District
Division of Drinking Water
State Water Resources Control Board
500 North Central Ave. Ste 500
Glendale, CA 91203

MAYWOOD MUTUAL WATER COMPANY No. 3

DBA Tri-City mutual Water Company

6151 Heliotrope Avenue • Maywood, CA 90270-0669
(323) 560-3657 • Fax (323) 560-3852

City of Bell Council
6330 Pine Ave
Bell, CA 90201

May 15, 2021

RE: Notification of 1,4-Dioxane

Dear **City Council**,

Well #7 was detected with an emerging contaminant known as 1,4-Dioxane. The levels of detection ND-6.0 ug/L of the test results of December 2020 are such that we are required to notify our customers of the detection. This is the purpose of this document to notify you that such contaminant was detected. The findings of the test results translate to (1ug/L = one drop in 48,000 gallons). The response level, the level at which removal of the source from service, is 35 ug/L for 1,4-dioxane.

1,4-Dioxane has been used as a stabilizer for solvents, in particular 1,1,1- trichloroethane (TCA), and a solvent in its own right, as well as in a number of industrial and commercial applications.

Our Well #7 will continue to be monitored for 1,4-Dioxane. You will also see this information included in the Annual Quality Report for 2019 (CCR's) being mailed out to our consumers before July 1, 2020.

Drinking water systems are not required by state regulations to monitor for 1,4-dioxane. Nevertheless, because of concerns about possible contamination, a number of systems have been directed by the State Water Resources Control Board, Division of Drinking Water to or have chosen to sample their supplies for 1,4-dioxane.

"Notification level" means the concentration level of a contaminant in drinking water delivered for human consumption that the department has determined, based on available scientific information, does not pose a significant health risk but warrants notification pursuant to this section, Code §116455. Notification levels are non-regulatory, health-based advisory levels established by the department for contaminants in drinking water for which maximum contaminant levels have not been established. Notification levels are established as precautionary measures for contaminants that may be considered candidates for establishment of maximum contaminant levels, but have not yet undergone or completed the regulatory standard setting process prescribed for the development of maximum contaminant levels and are not drinking water standards.

If you have any questions or concerns, please feel free to contact our office and speak to either Robert Rohlf # @323-560-3657.



Respectfully,
Maywood Mutual Water Co. #3
Board of Directors

Cc: Sutida Bergquist, PE
Central District
Division of Drinking Water
State Water Resources Control Board
500 North Central Ave. Ste 500
Glendale, CA 91203

MAYWOOD MUTUAL WATER COMPANY No. 3

DBA Tri-City mutual Water Company

6151 Heliotrope Avenue • Maywood, CA 90270-0669
(323) 560-3657 • Fax (323) 560-3852

City of Vernon Council
4305 S. Santa Fe Avenue
Vernon, CA 90058

May 15, 2021

RE: Notification of 1,4-Dioxane

Dear **City Council**,

Well #7 was detected with an emerging contaminant known as 1,4-Dioxane. The levels of detection ND-6.0 ug/L of the test results of December 2020 are such that we are required to notify our customers of the detection. This is the purpose of this document to notify you that such contaminant was detected. The findings of the test results translate to (1ug/L = one drop in 48,000 gallons). The response level, the level at which removal of the source from service, is 35 ug/L for 1,4-dioxane.

1,4-Dioxane has been used as a stabilizer for solvents, in particular 1,1,1- trichloroethane (TCA), and a solvent in its own right, as well as in a number of industrial and commercial applications.

Our Well #7 will continue to be monitored for 1,4-Dioxane. You will also see this information included in the Annual Quality Report for 2019 (CCR's) being mailed out to our consumers before July 1, 2020.

Drinking water systems are not required by state regulations to monitor for 1,4-dioxane. Nevertheless, because of concerns about possible contamination, a number of systems have been directed by the State Water Resources Control Board, Division of Drinking Water to or have chosen to sample their supplies for 1,4-dioxane.

"Notification level" means the concentration level of a contaminant in drinking water delivered for human consumption that the department has determined, based on available scientific information, does not pose a significant health risk but warrants notification pursuant to this section, Code §116455. Notification levels are non-regulatory, health-based advisory levels established by the department for contaminants in drinking water for which maximum contaminant levels have not been established. Notification levels are established as precautionary measures for contaminants that may be considered candidates for establishment of maximum contaminant levels, but have not yet undergone or completed the regulatory standard setting process prescribed for the development of maximum contaminant levels and are not drinking water standards.

If you have any questions or concerns, please feel free to contact our office and speak to either Robert Rohlf # @323-560-3657.



Respectfully,
Maywood Mutual Water Co. #3
Board of Directors

Cc: Sutida Bergquist, PE
Central District
Division of Drinking Water
State Water Resources Control Board
500 North Central Ave. Ste 500
Glendale, CA 91203