

Consumer Confidence Report Certification Form

(To be submitted with a copy of the CCR)

Water System Name:	NASA Ames Research Center
Water System Number:	CA4300997

The water system named above hereby certifies that its Consumer Confidence Report was distributed on 6/28/2024 to customers (and appropriate notices of availability have been given). Further, the system certifies that the information contained in the report is correct and consistent with the compliance monitoring data previously submitted to the State Water Resources Control Board, Division of Drinking Water (DDW).

Certified by:

Name: Jeanne Sabin	Title: Water Compliance Program Manager
Signature:	Date: 17 September 2024
Phone number: 650-582-7321	blank

To summarize report delivery used and good-faith efforts taken, please complete this page by checking all items that apply and fill-in where appropriate:

- ☐ CCR was distributed by mail or other direct delivery methods (attach description of other direct delivery methods used).
- ☒ CCR was distributed using electronic delivery methods described in the Guidance for Electronic Delivery of the Consumer Confidence Report (water systems utilizing electronic delivery methods must complete the second page).
- ☒ "Good faith" efforts were used to reach non-bill paying consumers. Those efforts included the following methods:
 - ☒ Posting the CCR at the following URL:
<https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>
 - ☐ Mailing the CCR to postal patrons within the service area (attach zip codes used)
 - ☐ Advertising the availability of the CCR in news media (attach copy of press release)
 - ☐ Publication of the CCR in a local newspaper of general circulation (attach a copy of the published notice, including name of newspaper and date published)
 - ☐ Posted the CCR in public places (attach a list of locations)
 - ☐ Delivery of multiple copies of CCR to single-billed addresses serving several persons, such as apartments, businesses, and schools

- ☐ Delivery to community organizations (attach a list of organizations)
- ☐ Publication of the CCR in the electronic city newsletter or electronic community newsletter or listserv (attach a copy of the article or notice)
- ☐ Electronic announcement of CCR availability via social media outlets (attach list of social media outlets utilized)
- ☐ Other (attach a list of other methods used)
- ☐ *For systems serving at least 100,000 persons:* Posted CCR on a publicly-accessible internet site at the following URL: www._____
- ☐ *For privately-owned utilities:* Delivered the CCR to the California Public Utilities Commission

Consumer Confidence Report Electronic Delivery Certification

Water systems utilizing electronic distribution methods for CCR delivery must complete this page by checking all items that apply and fill-in where appropriate.

- ☐ Water system mailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available website where it can be viewed (attach a copy of the mailed CCR notification). URL: www._____
- ☒ Water system emailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available site on the Internet where it can be viewed (attach a copy of the emailed CCR notification). URL: <https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>
- ☐ Water system emailed the CCR as an electronic file email attachment.
- ☐ Water system emailed the CCR text and tables inserted or embedded into the body of an email, not as an attachment (attach a copy of the emailed CCR).
- ☐ *Requires prior DDW review and approval.* Water system utilized other electronic delivery method that meets the direct delivery requirement.

Provide a brief description of the water system's electronic delivery procedures and include how the water system ensures delivery to customers unable to receive electronic delivery.

A center wide email is sent notifying all about the CCR availability. Additional emails are sent to those not included in the center wide email. Additionally, a CCR hard copy may be posted in public areas of buildings for general awareness and information.

This form is provided as a convenience and may be used to meet the certification requirement of section 64483(c) of the California Code of Regulations.

Appendix A: Copy of notifications



2023 Water Quality Report is Now Available Online



Sabin, Jeanne M. (ARC-JQ)
Environmental Engineer

Published 7/1/2024

Ames is required by law to provide an annual report on the quality of our drinking water by July 1 for the previous calendar year. Our water supplier, the San Francisco Public Utilities Commission, along with Ames, monitors and analyzes our water according to regulations set by the U.S. Environmental Protection Agency (EPA) and the California State Water Resources Control Board, Division of Drinking Water. The Water Quality Report presents these results.

An electronic version of this report is now available to both employees at Moffett Field and the public on the Ames Environmental Management Division website:

<https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>

If you have any questions, please feel free to contact Jeanne Sabin, Environmental Management Division, at 650-582-7321 or via email at jeanne.m.sabin@nasa.gov.

Inside Ames

From: [Sabin, Jeanne M. \(ARC-JO\)](#)
To: [Haider, Meighan K. \(ARC-DT\)](#)
Cc: [Encarnacion, Antonio \(ARC-DT\)](#); [Serna, Elena \(ARC-DT\)](#); [Carbon-norman, Cynthia L. \(ARC-DT\)](#); [Turner, Garrett Michael \(ARC-JO\)](#); [Kawashima, Brian L. \(ARC-JO\)\[BB&E, Inc.\]](#); [Wibe, Lauren {she,her} \(ARC-JO\)](#)
Subject: 2023 Water Quality Report Now Available - Please forward to NRP Partners
Date: Friday, June 28, 2024 7:25:15 AM

Good morning Meighan,

Below is the notification that is to be provided to all employees and residents at Moffett Field. Please forward the notice below to the NRP Partners, with the website hyperlink fully written out. Thank you for all your assistance, and happy to answer any questions.

Subject: 2023 Water Quality Report Now Available Online

Ames is required by law to provide an annual report on the quality of our drinking water by July 1 for the previous calendar year. Our water supplier, the San Francisco Public Utilities Commission, along with Ames, monitors and analyzes our water according to regulations set by the U.S. Environmental Protection Agency (EPA) and the California State Water Resources Control Board, Division of Drinking Water. The Water Quality Report presents these results.

An electronic version of this report is now available to both employees at Moffett Field and the public on the Ames Environmental Management Division website:

<https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>

If you have any questions, please feel free to contact Jeanne Sabin, Environmental Management Division, at 650-582-7321 or via email at jeanne.m.sabin@nasa.gov.

Sincerely,

Jeanne

Jeanne Sabin
Water Compliance Program Manager
Environmental Management Division
NASA Ames Research Center
M/S 204-15
Building N204, Room 102-11
Moffett Field, CA 94035-0001

Office: 650-604-1800
Mobile: 650-582-7321
Email: jeanne.m.sabin@nasa.gov
Pronouns: She, Hers

From: [Sabin, Jeanne M. \(ARC-JO\)](#)
To: [Lozano, Sharon K. \(ARC-D\)](#)
Cc: [Turner, Garrett Michael \(ARC-JO\)](#); [Kawashima, Brian L. \(ARC-JO\)\[BB&E, Inc.\]](#); [Alherz, Zaki \(ARC-JCM\)](#); [Wibe, Lauren {she,her} \(ARC-JO\)](#)
Subject: 2023 Water Quality Report Now Available - Please forward to Wescoat Residents and Employees and 63rd Readiness Division
Date: Friday, June 28, 2024 7:45:35 AM

Good morning Sharon,

Below is the notification that is to be provided to all employees and residents at Moffett Field. Could you please forward the notice below to the correct POCs for Wescoat Housing and the 63rd Readiness Division? Please note, the website hyperlink below must remain fully written out. Thank you for all your assistance, and happy to answer any questions.

Subject: 2023 Water Quality Report Now Available Online

Ames is required by law to provide an annual report on the quality of our drinking water by July 1 for the previous calendar year. Our water supplier, the San Francisco Public Utilities Commission (SFPUC), along with Ames, monitors and analyzes our water according to regulations set by the U.S. Environmental Protection Agency (EPA) and the California State Water Resources Control Board, Division of Drinking Water. The Water Quality Report presents these results.

An electronic version of this report is now available to both employees at Moffett Field and the public on the Ames Environmental Management Division website:

<https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>

Special Note about Army Properties:

Although the Moffett Field Army Properties (Wescoat Housing and Army Reserve Center) share the same water supplier (SFPUC) through the Hetch Hetchy – Tyrella supply line under agreements with NASA Ames, the Army properties are not included in the NASA Ames drinking water permit with the California State Water Resources Control Board, Division of Drinking Water, for either water quality monitoring or maintenance within the Army properties.

Practically, this means if there is a problem with the Tyrella supply line to an Army property, NASA Ames will fix or maintain this line. NASA Ames also monitors water quality within NASA properties. Since the Army properties receive water from the same source, this monitoring provides a good indication of the water quality supplied to the Army properties. However, NASA Ames does not monitor water quality within the Army properties nor maintains their lines. These responsibilities lie with the Army.

If you have any questions, please feel free to contact Jeanne Sabin, Environmental Management Division, at 650-582-7321 or via email at jeanne.m.sabin@nasa.gov.

Sincerely,

Jeanne

Jeanne Sabin
Water Compliance Program Manager
Environmental Management Division
NASA Ames Research Center
M/S 204-15
Building N204, Room 102-11
Moffett Field, CA 94035-0001

Office: 650-604-1800
Mobile: 650-582-7321
Email: jeanne.m.sabin@nasa.gov
Pronouns: She, Hers

From: [Sabin, Jeanne M. \(ARC-JQ\)](#)
To: Chien, Tsungchu@Waterboards
Cc: [Turner, Garrett Michael \(ARC-JQ\)](#); [Kawashima, Brian L. \(ARC-JQ\)\[BB&E, Inc.\]](#)
Subject: CA4300997 2023 Consumer Confidence Report
Date: Friday, June 28, 2024 8:39:04 AM
Attachments: [CA4300997 2023 Consumer Confidence Report Final 20240606.pdf](#)

Good morning George,

NASA Ames' Consumer Confidence Report (CCR) for calendar year 2023 was posted on June 18, 2024, available on the Ames Environmental Management Division public-facing website and attached. Below is the notification being provided to employees, residents, and tenants at Moffett Field. I will be sure to also provide the CCR certification report prior to October 1, 2024.

Please feel free to call or email me or Garrett Turner anytime with questions or concerns, and hope you have a great Friday.

Subject: 2023 Water Quality Report Now Available Online

Ames is required by law to provide an annual report on the quality of our drinking water by July 1 for the previous calendar year. Our water supplier, the San Francisco Public Utilities Commission, along with Ames, monitors and analyzes our water according to regulations set by the U.S. Environmental Protection Agency (EPA) and the California State Water Resources Control Board, Division of Drinking Water. The Water Quality Report presents these results.

An electronic version of this report is now available to both employees at Moffett Field and the public on the Ames Environmental Management Division website:

<https://environment.arc.nasa.gov/assets/files/2023%20Water%20Quality%20Report%20Final%2020240606.pdf>

If you have any questions, please feel free to contact Jeanne Sabin, Environmental Management Division, at 650-582-7321 or via email at jeanne.m.sabin@nasa.gov.

Sincerely,

Jeanne

Jeanne Sabin
Water Compliance Program Manager
Environmental Management Division
NASA Ames Research Center
M/S 204-15
Building N204, Room 102-11
Moffett Field, CA 94035-0001

Office: 650-604-1800
Mobile: 650-582-7321

Email: jeanne.m.sabin@nasa.gov

Pronouns: She, Hers

Appendix B: Copy of CCR



2023 Water Quality Report

NASA Ames Research Center, Moffett Field, California

July 2024


OUR DRINKING WATER QUALITY AND SOURCE

Federal and State law requires that NASA Ames Research Center (NASA Ames) make this report every year by July 1st for the previous calendar year (CY) concerning the sources and quality of the water provided to our customers by our drinking water distribution system.

This report contains important information about your drinking water. Please contact Jeanne Sabin at (650) 604-1800, jeanne.m.sabin@nasa.gov or Brian Kawashima at (650) 604-0296, brian.l.kawashima@nasa.gov for assistance. Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien. Para la ayuda en español entre en contacto con a Tito Martinez en (650) 604-1523, norberto.martinezmendez@nasa.gov.

For CY 2023, the water provided by the distribution system for NASA Ames (which includes Moffett Field) was monitored and analyzed by both the supplier and NASA Ames in accordance with Federal and State regulations. This report presents the results of those analyses with the details shown in the table on the last page. Most of the data in this table is provided to us by our supplier and the NASA Ames monitoring results are shown in the shaded regions.

Hetch Hetchy Water System Map

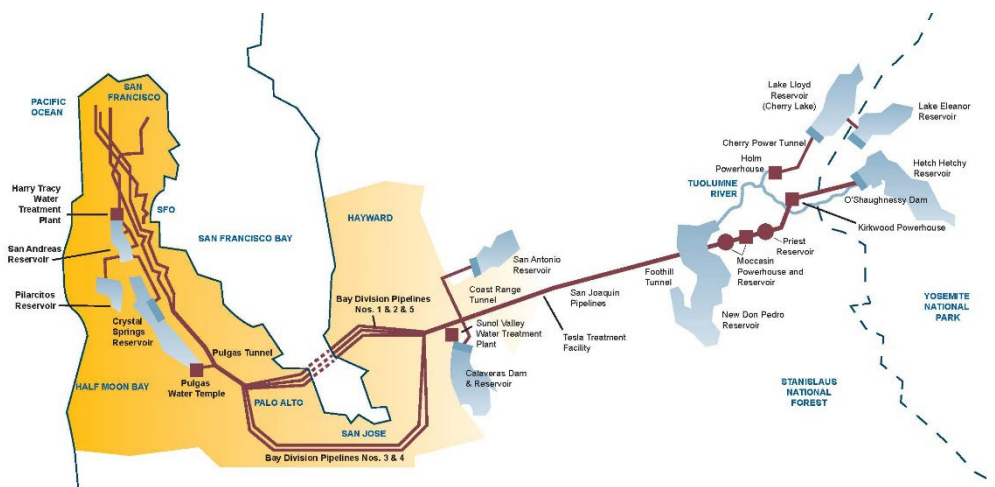

Drinking water at NASA Ames is supplied by the San Francisco Regional Water System (SFRWS), which is owned and operated by the San Francisco Public Utilities Commission (SFPUC). Our major drinking water supply consists of surface water and groundwater that are well protected and carefully managed by the SFPUC. These sources are diverse in both the origin and the location with the surface water stored in reservoirs located in the Sierra Nevada, Alameda County, and San Mateo County, as well as groundwater stored in a deep aquifer located in the northern part of San Mateo County.

2023 Water Quality Report

National Aeronautics and Space Administration

To meet drinking water standards for consumption, all surface water supplies including the upcountry non-Hetch Hetchy sources (UNHHS) undergo treatment by the SFRWS before it is delivered. Water from Hetch Hetchy Reservoir is exempt from federal and State filtration requirements but receives the following treatment: disinfection using ultraviolet light and chlorine, pH adjustment for optimum corrosion control, fluoridation for dental health protection, and chloramination for maintaining disinfectant residual and minimizing the formation of regulated disinfection byproducts. Water from local Bay Area reservoirs in Alameda County and UNHHS is delivered to Sunol Valley Water Treatment Plant (SVWTP); whereas water from local reservoirs in San Mateo County is delivered to Harry Tracy Water Treatment Plant (HTWTP). Water treatment at these plants consists of filtration, disinfection, fluoridation, optimum corrosion control, and taste and odor removal.

Protecting our Watersheds

SFRWS conducts watershed sanitary surveys for the Hetch Hetchy source annually and for non-Hetch Hetchy surface water sources every five years. The latest sanitary surveys for the non-Hetch Hetchy watersheds were completed in 2021 for the period of 2016-2020. All these surveys together with our stringent watershed protection management activities were completed with support from partner agencies including the National Park Service and US Forest Service. The purposes of the surveys are to evaluate the sanitary conditions and water quality of the watersheds and to review results of watershed management activities conducted in the preceding years. Wildlife, stock, and human activities continue to be the potential contamination sources. You may contact the San Francisco District office of the State Water Resources Control Board's Division of Drinking Water (SWRCB-DDW) at 510-620-3474 for the review of these reports.

Water Quality

Together with the SFRWS, samples are collected from reservoirs and designated sampling points throughout the system and tested to ensure the water delivered to you meets or exceeds federal and State drinking water standards.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. To ensure that tap water is safe to drink, the United States Environmental Protection Agency (USEPA) and the SWRCB prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

Drinking Water and Lead

Exposure to lead, if present, can cause serious health effects in all age groups, especially for pregnant women and young children. Infants and children who drink water containing lead could have decreases in intelligence quotient (IQ) and attention span and increases in learning and behavior problems. The children of women who are exposed to lead before or during pregnancy can have increased risk of these adverse health effects. Adults can have increased risk of heart disease, high blood pressure, kidney, or nervous system problems.

2023 Water Quality Report

National Aeronautics and Space Administration

Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. There are no known lead service lines in our water distribution system. We are responsible for providing high quality drinking water and removing lead pipes, but we cannot control the variety of materials used in plumbing components in your home. You share the responsibility for protecting yourself and your family from the lead in your home plumbing. You can take responsibility by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Before drinking tap water, flush your pipes for several minutes by running your tap, taking a shower, doing laundry or a load of dishes. You can also use a filter certified by an American National Standards Institute accredited certifier to remove lead from drinking water. If you are concerned about lead in the NASA Ames water supply, contact Jeanne Sabin at (650) 604-1800, jeanne.m.sabin@nasa.gov or Brian Kawashima at (650) 604-0269, brian.l.kawashima@nasa.gov. For information about lead in drinking water, testing methods, and steps you can take to minimize exposure is available at www.epa.gov/safewater/lead.

Ames conducts lead and copper surveys every three years. The last survey was conducted in 2023. The majority of the water distribution system at the former Naval Air Station Moffett Field or NASA Research Park (NRP) is cast iron pipe (CIP) with lead joints and was constructed in the 1940's and 1950's. Additional portions of the system were added as the site expanded. Tap sampling locations were selected from Tier 2 sample criteria based on Section 64676, Title 22 of California Code of Regulations (CCR §64676). A drinking water service line survey was conducted in 2020 per California Health and Safety code, Section 116885, and no lead service lines were found at NASA Ames.

Lead and Copper Tap Sampling Results

Determination of the level of exceedance for lead and copper was based on CCR §64678. A total of 22 samples were collected and analyzed for exceedance in more than 10 percent of the samples (90th percentile). Based upon the results of the sampling data, Ames did not exceed the action levels for the 90th percentiles for lead or copper. However, two sampling locations were at or above the action level for lead concentration. Continued monitoring for lead and copper will take place triennially as required with our next sampling event planned for September 2026.

Fluoridation and Dental Fluorosis

Mandated by State law, water fluoridation is a widely accepted practice proven to be safe and effective for preventing and controlling tooth decay. The fluoride target level in the water is 0.7 milligram per liter (mg/L, or part per million, ppm), consistent with the May 2015 State regulatory guidance on optimal fluoride level. Infants fed formula mixed with water containing fluoride at this level may still have a chance of developing tiny white lines or streaks in their teeth. These marks are referred to as mild to very mild fluorosis and are often only visible under a microscope. Even in cases where the marks are visible, they do not pose any health risk. The Centers for Disease Control (CDC) considers it safe to use optimally fluoridated water for preparing infant formula. To lessen this chance of dental fluorosis, you may choose to use low-fluoride bottled water to prepare infant formula. Nevertheless, children may still develop dental fluorosis due to fluoride intake from other sources such as food, toothpaste, and dental products.

Contact your healthcare provider or SWRCB-DDW if you have concerns about dental fluorosis. For additional information about fluoridation or oral health, visit the SWRCB-DDW website www.waterboards.ca.gov/drinking_water/certlic/drinkingwater/Fluoridation.shtml, or the CDC website www.cdc.gov/fluoridation.

2023 Water Quality Report

National Aeronautics and Space Administration

Special Health Needs

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons, such as those with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly people and infants, can be particularly at risk from infections.

These people should seek advice about drinking water from their healthcare providers. USEPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the USEPA's Safe Drinking Water Hotline 800-426-4791 or at www.epa.gov/safewater.

Monitoring of Per- and Polyfluoroalkyl Substances (PFAS)

PFAS is a group of approximately 5,000 man-made, persistent chemicals used in a variety of industries and consumer products. In 2021, our wholesaler conducted a second round of voluntary monitoring using a newer analytical method adopted by the USEPA for some other PFAS contaminants. No PFAS were detected above the SWRCB's Consumer Confidence Report Detection Levels in surface water and groundwater sources. For additional information about PFAS, you may visit SWRCB website waterboards.ca.gov/pfas, SFPUC website https://sfpuc.org/sites/default/files/documents/PFAS_FactSheet_2023.pdf, and/or USEPA website epa.gov/pfas.

State Revised Total Coliform Rule

This report reflects changes in drinking water regulatory requirements during 2021, in which the SWRCB adopted the California version of the federal Revised Total Coliform Rule. The revised rule, effective on July 1, 2021, maintains the purpose to protect public health by ensuring the integrity of the drinking water distribution system and monitoring for the presence of microbials (i.e., total coliform and *E. coli* bacteria). Greater public health protection is anticipated, as the revised rule requires water systems that are vulnerable to microbial contamination to identify and fix problems. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment to determine if any sanitary defects exist. If found, these must be corrected by the water system.

Boron Detection Above Notification Level in Source Water

In 2023, boron was detected at a level of 1.7 ppm in the raw water stored in Pond F3 East, one of the San Francisco Regional Water System's approved sources in the Alameda Watershed. Similar levels were also previously detected in the same pond. Although the detected value was above the California Notification Level (NL) of 1 ppm, the water was typically delivered to San Antonio Reservoir where it was substantially diluted to below the NL before treatment at the Sunol Valley Water Treatment Plant. Boron is an element in nature and is typically released into air and water when soils and rocks naturally weather.

Cross Connection Control Program

The purpose of a cross-connection control program is to prevent the occurrence of backflow into a water distribution system in order to protect customers from contamination or pollution from any on-site hazards. Properly installed and maintained backflow prevention devices, devices or methods provide protection against the threat posed by many conditions typically found on a user's premise.

2023 Water Quality Report

National Aeronautics and Space Administration

Ames conducts annual backflow prevention device testing and certification to maintain the health and safety of the water system. Testing is completed by a licensed professional. Any device that fails its test is repaired and retested for completeness.

Cryptosporidium in Surface Water

Cryptosporidium is a microbial pathogen found in surface water throughout the U.S. Although filtration removes Cryptosporidium, the most commonly used filtration methods cannot guarantee 100 percent removal. Our monitoring indicates the presence of these organisms in our source water and/or finished water. Current test methods do not allow us to determine if the organisms are dead or if they are capable of causing disease. Ingestion of Cryptosporidium may cause cryptosporidiosis, an abdominal infection. Symptoms of infection include nausea, diarrhea, and abdominal cramps. Most healthy individuals can overcome the disease within a few weeks. However, immuno-compromised people, infants and small children, and the elderly are at greater risk of developing life-threatening illness. We encourage immuno-compromised individuals to consult their doctor regarding appropriate precautions to take to avoid infection. Cryptosporidium must be ingested to cause disease, and it may be spread through means other than drinking water.

Contaminants and Regulations

Generally, the sources of drinking water (both tap water and bottled water) include rivers, lakes, oceans, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Such substances are called contaminants, and may be present in source water as:

Microbial contaminants, such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife,

Inorganic contaminants, such as salts and metals, that can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming,

Pesticides and herbicides that may come from a variety of sources such as agriculture, urban stormwater runoff and residential uses,

Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems,

Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities.

More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline 800-426-4791, or at www.epa.gov/safewater.

Frequently Asked Questions

Why is my water yellow or brown?

The most common reason for discolored water is the plumbing. When water is not circulated regularly (unused over weekends), it can pick up color from the pipes. Distribution mains can also accumulate small amounts of sediment that settles out. When NASA Ames opens hydrants, this sediment can become re-suspended. Let the water run a few minutes to clear the discoloration.

Why does my water sometimes look cloudy?

Tiny air bubbles that can cause cloudy water often originates when water is pumped during distribution. The cloudy appearance should clear when the water is allowed to stand for a few minutes.

Why tap vs. bottled?

On February 28, 2005, the bottled water service was canceled since our tap water meets Federal and State health standards. Therefore, the Center cannot expend public funds for bottled water.

What should I consider before buying bottled water?

Consider why you are buying bottled water. Many people choose bottled water because of its taste. One of the key taste differences between tap water and bottled water is based on the disinfection method. Tap water can be disinfected with chlorine, chloramine, ozone, or ultraviolet light. Generally, bottlers prefer ozone because it does not leave a taste. Bottled water is not necessarily safer than tap water and costs hundreds of times more than tap water on a per gallon basis. Consumers who choose to purchase bottled water should carefully read its label to understand what they are buying, whether it is a better taste, or a certain method of treatment.

Drinking tap water is a sustainable choice. Bottled water manufacturing processes use oil, release carbon dioxide emissions, and use fuel for transportation and delivery.

Key Water Quality Terms

The following are definitions of key terms referring to standards and goals of water quality noted on the data table.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the USEPA.

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs or MCLGs as is economically and technologically feasible. Secondary MCLs (SMCLs) are set to protect the odor, taste, and appearance of drinking water.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

2023 Water Quality Report

National Aeronautics and Space Administration

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Primary Drinking Water Standard (PDWS): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

Regulatory Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Turbidity: A water clarity indicator that measures cloudiness of the water and is also used to indicate the effectiveness of the filtration system. High turbidity can hinder the effectiveness of disinfectants.

NASA Ames Research Center - Water Quality Data for Year 2023 ⁽¹⁾

DETECTED CONTAMINANTS	Unit	MCL/TT	PHG or (MCLG)	Range or Level Found	Average or [Max]	Typical Sources in Drinking Water
TURBIDITY						
Unfiltered Hetch Hetchy Water	NTU	5	N/A	0.3 - 0.9 ⁽²⁾	[2]	Soil runoff
Filtered Water from Sunol Valley Water Treatment Plant (SVWTP)	NTU	1 ⁽³⁾	N/A	-	[0.2]	Soil runoff
	-	Min 95% of samples ≤ 0.3 NTU ⁽³⁾	N/A	100%	-	Soil runoff
Filtered Water from Harry Tracy Water Treatment Plant (HTWTP)	NTU	1 ⁽³⁾	N/A	-	[0.6]	Soil runoff
	-	Min 95% of samples ≤ 0.3 NTU ⁽³⁾	N/A	99.4% - 100%	-	Soil runoff
DISINFECTION BYPRODUCTS AND PRECURSOR						
Total Trihalomethanes	ppb	80	N/A	21.0 - 54.0	32.25 ⁽⁴⁾	Byproduct of drinking water disinfection
Five Haloacetic Acids	ppb	60	N/A	15.2 - 56.0	33.8 ⁽⁴⁾	Byproduct of drinking water disinfection
Bromate	ppb	10	0.1	ND - 1.7	[1] ⁽⁵⁾	Byproduct of drinking water disinfection
Total Organic Carbon ⁽⁶⁾	-	TT (% Removal Ratio)	N/A	1.2 - 1.8	[1.5] ⁽⁵⁾	Various natural and man-made sources
MICROBIOLOGICAL						
<i>E. coli</i>	-	0 PS	(0)	-	ND	Human or animal fecal waste
<i>Giardia lamblia</i>	cyst/L	TT	(0)	0 - 0.13	0.03	Naturally present in the environment
INORGANICS						
Fluoride ⁽⁷⁾	ppm	2.0	1	0.4 - 2.6	0.6	Erosion of natural deposits; water additive to promote strong teeth
Nitrate (as N)	ppm	10	10	ND - 0.6	ND	Erosion of natural deposits
Chloramine (as chlorine)	ppm	MRDL = 4.0	MRDLG = 4	0.02 - 3.50	1.96 ⁽⁵⁾	Drinking water disinfectant added for treatment

CONSTITUENTS WITH SECONDARY STANDARDS	Unit	SMCL	PHG	Range	Average	Typical Sources in Drinking Water
Aluminum ⁽⁸⁾	ppb	200	600	ND - 82	ND	Erosion of natural deposits; some surface water treatment residue
Chloride	ppm	500	N/A	<3 - 17	8.7	Runoff / leaching from natural deposits
Color ⁽⁹⁾	Unit	15	N/A	<5 - 20	<5	Naturally-occurring organic materials
Iron	ppb	300	N/A	<6 - 42	19	Leaching from natural deposits
Manganese	ppb	50	N/A	<2 - 4.6	2.6	Leaching from natural deposits
Specific Conductance	µS/cm	1600	N/A	32 - 289	175	Substances that form ions when in water
Sulfate	ppm	500	N/A	1.2 - 36	17	Runoff / leaching from natural deposits
Threshold Odor Number	T.O.N	3	N/A	ND - 1	ND	Naturally-occurring organic materials
Total Dissolved Solids	ppm	1000	N/A	<20 - 153	84	Runoff / leaching from natural deposits
Turbidity	NTU	5	N/A	0.1 - 1.6	<1.0	Soil runoff

LEAD AND COPPER	Unit	AL	PHG	Range	90th Percentile	Typical Sources in Drinking Water
Copper	ppb	1300	300	18 - 130 ⁽¹⁰⁾	91.6	Internal corrosion of household water plumbing systems
Lead	ppb	15	0.2	ND - 27 ⁽¹¹⁾	10.42	Internal corrosion of household water plumbing systems

NON-REGULATED WATER QUALITY PARAMETERS	Unit	ORL	Range	Average
Alkalinity (as CaCO ₃)	ppm	N/A	3.1 - 103	46
Boron	ppb	1000 (NL)	22 - 65	40
Calcium (as Ca)	ppm	N/A	2.9 - 24	13
Chlorate ⁽¹²⁾	ppb	800 (NL)	30 - 749	141
Chromium (VI)	ppb	N/A	0.11 - 0.35	0.23
Hardness (as CaCO ₃)	ppm	N/A	7.5 - 86	46
Magnesium	ppm	N/A	0.2 - 8.4	4.7
pH	-	N/A	8.4 - 9.8	9.2
Potassium	ppm	N/A	0.3 - 1.7	1
Silica	ppm	N/A	4.4 - 9.4	6.2
Sodium	ppm	N/A	2.7 - 20	14
Strontium	ppb	N/A	14 - 331	139

KEY:
< / ≤ = less than / less than or equal to
AL = Action Level
Max = Maximum
Min = Minimum
N/A = Not Available
ND = Non-detect
NL = Notification Level
NTU = Nephelometric Turbidity Unit
ORL = Other Regulatory Level
ppb = part per billion
ppm = part per million
PS = Number of Positive Sample
µS/cm = microSiemens/centimeter

Footnotes:

- (1) All results met State and Federal drinking water health standards.
- (2) These are monthly average turbidity values measured every 4 hours daily.
- (3) This is a TT requirement for filtration systems.
- (4) This is the highest locational running annual average value.
- (5) This is the highest running annual average value.
- (6) Total organic carbon (TOC) is a precursor for disinfection byproduct formation. The TT requirement applies to the filtered water from the SVWTP only. In 2023, the range of the SVWTP effluent TOC levels were 0.6 ppm - 3.3 ppm.
- (7) Natural fluoride in the Hetch Hetchy source was ND. Elevated fluoride levels in raw water to the water treatment plants were attributed to the transfer of fluoridated Hetch Hetchy water into the local reservoirs. In 2023, the average fluoride level in raw water sources was 0.3 mg/L
- (8) Aluminum also has a primary MCL of 1,000 ppb.
- (9) There are no PHGs, MCLGs, or mandatory standard health effects language for these constituents because secondary MCLs are set on the basis of aesthetic concerns.
- (10) The most recent Lead and Copper Rule monitoring was in 2023. 0 of 22 site samples collected at consumer taps had copper concentrations above the AL.
- (11) The most recent Lead and Copper Rule monitoring was in 2023. 2 of 22 site samples collected at consumer taps had lead concentrations above the AL.
- (12) The detected chlorate is a degradation product of sodium hypochlorite used by the SFRWS for water disinfection.

Additional water quality data may be obtained by calling NASA Ames Research Center phone number at (650) 604-1406 or (650) 604-0296

2023 Water Quality Report

National Aeronautics and Space Administration

Your Views are Welcome

If you have any questions, please let us know. Technical staff investigate drinking water complaints.

Requirements

NASA Ames ensures that a clean, constant supply of drinking water is provided by testing the water, maintaining the distribution systems, and reporting on the water quality.

For Questions about:

Water quality, please contact Jeanne Sabin at (650) 604-1800, jeanne.m.sabin@nasa.gov or Brian Kawashima at (650) 604-0269, brian.l.kawashima@nasa.gov for assistance.

Calidad del agua, contacta a Tito Martinez en (650) 604-1523, norberto.martinezmendez@nasa.gov.

Maintenance, contact the Ames Trouble Desk at (650) 604-5212.

Health & Safety, contact your representative.

Con alguien que lo entienda bien. 此份水質報告，內有重要資訊。請找他人為你翻譯和解說清楚。

Ames Environmental Management Division

<https://environment.arc.nasa.gov>