

APPENDIX B: eCCR Certification Form (Suggested Format)

Consumer Confidence Report Certification Form

(To be submitted with a copy of the CCR)

Water System Name:	Scotts Valley Water District
Water System Number:	4410013

The water system named above hereby certifies that its Consumer Confidence Report was distributed on 6/15/2026 (date) to customers (and appropriate notices of availability have been given). Further, the system certifies that the information contained in the report is correct and consistent with the compliance monitoring data previously submitted to the State Water Resources Control Board, Division of Drinking Water (DDW).

Certified by:

Name: Nate Gillespie	Title: Operations Manager
Signature: <i>Nate Gillespie</i>	Date: 6/16/2026
Phone number: (831)600-1903	blank

To summarize report delivery used and good-faith efforts taken, please complete this page by checking all items that apply and fill-in where appropriate:

- ☒ CCR was distributed by mail or other direct delivery methods (attach description of other direct delivery methods used).
- ☒ CCR was distributed using electronic delivery methods described in the Guidance for Electronic Delivery of the Consumer Confidence Report (water systems utilizing electronic delivery methods must complete the second page).
- ☒ "Good faith" efforts were used to reach non-bill paying consumers. Those efforts included the following methods:
 - ☒ Posting the CCR at the following URL:
<https://www.svwd.org/media/Reports/CCR2025.pdf>
 - ☐ Mailing the CCR to postal patrons within the service area (attach zip codes used)
 - ☐ Advertising the availability of the CCR in news media (attach copy of press release)
 - ☐ Publication of the CCR in a local newspaper of general circulation (attach a copy of the published notice, including name of newspaper and date published)
 - ☐ Posted the CCR in public places (attach a list of locations)

- ☐ Delivery of multiple copies of CCR to single-billed addresses serving several persons, such as apartments, businesses, and schools
- ☐ Delivery to community organizations (attach a list of organizations)
- ☒ Publication of the CCR in the electronic city newsletter or electronic community newsletter or listserv (attach a copy of the article or notice). Please see attachment A
- ☒ Electronic announcement of CCR availability via social media outlets (attach list of social media outlets utilized): Facebook, Instagram, Nextdoor, X and LinkedIn
- ☐ Other (attach a list of other methods used)
- ☐ *For systems serving at least 100,000 persons:* Posted CCR on a publicly-accessible internet site at the following URL: www._____
- ☐ *For privately-owned utilities:* Delivered the CCR to the California Public Utilities Commission

Consumer Confidence Report Electronic Delivery Certification

Water systems utilizing electronic distribution methods for CCR delivery must complete this page by checking all items that apply and fill-in where appropriate.

- ☐ Water system mailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available website where it can be viewed (attach a copy of the mailed CCR notification). URL: www._____
- ☒ Water system emailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available site on the Internet where it can be viewed (attach a copy of the emailed CCR notification). URL: https://www.svwd.org/media/Reports/CCR2025.pdf
- ☐ Water system emailed the CCR as an electronic file email attachment.
- ☐ Water system emailed the CCR text and tables inserted or embedded into the body of an email, not as an attachment (attach a copy of the emailed CCR).
- ☐ *Requires prior DDW review and approval.* Water system utilized other electronic delivery method that meets the direct delivery requirement.

Provide a brief description of the water system's electronic delivery procedures and include how the water system ensures delivery to customers unable to receive electronic delivery.

For customers that receive their bills in the mail, a bill insert was included with the May 2026 bill announcing the availability of the 2025 CCR . Please see attachment B. For customers that receive their bills electronically, a dedicated email announcing the availability of the CCR was sent on 5/15/2026. Please see attachment C. Completed 2025 CCR is included as attachment D.

This form is provided as a convenience and may be used to meet the certification requirement of section 64483(c) of the California Code of Regulations.

Nate Gillespie

From: Scotts Valley Water District <contact@svwd.org>
Sent: Wednesday, May 27, 2026 1:02 PM
To: Nate Gillespie
Subject: May 2026 Newsletter



IN THIS

EDITION:

SVWD Water Quality Report

Grace Way Well Update

Rainfall Report for 2026 Water Year

Save On Your Water Bill With a Pool Cover

SCOTTS VALLEY WATER QUALITY MAKES THE GRADE

Report: SVWD exceeds water quality standards for state, federal guidelines

The annual [SVWD Water Quality Report](#) is available. This latest report shares water quality data from samples collected during the 2025 calendar year, including explaining how water is treated and tested to ensure it's safe — and refreshing — to drink.

Finally, the report shows that the District's water, just like in years past, meets all state and federal drinking water standards.

The report is available [online](#) as well as in print (upon request).

[Read the Report](#)



WaterSmart

Take control of your water use! Enroll or check your [WaterSmart](#) today!



**Motor control center building complete at
Grace Way Well project site**

The motor control center building has been completed at the Grace Way Well site, paving the way for allowing crews to start planning for electrical connections. That process involves trenching on the site as well as part of the road.

Once completed, the Grace Way Well will draw water from the Butano and Lompico aquifers, becoming the District's sixth active well. Capital Improvement Projects like this are essential for maintaining a reliable water supply for local residents and businesses.

Learn more about other Capital Improvement Projects on the [District's website](#).



Rainfall slightly below average

As part of its annual supply and demand assessment, the Scotts Valley Water District tracks regional rainfall. For the 2026 water year (which runs October 2025 through September 2026), Scotts Valley has received 32.45 inches of rain — about 79% of the historical average.

Because of this below-average rainfall, as well as groundwater conditions in the Santa Margarita Basin, the District will remain under Stage 1 Water Conditions. These restrictions have been in place since June 2025, triggered by four consecutive winters of low rainfall.

Track how much rain has fallen in the area by visiting the [District's website](#).



SVWD has you covered this summer

Pool covers are a smart investment for homeowners looking to save money in the long-run. As temperatures begin to rise, pools can lose water through evaporation and can result in using more water to keep the pool full throughout the summer.

With a pool cover, the rate of evaporation is reduced and your water bill is lower as a result. Pool covers also have the added benefit of keeping debris out of the water, maintaining water temperature through insulation and saving you time throughout the summer.

As a bonus, the Scotts Valley Water District is offering customers up to a 50% rebate to cover the cost of pool covers. Learn how to take advantage of this rebate on the [District website](#).



**SCOTTS VALLEY
WATER DISTRICT**
svwd.org



[View email in browser](#)

Scotts Valley Water District • 2 Civic Center Dr. • Scotts Valley, Ca 95066 • USA

[update your preferences](#) or [unsubscribe](#)

SCOTTS VALLEY WATER QUALITY MAKES THE GRADE

Este reporte contiene las instrucciones mas recientes para obtener informacion importante sobre su agua potable. Traducir, o hablar con alguien que lo entienda.

Scotts Valley Water District's annual report on water quality shows that last year, as in years past, the District's water met all State and Federal primary drinking water standards. Included in the Consumer Confidence Report is information about the source water quality and treated water quality. It also explains how the water is treated and tested to ensure it is always safe and refreshing to drink.



To view and download the 2025 SVWD Water Quality Report, visit www.svwd.org/media/Reports/CCR2025.pdf. For questions or to receive a hard copy of the report, call (831)438-2363.

Attachment B



SCOTTS VALLEY
WATER DISTRICT

svwd.org   



YOUR WATER RATES AT WORK

The Scotts Valley Water District continues to invest in water infrastructure for customers. Learn more about all projects by visiting the CIP page.

svwd.org/Projects



SCOTTS VALLEY
WATER DISTRICT

svwd.org    

Nate Gillespie

From: Scotts Valley Water District <support@watersmartsoftware.com>
Sent: Friday, May 15, 2026 12:18 PM
To: Nate Gillespie
Subject: SVWD 2025 Water Quality Report Is Now Available



2 Civic Center Dr
007012-005

Hello,

Scotts Valley Water District's annual report on water quality shows that last year, as in years past, the District's water met all State and Federal primary drinking water standards. Included in the Consumer Confidence Report is information about the source water quality and treated water quality. It also explains how the water is treated and tested to ensure it is always safe and refreshing to drink.

To view and download the 2025 SVWD Water Quality Report, visit www.svwd.org/media/Reports/CCR2025.pdf

For questions or to receive a paper copy of the report, call (831)438-2363.

Scotts Valley Water District

Este reporte contiene las instrucciones mas recientes para obtener informacion importante sobre su agua potable. Traducir, o hablar con alguien que lo entienda.

This email was sent to ngillespie@svwd.org from Scotts Valley Water District and refers to account 007012-005 with service at 2 Civic Center Dr.

Change your [communication preferences](#) or [unsubscribe](#).



**SCOTTS VALLEY
WATER DISTRICT**

svwd.org   

SCOTTS VALLEY WATER QUALITY MAKES THE GRADE

This annual Consumer Confidence Report on water quality shows that last year, as in years past, the District's water met all State and Federal primary drinking water standards. Included in the report is information about the source water quality and treated water quality. It also explains how the water is treated and tested to ensure that it is always safe and refreshing to drink.




Start with a Local Water Supply

Drinking water comes from five wells pumping from the Lompico and Butano aquifers, which are part of the Santa Margarita Groundwater Basin.



Test to Ensure Quality

The District's state-certified water operators monitor the water system 24 hours a day, 7 days a week, to ensure the reliability and safety of our water. Depending on the constituent, the District conducts numerous tests on a daily, weekly, monthly, quarterly and annual basis.




Treat to Provide High-Quality Water

The Lompico and Butano aquifers are naturally high in iron and manganese. The District operates three treatment facilities that utilize oxidation and filtration to reduce these constituents and produce safe, high-quality water.




Providing Customers with Safe, Reliable, High-Quality Water is the District's Top Priority

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.




WHERE WATER COMES FROM

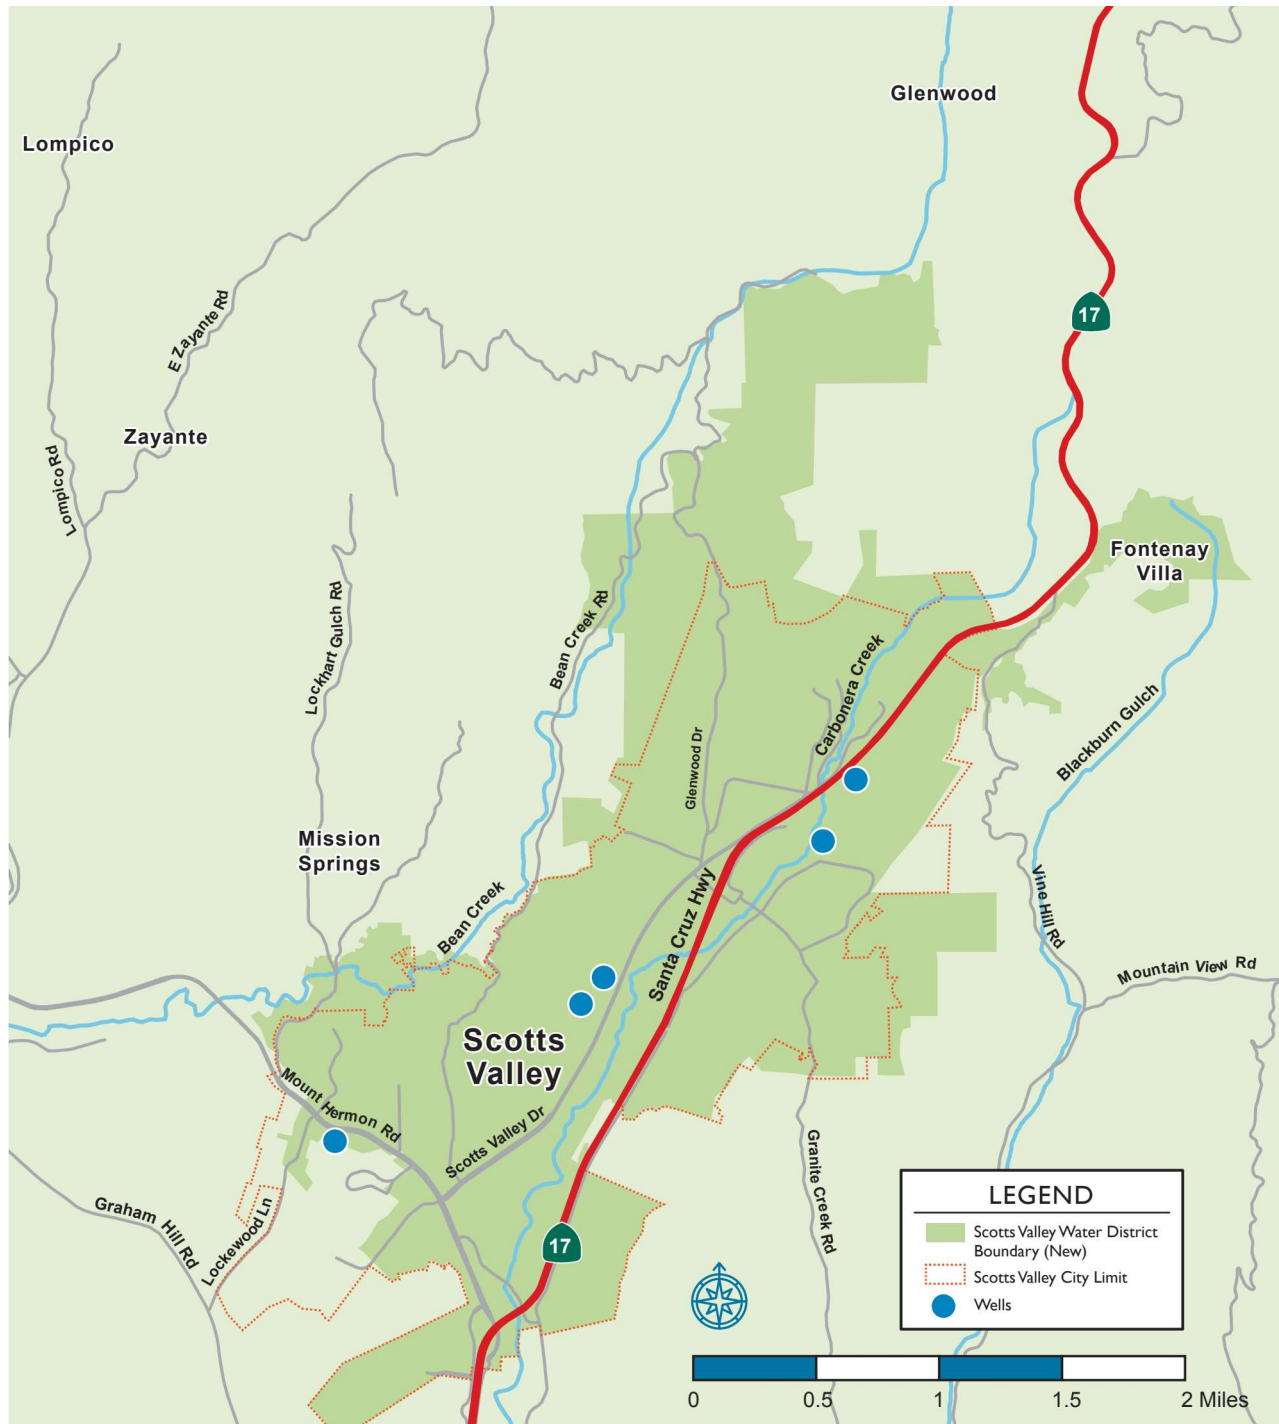

Scotts Valley Water District is a public agency providing water service to over 4,000 accounts within six square miles, including most of the City of Scotts Valley and portions of the unincorporated areas north of the city limits.

The District serves as a leader in sustainable water management practices, embraces innovation and is a trusted source of water-related information in the community. The community of Scotts Valley places a high value on livability, innovation and planning for the future, and the District is proud to play a vital role in supporting those efforts by providing a reliable, high-quality water supply.



DRINKING WATER QUALITY

Source Water

Sources of drinking water (both tap and bottled water) include rivers, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.



Source water contaminants that may be present include:

- Microbial contaminants, such as viruses and bacteria, that may come from wastewater treatment plants, septic systems, agricultural livestock operations and wildlife.
- Pesticides and herbicides that may come from a variety of sources such as agriculture, urban storm water runoff and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are by-products of industrial processes and petroleum production and can also come from gas stations, urban storm water runoff, agricultural applications and septic systems.
- Radioactive contaminants that can be naturally occurring or from oil and gas production and mining activities.
- Inorganic contaminants, such as salts and metals, that can be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by visiting epa.gov/safewater or calling the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

Source Water Assessment

In 2018, the District updated its 2001 Source Water Assessment of District wells that provide source water. These wells are considered most vulnerable to the activities associated with contaminants detected in the water supply from dry-cleaning, gasoline storage and distribution, and manufacturing. In addition, these wells are susceptible to negative impacts from abandoned water and monitoring wells, septic systems, transportation corridors, commercial parking lots and sewer collection systems.

The complete assessment is available at the District Office – 2 Civic Center Drive, Scotts Valley – or by e-mail at contact@svwd.org.

Water Quality Regulations

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (U.S. EPA) and the State Water Resources Control Board (State Water Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health.

While your drinking water meets the federal and state standard for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. The U.S. EPA continues to research the health effects of low levels of arsenic, which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

When to Seek Health Care Advice

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised populations such as persons undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly and infants can be particularly at risk for infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at (800) 426-4791.

HOW CONSTITUENTS ARE MEASURED

MILLIGRAMS per liter (mg/L) or parts per MILLION (ppm)



14
gallons

OR



11.5
days

One drop in 14 gallons

One second in 11.5 days

MICROGRAMS per liter (ug/L) or parts per BILLION (ppb)



14,000
gallon pool

OR



32
years

One drop in 14,000 gallons

One second in nearly 32 years

NANOGRAMS per liter (ng/L) or parts per TRILLION (ppt)



14,000,000
gallon lake

OR



32,000
years

One drop in 14,000,000 gallons

One second in nearly 32,000 years





WATER TEST RESULTS

This table lists all of the drinking water contaminants and other constituents detected between January 1 and December 31. Secondary standards relate to aesthetic aspects of water. Scotts Valley Water District water quality met or surpassed all State and Federal criteria for public health protection.

Primary Health Standards	MCL or MRDL	PHG or MCLG	Range	Average	Violation	Typical Sources
Arsenic (ppb) ⁵	10	0.004	<2 - 9.8	4.9	No	Naturally occurring minerals
Fluoride from natural sources (ppm)	2	1	0.1 - 0.4	0.3	No	Naturally occurring minerals
Gross alpha particle activity (pCi/L) ¹	15	None	<3 - 4.6	<3	No	Naturally occurring minerals
Disinfection By-Products & Disinfection Residual	MCL or MRDL	PHG or MCLG	Range	Average	Violation	Typical Sources
Total Trihalomethanes (ppb)	80	None	11 - 48	39	No	By-product of drinking water chlorination
Haloacetic Acids as HAA5 (ppb)	60	None	<1 - 6	4	No	By-product of drinking water chlorination
Chlorine Residual (ppm)	4	4	0.21 - 1.07	0.76	No	Drinking water disinfectant added for treatment
Residential Tap Monitoring	MCL	PHG or MCLG	Sites Sampled	90th Percentile	Sites Exceeding Action Level	Typical Sources
Lead (ppb) ¹	15	0	31	<5	0	Internal corrosion of household plumbing; erosion of natural deposits
Copper (ppm) ¹	1.3	0.3	31	0.19	0	Internal corrosion of household plumbing; erosion of natural deposits
Lead Sampling of Drinking Water in California Schools (AB746/HSC-116277)		Year Tested	Schools Tested	Typical Sources		
Lead		2017	3	Internal corrosion of household plumbing; erosion of natural deposits		
Secondary Aesthetic Standards	Secondary MCL	Range	Average	Typical Sources		
Chloride (ppm)	500	25 - 59	41	Naturally occurring minerals		
Odor Threshold @ 60 C (TON)	3	<1 - 2	<1	Naturally occurring minerals		
Specific Conductance (MHOS/CM)	1,600	490 - 887	696	Naturally occurring substance that form ions in water		
Sulfate (ppm)	500	84 - 98	90	Naturally occurring minerals		
Turbidity (NTU)	5	<0.1 - 0.7	0.15	Naturally occurring minerals		
Total Dissolved Solids (ppm)	1,000	320 - 520	395	Naturally occurring minerals		
Other Monitoring Results		Range	Average	NOTES • Except where noted, water samples for this report were collected from District treatment plants, the water distribution system, and customer homes throughout the 2025 calendar year. • The treatment processes effectively remove concentrations of iron, manganese, arsenic, sulfide and reduce other contaminants inherent in the groundwater supply. • The State allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants rarely change.		
pH (UNITS)		6.9 - 8.4	7.9			
Sodium (ppm)		32 - 71	49			
Total Hardness ² as CaCO ₃ (ppm)		140 - 310	227			
Calcium (ppm)		43 - 67	58			
Magnesium (ppm)		7 - 35	20			
Potassium (ppm)		1.6 - 2.5	2.1			
Orthophosphate as PO ₄ (ppm)		0.6 - 1.5	1.02			
Unregulated Contaminant Monitoring Rule 5 Monitoring Results ¹		Range	Average			
Lithium (ppb)		23 - 62	42			
Perfluorohexanoic Acid (PFHxA) ⁴ (ppt)		<3 - 4.2	<3			
Perfluoropentanoic Acid (PFPeA) ⁴ (ppt)		<3 - 6.4	<3			

Definitions and footnotes on next page.

Definitions

Contaminants: Chemical and physical elements contained in water.

Grains per Gallon: A unit of hardness where 17.1 parts per million equals 1 grain per gallon.

Turbidity: A physical characteristic of water that makes the water appear cloudy. The condition is caused by the presence of suspended matter. It's monitored because it is a good indicator of the effectiveness of the filtration system.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs or MCLGs as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

MHOS/CM: Micromhos per Centimeter: An indicator of dissolved minerals in the water.

MRDL: Maximum Residual Disinfectant Level. The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

NA: Not applicable.

ND: Not detected at testing limit.

NTU: Nephelometric turbidity unit, indicating the clarity of the water.

pCi/L: Picocuries per liter is a measure of radio-activity.

PDWS: Primary Drinking Water Standards: MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

ppm: Parts per million or milligrams per liter. 1 ppm equals 1,000 ppb and is equivalent to about one drop in 14 gallons of water.

ppb: Parts per billion or micrograms per liter. 1 ppb equals 0.001 ppm and is equivalent to about one drop in 14,000 gallons of water.

ppt: Parts per trillion or nanograms per liter. 1 ppt equals 0.001 ppb and is equivalent to about one drop in 14,000,000 gallons of water.

PHG: Public Health Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Total Dissolved Solids: An indicator of dissolved minerals in the water.

TON: Threshold Odor Number: The unit of odor.

90TH Percentile: The third highest sample result of 20 sample results.

FOOTNOTES

¹ All testing is from 2025, except where noted. Radiological constituents were drawn from treatment plants in January 2019. Residential tap monitoring of lead and copper occurred in 2023.

² Average Total Hardness for 2025 was 13.3 grains per gallon.

³ Unregulated contaminant monitoring helps the US EPA and the State Water Resources Control Board Division of Drinking Water to determine where certain contaminants occur and whether these contaminants need to be regulated. This section includes a summary of the Unregulated Contaminant Monitoring Rule 5 monitoring results in 2024.

⁴ PFHxA and PFPeA were detected only at the Well 10A Water Treatment Plant, which provided 25% of water provided to customers of the Scotts Valley Water District in 2025.

⁵ Arsenic testing results include both untreated and treated sample results. The average arsenic detection for the El Pueblo Water Treatment Plant was 5.9 ppb, while arsenic was not detected at both the Orchard Run and Well 10 Water Treatment Plants. The El Pueblo Water Treatment Plant produced 25% of the water distributed to customers in 2025.

Lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Scotts Valley Water District is responsible for providing high quality drinking water and removing lead pipes, but cannot control the variety of materials used in plumbing components in your home. You share the responsibility for protecting yourself and your family from the lead in your home plumbing. You can take responsibility by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Before drinking tap water, flush your pipes for several minutes by running your tap, taking a shower, doing laundry or a load of dishes. You can also use a filter certified by an American National Standards Institute accredited certifier to reduce lead in drinking water.

For information specific to service lines in the Scotts Valley Water District service area, please refer to the inventory report available on our website: <https://www.svwd.org/lead-service-line-inventory-report>. If you are concerned about lead in your water and wish to have your water tested, contact Scotts Valley Water District at contact@svwd.org.

Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at <http://www.epa.gov/safewater/lead>.

Got Questions?

Contact Operations Manager Nate Gillespie at (831) 600-1903.

How to Get Involved

Customers are invited to attend monthly board meetings on the second Thursday of every month at 6 pm at the District Office, 2 Civic Center Drive, Scotts Valley.

Download this report at:

www.svwd.org/media/Reports/CCR2025.pdf



**SCOTTS VALLEY
WATER DISTRICT**

svwd.org   