




**Groveland Community Services District**  
**18966 Ferretti Road**  
**P.O. Box 350**  
**Groveland, California, 95321**

**Phone: (209) 962-7161**  
**Fax: (209) 962-4943**  
**E-mail: [info@gcsd.org](mailto:info@gcsd.org)**  
**Visit our web site at: [www.gcsd.org](http://www.gcsd.org)**

## 2023 Water Quality Report

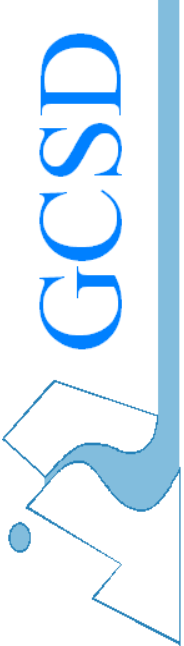

**Groveland Community Services District**

### Water Conservation Tips

- Automatic dishwashers use 15 gallons for every cycle, regardless of how many dishes are loaded. Get a run for your money and load it to capacity.
- Turn off the tap when brushing your teeth.
- Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day and up to 7,300 gallons a year.
- Check your toilets for leaks by putting a few drops of food coloring in the tank. Watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from an undetectable toilet leak. Fix it and you could save more than 30,000 gallons a year.
- Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances. Then check the meter after 15 minutes. If it moved, you have a leak.
- Replace shower heads with new, low flow models. They are inexpensive and by replacing just one, the average family can save 2,900 gallons per year. By using less hot water, you'll also save on your energy bill.

### District Toilet and Showerhead Rebates

The District currently offers rebates to its customers who replace high flow toilets and shower heads with new low flow ones. Water customers can receive a \$50 rebate per new low flow toilet and customers on Sewer and Water can receive \$100 per toilet, with a maximum of two (2) rebates per household.

Water and Sewer customers can also receive a \$20 rebate for installing a new 1.5 gallons per minute or less showerhead, with a maximum of two (2) per household.

### Community Participation

our web site [www.gcsd.org](http://www.gcsd.org).

You are invited to attend our regularly scheduled Board meetings held on the second Tuesday of each month, beginning at 10:00 a.m. in the Groveland Community Services District's boardroom, at 18966 Ferretti Road, Groveland, California. GCS D's Board meetings are an excellent way to learn about water and wastewater issues that directly affect you and everyone in the Groveland, Big Oak Flat, and Pine Mountain Lake areas. Your participation is appreciated. Current information is available on



The Pall Trailer is known as the Alternative Water Supply (AWS) treatment plant. The AWS was installed in 2008. It is capable of producing 600 gallons per minute of treated water drawn from Pine Mountain Lake. During a tunnel outage, or emergency situation, the treatment plant is capable of providing a safe drinking water supply to all GCS D customers.

### Sampling Results

The District routinely monitors for contaminants in your drinking water in accordance with federal and state laws. The results contained in this report are for the monitoring period of January 1, 2023, through December 31, 2023.

This report contains results from laboratory testing, excluding contaminants that were not detected, or that were detected at a level below the state's detection level for the purposes of reporting (DLR). This information has been compiled in the tables on the back of this pamphlet to show what these contaminants were.

In order to ensure that tap water is safe to drink, the USEPA, and the State Water Resources Control Board prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. State Board regulations also establish limits for contaminants in bottled water that proved the same protection for public health.

The chart lists all of the drinking water contaminants that were detected during the most recent sampling for the constituent. The presence of these contaminants in the water does not necessarily indicate that the water poses a health risk. The State Board allows us to monitor for certain contaminants less than once per year because concentrations of these contaminants do not change frequently. Some of the data, though representative of the water quality, are more than one year old. Any violation of an AL, MCL, MRDL, or TT is asterisked.

**Action Level (Regulatory Action Level):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

**MCL (Maximum Contaminant Level):** The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs (SMCLs) are set to protect the odor, taste and appearance of drinking water.

### Terms Used In This Report

bottled water, and the bacterial counts approach zero. Because of the high quality of our source water, the District obtained a Filtration Avoidance permit (no filtration process required) on April 22, 1998, and during 2007 and 2008 began using disinfection-by-chloramination and ultraviolet disinfection to kill any pathogens, including *Cryptosporidium* and *Giardia*, that may be present in its surface water supply.



### Where Your Water Comes From

GCS D obtains the majority of its water from the San Francisco Public Utilities Commission's (SFPUC) Hetch Hetchy Reservoir supply by deep conveyance tunnel southeast of town, known as the Mountain Tunnel. The water originates in Yosemite National Park as snow melt from a large pristine watershed in the High Sierra. With controlled human contact and granite-type geology, the mineral content of this water is lower than most

**MCLG (Maximum Contaminant Level Goal):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. EPA.

**MRDL (Maximum Residual Disinfectant Level):** The level of a disinfectant added for water treatment that may not be exceeded at the consumer's tap.

**MRDLG (Maximum Residual Disinfectant Level Goal):** The level of a disinfectant added for water treatment below which there is no known or expected risk to health. MRDLGs are set by the U.S. EPA.

**ND (Not Detected):** Indicates that the substance was not found by laboratory analysis.

**NS:** No standard.

**NTU (Nephelometric Turbidity Units):** Measurement of the clarity, or turbidity, of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

**PDWS (Primary Drinking Water Standard):** MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

**PHG (Public Health Goal):** The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California EPA.

**Ppb/µg (parts per billion) :** One part of substance per billion parts water (or micrograms per liter).

**Ppm/mg (parts per million):** One part of substance per million parts water (or milligrams per liter).

**TT (Treatment Technique):** A required process intended to reduce the level of a contaminant in drinking water.

**Variances and Exemptions:** State Board permission to exceed and MCL or not comply with a treatment or other requirements that a water system must follow.

**ppm:** parts per million of milligrams per liter (mg/L)

**ppb:** parts per billion of micrograms per liter (µg/L)

**ppt:** parts per trillion or nanograms per liter (ng/L)

**Ppq:** parts per quadrillion or picogram per liter (pg/L)

**pCi/L:** picocuries per liter (a measure of radiation)

2023 WATER QUALITY DATA

Groveland Community Services District, Groveland, California

PRIMARY DRINKING WATER STANDARDS

Este informe contiene informacion muy importante sobre su agua potable. Traduzcalo o hable con alguien que lo entienda bien.

| Substance or Parameter                              | Unit | MCL/MRDL     | (MCLG) | Range     | Average | Typical Sources in Drinking Water                                                                                                     |
|-----------------------------------------------------|------|--------------|--------|-----------|---------|---------------------------------------------------------------------------------------------------------------------------------------|
| CLARITY                                             |      |              |        |           |         |                                                                                                                                       |
| Turbidity—Raw Source Water                          | NTU  | 5            | NS     | 0.14-1.0  | 0.2     | Primarily related to soil runoff (erosion) which is made up of suspended matter that interferes with light                            |
| Turbidity—Finished Water                            | NTU  | 5            | NS     | 0.13-0.95 | 0.2     | Primarily related to soil runoff (erosion) which is made up of suspended matter that interferes with light                            |
| MICROBIOLOGICAL                                     |      |              |        |           |         |                                                                                                                                       |
| Total Coliform —Raw Water                           | #    | (a)          | 0      | <1-1600   | 130     | Naturally present in the environment from decomposition of organic matter; may be an indication of fecal waste                        |
| Fecal Coliform—Raw Water                            | #    | (b)          | 0      | <1-240    | 2..0    | Related to human and animal waste                                                                                                     |
| DISINFECTION BY PRODUCTS AND DISINFECTANT RESIDUALS |      |              |        |           |         |                                                                                                                                       |
| Total Trihalomethanes (TTHMs)*                      | µg/L | 80           | NS     | 22.2-62.3 | 32.3    | Byproducts of drinking water disinfection using chlorine; upgrades to the treatment process have reduced TTHMs to below MCL’s         |
| Total Haloacetic Acids (HAAs)*                      | µg/L | 60           | NS     | 38.7-62.6 | 53.3    | Byproducts of drinking water disinfection using chlorine; upgrades to the treatment process have reduced HAAs to below MCL’s          |
| Chlorine ◀                                          | mg/L | 4.0 (as Cl2) | 4.0    | 1.3-3.5   | 2.9     | Drinking water disinfectant added for treatment                                                                                       |
| Chloramines (Distribution System)★                  | mg/L | 4.0 (as Cl2) | 4.0    | 1.4-3.5   | 2.7     | Drinking water disinfectant added for treatment                                                                                       |
| INORGANIC CHEMICALS 90th Percentile                 |      |              |        |           |         |                                                                                                                                       |
| Copper▼ (August 2023)                               | mg/L | 1.3          | 0.17   | ND-.076   | 0.024   | Internal corrosion of household plumbing systems, erosion of natural rock/soil deposits, and leaching from wood preservatives         |
| Lead▼ (August 2023)                                 | mg/L | 15           | 2      | ND-.009   | 0.0005  | Internal corrosion of household plumbing systems, erosion of natural rock/soil deposits, and discharges from industrial manufacturers |

SECONDARY DRINKING WATER STANDARD

| Substance or Parameter             | Typical Sources in Drinking Water |     |    |          |       |                                                                                                                                                                               |
|------------------------------------|-----------------------------------|-----|----|----------|-------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Color                              | unit                              | 15  | NS | 10-15    | 12    | From naturally occurring organic materials such as leaves, pine needles, and wood                                                                                             |
| Odor♦                              | TON                               | 3   | NS | ND-8     | 8     | From naturally occurring organic materials                                                                                                                                    |
| Specific Conductance               | µS/cm                             | 900 | NS | ND-89    | 42    | From naturally occurring dissolved solids that form ions in water, an indication of the dissolved mineral content of water                                                    |
| Total Dissolved Solids (TDS)       | mg/L                              | 500 | NS | 30-92    | 71    | From runoff and leaching from natural deposits (soil and rocks)                                                                                                               |
| Sulfate                            | mg/L                              | 250 | NS | 0.51-3.8 | 2     | From runoff and leaching from natural deposits (soil and rocks)                                                                                                               |
| OTHER                              |                                   |     |    |          |       |                                                                                                                                                                               |
| Substance or Parameter             | Typical Sources in Drinking Water |     |    |          |       |                                                                                                                                                                               |
| Alkalinity (as CaCO <sub>3</sub> ) | mg/L                              | NS  | NS | 15-30    | 20    | From natural sources and dissolved minerals                                                                                                                                   |
| Hardness (as CaCO <sub>3</sub> )   | mg/L                              | NS  | NS | ND-34    | 18    | From naturally occurring dissolved substances (Ca <sup>2+</sup> , Mg <sup>2+</sup> , Sr <sup>2+</sup> , Fe <sup>2+</sup> , Mn <sup>2+</sup> ) that come in contact with water |
| Chloride                           | mg/L                              | 250 | NS | ND-0.006 | 0.002 | From naturally occurring and dissolved minerals                                                                                                                               |
| Sodium                             | mg/L                              | NS  | NS | ND-5.4   | 2.2   | From naturally occurring and dissolved minerals                                                                                                                               |
| Calcium                            | mg/L                              | NS  | NS | ND-9     | 5     | From naturally occurring and dissolved minerals                                                                                                                               |
| Ph (Distribution System)           | unit                              | NS  | NS | 6.6-10.2 | 8.8   | Affected by alkaline sources, atmospheric CO <sub>2</sub> , organic matter, and acidity from mineral sources—distilled water has a 7.0 pH                                     |
| Potassium                          | mg/L                              | NS  | NS | ND-2.2   | 0.7   | From naturally occurring and dissolved mineral                                                                                                                                |
| Magnesium                          | mg/L                              | NS  | NS | ND-2.8   | 1.3   | From naturally occurring and dissolved mineral                                                                                                                                |
| Iron                               | mg/L                              | 0.3 | NS | ND-0.21  | 0.07  | From naturally occurring and dissolved mineral                                                                                                                                |
|                                    |                                   |     |    |          |       |                                                                                                                                                                               |
|                                    |                                   |     |    |          |       |                                                                                                                                                                               |

The tables above list all of the drinking water substances and parameters that were detected in 2023.

MCLs for Total and Fecal Coliform

- (a) - For 40 samples/month; No more than 5.0% of monthly samples may be positive; for <40 samples/month; no more than 1 positive sample
- (b) - A routine sample and repeat samples are total coliform positive, and one of these is also fecal coliform or E. Coli positive
- Results for total and fecal coliform are for raw water sources; they do not represent the drinking water concentrations of these substances

Water Hardness Classification (Note: GCSD’s water is soft)

- 0—75 mg/L = Soft
- 75—150 mg/L = Moderately hard
- 150—300 mg/L = Hard
- >300 mg/L = Very hard

\* Results for TTHM and HAA samples are averaged over four quarters. Results indicate levels well below the MCL for 2023. Some people who use water containing TTHMs in excess of the MCL over many years may experience liver, kidney, or central nervous system problems, and may have an increased risk of getting cancer. Some people who drink water containing HAAs in excess of the MCL over many years may have an increased risk of getting cancer.

◀Some people who use water containing chlorine well in excess of the MRDL could experience irritating effects to their eyes and nose. Some people who drink water containing chlorine in excess of the MRDL could experience stomach discomfort.

★Some people who use water containing chloramines well in excess of the MRDL could experience irritating effects to their eyes and nose. Some people who drink water containing chloramines well in excess of the MRDL could experience stomach discomfort or anemia.

♦20 samples were collected by the GCSD during August 2023 (the minimum required). If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. GCSD is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have it tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

♦Results for odor testing indicated an exceedance of the MCL for the Pine Mountain Lake Source, but test results at the AWS Filter Plant were non-detect after filtration.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA’s Safe Drinking Water Hotline (1-800-426-4791). Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advise about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium or other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791); in addition more information about contaminants and potential health effects can be obtained by calling the same. If you have health issues concerning the consumption of this water, you may wish to consult your doctor.

Please share this information with all people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this public notice in a public place or distributing copies by hand or mail.

For questions regarding this report, please contact the District’s Office at 209-962-7161.