


Consumer Confidence Report Certification Form

(To be submitted with a copy of the CCR)

Water System Name:	Oxnard Water Department
Water System Number:	CA5610007

The water system named above hereby certifies that its Consumer Confidence Report was distributed on June 21, 2022 to customers (and appropriate notices of availability have been given). Further, the system certifies that the information contained in the report is correct and consistent with the compliance monitoring data previously submitted to the State Water Resources Control Board, Division of Drinking Water (DDW).

Certified by:

Name: Omar Castro	Title: Water Division Manager
Signature: 	Date: 7/11/2022
Phone number: (805) 385-8139	

To summarize report delivery used and good-faith efforts taken, please complete this page by checking all items that apply and fill-in where appropriate:

- ☐ CCR was distributed by mail or other direct delivery methods (attach description of other direct delivery methods used).
- ☒ CCR was distributed using electronic delivery methods described in the Guidance for Electronic Delivery of the Consumer Confidence Report (water systems utilizing electronic delivery methods must complete the second page).
- ☒ "Good faith" efforts were used to reach non-bill paying consumers. Those efforts included the following methods:
 - ☒ Posting the CCR at the following URL: www.oxnard.org/ccr _____
 - ☐ Mailing the CCR to postal patrons within the service area (attach zip codes used)
 - ☐ Advertising the availability of the CCR in news media (attach copy of press release)
 - ☐ Publication of the CCR in a local newspaper of general circulation (attach a copy of the published notice, including name of newspaper and date published)
 - ☐ Posted the CCR in public places (attach a list of locations)
 - ☐ Delivery of multiple copies of CCR to single-billed addresses serving several persons, such as apartments, businesses, and schools
 - ☐ Delivery to community organizations (attach a list of organizations)
 - ☐ Publication of the CCR in the electronic city newsletter or electronic community newsletter or listserv (attach a copy of the article or notice)

☐ Electronic announcement of CCR availability via social media outlets (attach list of social media outlets utilized)

☐ Other (attach a list of other methods used)

☒ *For systems serving at least 100,000 persons:* Posted CCR on a publicly-accessible internet site at the following URL: www.oxnard.org/ccr

☐ *For privately-owned utilities:* Delivered the CCR to the California Public Utilities Commission

Consumer Confidence Report Electronic Delivery Certification

Water systems utilizing electronic distribution methods for CCR delivery must complete this page by checking all items that apply and fill-in where appropriate.

☒ Water system mailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available website where it can be viewed (attach a copy of the mailed CCR notification). URL: www.oxnard.org/ccr

☐ Water system emailed a notification that the CCR is available and provides a direct URL to the CCR on a publicly available site on the Internet where it can be viewed (attach a copy of the emailed CCR notification). URL: www.oxnard.org/ccr

☐ Water system emailed the CCR as an electronic file email attachment.

☐ Water system emailed the CCR text and tables inserted or embedded into the body of an email, not as an attachment (attach a copy of the emailed CCR).

☐ *Requires prior DDW review and approval.* Water system utilized other electronic delivery method that meets the direct delivery requirement.

Provide a brief description of the water system's electronic delivery procedures and include how the water system ensures delivery to customers unable to receive electronic delivery.

All postal customers within the City of Oxnard service are were mailed a CCR
Availability notification postcard on June 21, 2022. The postcard directs customers to www.oxnard.org/ccr or to call to have a paper CCR mailed to them directly.



CITY OF

OXNARD



CALIFORNIA

Drinking Water Consumer Confidence Report Calendar Year 2021

This report contains important information about your drinking water.

Este informe contiene información muy importante sobre su agua potable. El informe está disponible en español en el sitio web de la Ciudad en www.oxnard.org/CCR o contáctenos al (805) 385-8136 para recibir asistencia en español.



Letter from the Oxnard Water Division Manager	3
Drinking Water Sources and Treatment	4
Water Quality Monitoring	6
Important Health Information	7
Water Quality Results	8
Investing in a Sustainable Water Future	10
Water Conservation	11

John C. Zaragoza
Mayor

Bryan A. MacDonald
Mayor Pro Tem, District 4

Bert E. Perello
Councilmember, District 1

Gabe Teran
Councilmember, District 2

Oscar Madrigal
Councilmember, District 3

Gabriela Basua
Councilmember, District 5

Vianey Lopez
Councilmember, District 6

City Council Office
300 West Third Street, Oxnard, CA 93030

Public Information

You are invited to participate in or view any of the regularly scheduled City Council meetings.

When: 1st and 3rd Tuesdays at 6 p.m.

Where: City Council Chambers
305 West Third Street, Oxnard, CA 93030

Meetings can be watched live and are taped for later viewing. The City has also expanded public participation options to be able to provide public comment in person or remotely. For details, visit www.oxnard.org/city-meetings.

For more information about this report:

Visit www.oxnard.org/CCR or (805) 385-8136

For additional information:

Environmental Protection Agency Safe Drinking Water Hotline
(800) 426-4791

California Division of Drinking Water, District 06-Santa Barbara
(805) 566-1326

DEAR VALUED CUSTOMER,

I am pleased to share the 2021 Drinking Water Consumer Confidence Report. This report contains important water quality testing results, background on our water resources, and health information for sensitive populations. As you will read, the City has successfully met strict water quality guidelines set by the California Division of Drinking Water (CDDW) and the United States Environmental Protection Agency (USEPA).

During this challenging time, the Water Division team continues its commitment to work hard each and every day to ensure the delivery of safe, clean and reliable drinking water to more than 200,000 residents. More than ever, tap water is vital to our community's health and safety. Please rest assured that our water treatment processes, as they always have, will continue to protect you and your family by removing harmful organisms and viruses, including COVID-19. In addition, I am proud that our entire staff have taken all necessary actions to maintain essential water operations during this public health emergency.

Through the dedication and commitment of our essential workforce we continue to serve you safe and reliable drinking water. Our skilled and State Certified personnel ensure water treatment facilities are maintained and water quality is monitored, sampled, and tested regularly. All water served to you and your

family is treated and tested rigorously to meet state and federal drinking water standards.

Due to our investments in infrastructure, we continue to make our water system resilient and responsive to your needs and the community we serve. Investments in our diverse water supply portfolio include leveraging recycled water in the future to further help us to prepare for dry periods and allow us to serve safe and reliable drinking water for generations to come.

Please share this information with others at your location by posting this notice in a public place or common area. This Drinking Water Consumer Confidence Report is available in English and Spanish (español) on the City's website at www.oxnard.org/CCR. For any questions about this report, please call (805) 385-8136.

Thank you for reading this important report because informed customers are our best allies. We truly appreciate your support.

Sincerely,

Omar Castro
Water Division Manager



Drinking Water Sources and Treatment

Oxnard's drinking water is a blend of sources. Our water supplies include imported water from the Calleguas Municipal Water District (Calleguas), regional groundwater purchased from the United Water Conservation District (United), and water pumped from City groundwater wells, a portion of which is treated by the City's Desalter Facility.

IMPORTED WATER: *Calleguas Municipal Water District*

Calleguas is a member agency of the Metropolitan Water District of Southern California (Metropolitan), the major water importer and wholesale agency for Southern California. Water supplied to Oxnard from Calleguas originates in Northern California via the State Water Project: a system of reservoirs, aqueducts and pump stations. This water is treated either by Metropolitan's Jensen Water Treatment Plant or by Calleguas' Lake Bard Water Filtration Plant. Both Metropolitan and Calleguas perform routine watershed surveys, source water quality sampling and analyses, and operational and treatment activities to ensure the water supplied maintains a high quality.

REGIONAL GROUNDWATER: *United Water Conservation District*

United Water manages, stores and may periodically release water from Lake Piru into the Santa Clara River. During

high flows (during and after storms), United may also divert Santa Clara River water into spreading ponds near El Rio, capturing water that would have otherwise been lost to the ocean. This river water infiltrates and recharges the Oxnard Plain groundwater aquifer. Later the groundwater is extracted, treated, and delivered to several retail water agencies in the region including Oxnard. Groundwater from United is blended with water from Calleguas or water from the City's Desalter Treatment Facility before delivery into the water distribution system. United performs regular watershed surveys as well as routine sampling and water quality analyses to ensure that water stored, treated, and delivered to its customers maintains a consistent quality.

LOCAL GROUNDWATER: *Oxnard*


The Water Division operates ten groundwater wells that are tested and monitored on a regular basis to meet all drinking water standards. Oxnard's treatment process includes disinfection

using chloramines which removes and kills viruses, including coronaviruses, as well as bacteria and other pathogens.

To produce an aesthetically pleasing drinking water quality, City well water is blended with water from Calleguas or treated water from the City's Desalter Treatment Facility. The Desalter, fed by City wells, improves water quality by using reverse osmosis treatment to remove dissolved minerals and is capable of processing up to 7.5 million gallons of water per day.


The City's Water Division also conducts routine source water assessments in order to detect potential contaminants in the groundwater before they become a problem. This includes possible contaminants from local gas stations, private septic systems, drainage from agriculture, and industrial facilities such as chemical and petroleum processing and storage facilities, dry cleaners, metal plating, finishing and fabricating facilities.

OXNARD WATER SUPPLY

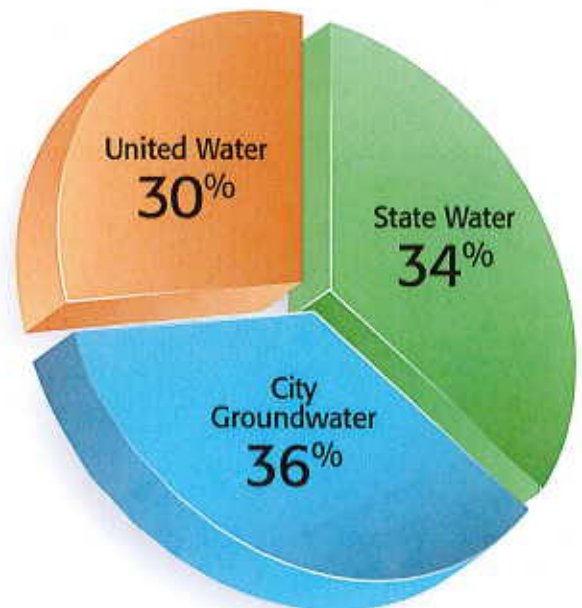

Water Supply Map

Oxnard Water is a blend of imported water, regional groundwater, and local Oxnard groundwater.

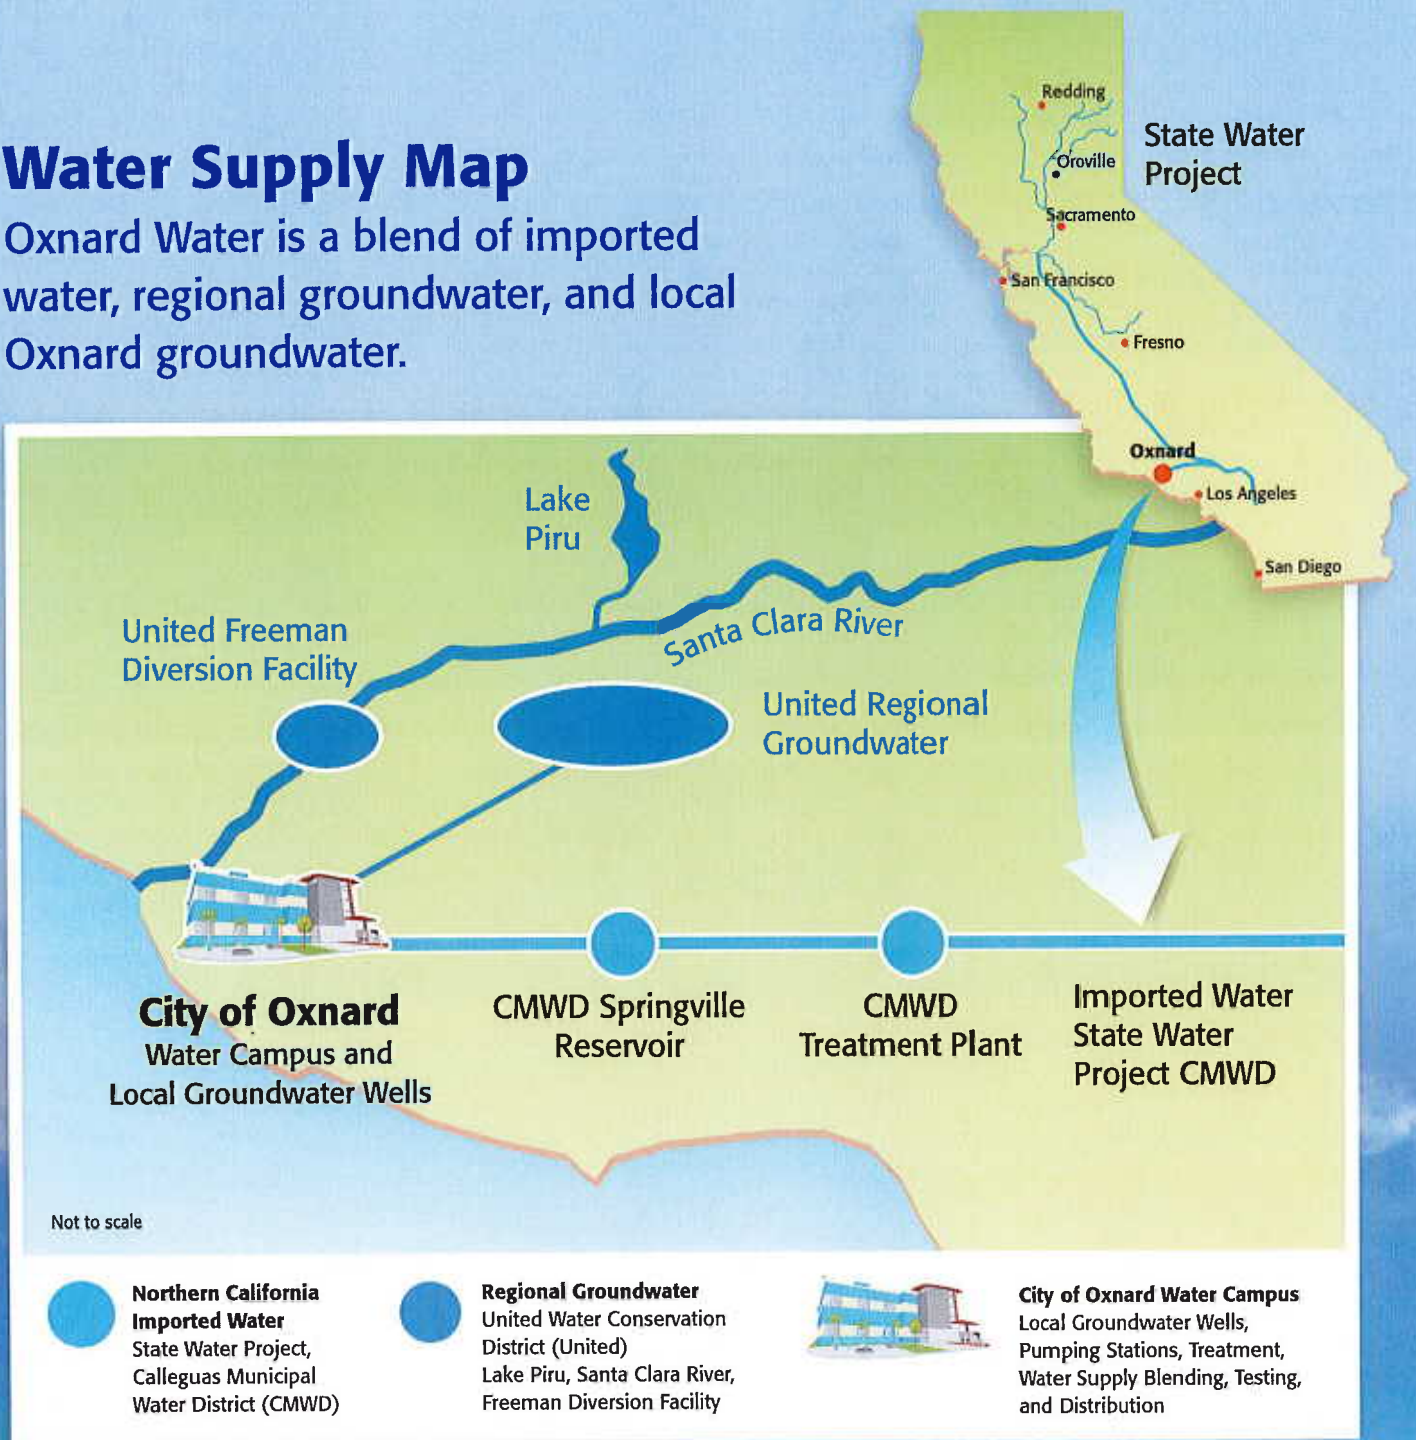

WATER QUALITY MONITORING

All of the monitoring conducted is necessary to ensure that your water is safe to drink and also aesthetically pleasing. Monitoring is a result of prescribed regulations from the USEPA as well as the CDDW. These regulations limit the amount of certain health-based and aesthetic contaminants in water provided by all public water systems. Many of the monitoring, treatment, and water quality requirements that are placed upon local drinking water supplies are actually more stringent than for bottled water.



Operation staff sampling water for contaminants

CONTAMINANTS THAT MAY BE PRESENT IN SOURCE WATER INCLUDE:

Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

Pesticides and herbicides that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.

Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.

Radioactive contaminants that can be naturally-occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, the USEPA and State Water Resources Control Board prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. USEPA regulations also establish limits for contaminants in bottled water that provide the same protection for public health. Drinking water, including bottled water, may reasonably

Here is some additional information that may provide assistance in interpreting information in the 2021 Water Quality Tables:

- Some of the parameters measured will change very infrequently in their environment. For these parameters, the State allows the City to monitor them less than once a year. Therefore, some of the City's data, although representative, is more than one year old.
- Unregulated contaminant monitoring is conducted every five years in order to assist USEPA and CDDW to determine where certain contaminants occur and whether the contaminants need to be regulated. During 2018-2021, the City monitored 30 unregulated contaminants from its wells along with a corresponding sampling from the distribution system reflecting water from each well. The testing data is collected nationally and used to evaluate if new drinking water regulations would increase public health protection.
- There are many more contaminants that were monitored than what is reported in the included water quality tables; however, they were never detected in your drinking water so they are not listed.
- The sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive materials, and can pick up substances resulting from the presence of animals or from human activity.



Operation staff testing the Desalter Facility membranes

be expected to contain small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline (1- 800-426-4791).



IMPORTANT HEALTH INFORMATION

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers.

USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Nitrate (as Nitrogen) in drinking water at levels above 10 mg/L is a health risk for infants of less than six months of age. Such nitrate levels in drinking water can interfere

with the capacity of the infant's blood to carry oxygen, resulting in a serious illness; symptoms include shortness of breath and blueness of the skin.

Nitrate (as Nitrogen) levels above 10 mg/L may also affect the ability of the blood to carry oxygen in other individuals, such as pregnant women and those with certain specific enzyme deficiencies. If you are caring for an infant, or you are pregnant, you should ask advice from your health care provider.

In 2021, the City sampled various residential homes for lead and copper. Lead and copper results indicated that one residential sample was above the action level. Lead and Copper testing will be conducted again in 2024 in accordance with the EPA's Lead and Copper rule of testing every three years.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Oxnard Water is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

City of Oxnard Summary of Water Quality Results for 2021

The following water quality tables describe the parameters measured in the various water supply sources and results of those measurements from January through December 2021, unless otherwise indicated. Please note that the results represent a blend of water quality which is delivered to customers through the water distribution system, unless otherwise indicated.

This Consumer Confidence Report (CCR) reflects changes in drinking water regulatory requirements during 2021. These revisions add the requirements of the federal Revised Total Coliform Rule, effective since April 1, 2016, to the existing state Total Coliform Rule. The revised rule maintains the purpose to protect public health by ensuring the integrity of the drinking water distribution system and monitoring for the presence of microbials (i.e., total coliform and E. coli bacteria). The USEPA anticipates greater public health protection as the rule requires water systems that are vulnerable to microbial contamination to identify and fix problems. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment to determine if any sanitary defects exist. If found, these must be corrected by the water system. The state Revised Total Coliform Rule became effective July 1, 2021.

PRIMARY DRINKING WATER STANDARDS - Jensen/MWD and Lake Bard/Calleguas

Parameter	MCL	PHG (MCLG) MRDLG	Jensen Plant	Lake Bard	Year Tested	Major Sources in Drinking Water
Combined Filter Effluent Turbidity (NTU)	Highest Single Value		0.06	0.06	2021	Soil runoff
	TT = % of samples \leq 0.3 NTU		100%	100%		

PRIMARY DRINKING WATER STANDARDS - Water system data (Calleguas, United, and Oxnard water)

Parameter	MCL (MRDL)	PHG (MCLG) MRDLG	Range	Average	Year Tested	Major Sources in Drinking Water
INORGANIC CHEMICALS						
Arsenic (ppb)	10	0.004	ND - 3.3	2.0	2021	Erosion of natural deposits, orchard runoff
Fluoride (ppm)	2.0	1.0	ND - 0.82	0.56	2021	Water additive that promotes strong teeth, naturally occurs in groundwater
Nitrate (as N) (ppm)	10	10	0.19 - 6.7	3.3	2021	Runoff and leaching from fertilizer and sewage
Selenium (ppb)	50	30	7.2 - 9.7	8.2	2021	Erosion of natural deposits; discharge from refineries
RADIOLOGICALS (a) (b)						
Gross Alpha Particle Activity (pCi/L)	15	0	3.68 - 7.48	5.7	2021	Erosion of natural deposits
Gross Beta Particle Activity (pCi/L)	50	0	4.34 - 5.5	4.9	2021	Decay of natural and manmade deposits
Uranium (pCi/L)	20	0.43	4.2 - 4.9	4.5	2021	Erosion of natural deposits
MICROBIALS						
Total Coliform Bacteria	\leq 5% of monthly samples are coliform positive	0	0% - 0.77%	Highest monthly = 0.77%	2021	Naturally present in the environment

SECONDARY DRINKING WATER STANDARDS - Water system data (Calleguas, United, and Oxnard water)

Parameter	Secondary MCL	Notification Level	Range	Average	Year Tested	Major Sources in Drinking Water
Chloride (ppm)	500		56 - 76	68	2021	Runoff and leaching from natural deposits, seawater influence
Iron (ppb)	300		ND - 100	32	2021	Leaching from natural deposits, industrial waste
Specific Conductance (uS/cm)	1,600		1,050 - 1,190	1,143	2021	Substances that form ions when in water, seawater influence
Sulfate (ppm)	500		110 - 350	306	2021	Runoff and leaching from natural deposits
Total Dissolved Solids (ppm)	1,000		728 - 1,500	772	2021	Runoff and leaching from natural deposits
Turbidity (NTU)	5.0		0.10 - 0.11	0.107	2021	Soil runoff
United Groundwater Turbidity (NTU)	5		0.01 - 0.30		2021	Well corrosion byproducts. Microscopic soil particles

ADDITIONAL PARAMETERS (UNREGULATED) - Water system data (Calleguas, United, and Oxnard water)

Parameter	Secondary MCL	Notification Level	Range	Average	Year Tested	Major Sources in Drinking Water
Alkalinity (ppm)	NS	NS	150 - 170	163	2021	Erosion of natural material
Calcium (ppm)	NS	NS	24 - 150	92	2021	Erosion of natural material
Hardness (Total Hardness) (ppm)	NS	NS	100 - 570	350	2021	Erosion of natural material
Magnesium (ppm)	NS	NS	10 - 49	32	2021	Erosion of natural material
pH (pH units)	NS	NS	7.75 - 7.99	7.87	2021	
Potassium (ppm)	NS	NS	3 - 4	3.7	2021	Erosion of natural material
Sodium (ppm)	NS	NS	74 - 92	85	2021	Erosion of natural material, seawater influence

ADDITIONAL PARAMETERS (UNREGULATED) - Source water prior to blending

Parameter	Secondary MCL	Notification Level	Range	Average	Year Tested	Major Sources in Drinking Water
Chlorate (ppb)	NS	800	ND - 51	17	2021	By-product of water disinfection
Total Organic Carbon (ppm)	NS	50	1 - 2	2	2021	Various natural and manmade sources
Boron (ppb)	NS	1,000	420 - 560	460	2021	Naturally present in the environment
UNREGULATED CONTAMINANT MONITORING RULE (UCMR 4) 2018						
Manganese (ppb)	50	500	ND - 14	4.64	2018	Naturally present in rock and soil
1-Butanol (ppb)	NS	NS	ND - 2.1	0.64	2018	

ADDITIONAL PARAMETERS - Water system data (Calleguas, United, and Oxnard water)

Parameter	State MCL [MRDL]	PHG (MCLG) [MRDLG]	Range	Average	Greatest RAA	Major Sources in Drinking Water
DISINFECTION RELATED MONITORING						
Disinfectant Residual Total Chlorine, as residual (ppm)	[4.0]	[4.0]	0.11 - 2.8	1.65	1.69	Disinfectant added to control microbiological parameters
Parameter	State MCL [MRDL]	PHG (MCLG) [MRDLG]	Range	Average	Greatest RAA	Major Sources in Drinking Water
Disinfection By-Products Haloacetic acids (HAAs) (ppb)	60	N/A	ND - 73	4.43	5.8	By-products of drinking water disinfection using chlorine
Total Trihalomethanes TTHM (ppb)	80	N/A	1.3 - 29	20.6	26.3	By-products of drinking water disinfection using chlorine
Source water prior to blending Bromate (ppb)	10	0.1	1.5 - 1.9	1.13		By-product of drinking water disinfection
Metropolitan (Jensen Plant) Bromate (ppb) (c)	10	0.1	1.2 - 9.8	4.5		By-product of drinking water disinfection

Lead and Copper Rule

LEAD AND COPPER MONITORING 2021

Copper (ppb)	1,300 (AL)	300	90th percentile value	870	Erosion of natural materials and corrosion of household plumbing fixtures
			No. of sites sampled	52	
			Sites exceeding AL	0	
Lead (ppb)	15 (AL)	0.2	90th percentile value	4.2	Erosion of natural materials and corrosion of household plumbing fixtures
			No. of sites sampled	52	
			Sites exceeding AL	1	

SCHOOL LEAD SAMPLING 2018-2019 - Number of schools sampled: 41; Number of results exceeding the AL: 1

Maximum Contaminant Level (MCL)

The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG)

The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the USEPA.

Public Health Goal (PHG)

The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.

Primary Drinking Water Standards (PDWS)

MCLs, MRDLs, and treatment techniques (TTs) for contaminants that affect health, along with their monitoring and reporting requirements.

Maximum Residual Disinfectant Level (MRDL)

The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG)

The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Regulatory Action Level (AL)

The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

Treatment Technique (TT)

A required process intended to reduce the level of a contaminant in drinking water.

Abbreviations

CDDW	California Division of Drinking Water
LRAA	Locational Running Annual Average
NA	Not Applicable
ND	Not Detected
NS	No Standard
NTU	Nephelometric Turbidity Unit

pCi/L	picoCuries per liter
ppb	Parts per billion - Micrograms per liter (ug/l)
ppm	Parts per million - Milligrams per liter (mg/l)
RAA	Running Annual Average
SWRCB	State Water Resources Control Board
uS/cm	microSiemen per centimeter

References

- SWRCB DDW considers 50 pCi/L to be the level of concern for beta particles; the gross beta particle activity MCL is 4 millirem/year annual dose equivalent to the total body or any internal organ.
- Radionuclides are sampled over a range from throughout a given year to every 6 years.
- Bromate is an ozonation treatment by-product. Bromate values shown are solely contributed by the Jensen Plant and only occur in the system when water originates from that location.

Investing in a Sustainable Future



AMI meter and customer portal

ADVANCED METERING INFRASTRUCTURE (AMI)

The Oxnard Water Division remains committed to helping customers use water efficiently. One very efficient method of assisting customers in doing so is to empower them with smart water meters. The currently installed water meters will be upgraded within the next three years with smart meters that utilize Advanced Metering Infrastructure (AMI) technology. These smart meters will allow customers to:

- Obtain near real-time water usage data
- Receive leak detection alerts
- Improve customer water conservation efforts



Advanced Water Purification Facility (AWPF)

AQUIFER, STORAGE, AND RECOVERY WELL DEMONSTRATION (ASR)

Securing water supplies is critical for future generations. A reliable water supply will help during droughts and provide safe, reliable drinking water for public health and safety. That is why the Oxnard Water Division has invested in an Aquifer, Storage, and Recovery (ASR) well demonstration pilot program that is currently in construction. If successful, the ASR program will:

- Store recycled water from the City's Advanced Water Purification Facility to blend with other water resources
- Provide an additional water supply during a drought
- Secure water supplies for future generations to utilize



Groundwater wells at Blending Station No. 3

INVESTING IN OUR WATER SYSTEM TODAY FOR A BETTER FUTURE

Critical water infrastructure continues to age, costs of operation and maintenance items have increased, the population has grown, and climate variability continues to be a huge challenge. Now, more than ever, is a critical time to take action to ensure a safe and reliable future water supply. The Oxnard Water Division has efficiently utilized ratepayers' fees to operate four years without a rate increase. The Oxnard Water Division will explore all options to secure the City's future water supply, including improving operational efficiencies to save on costs and conducting a water rate study to ensure equitable water rates.

Water Conservation is an Oxnard Way of Life

California is in its third consecutive year of drought. Water conservation by customers is an important part of the City's water supply. Being water wise is one of the best ways to help make sure we have enough water to meet our essential needs. Your ongoing efforts — like taking shorter showers, replacing water wasting toilets with newer, high-efficiency models, checking for leaks, and planting California Friendly gardens — make a big impact in conserving water.

From water efficient tips to rebates and workshops, the City of Oxnard Water Division provides resources to customers to help make every drop count.

STAY UP-TO-DATE

on the latest water waste restrictions and mandatory conservation measures by visiting OxnardWater.org.



FIND AND FIX LEAKS

The average household loses more than 10,000 gallons of water each year through leaks. Fortunately, most leaks are easy to find if you know where to look!



- Check your meter before and after a two-hour period when no water is being used in the home. If the meter numbers change at all, you probably have a leak.
- Look for dripping faucets, showerheads, hoses, spigots, and broken sprinkler heads. You may just need to tighten the connection, or maybe it's time to replace some of your fixtures with water efficient EPA WaterSense labeled devices.
- Identify silent toilet leaks by placing drops of food coloring in the tank. If any color shows up in the bowl after 15 minutes, you have a leak. Flush the toilet to prevent staining. It's time to replace the flapper!
- If you need more information on how to detect and repair the most common leaks, check out our web page for DIY videos and helpful tips.



Be in-the-know about **Oxnard's H₂O!**



Facility Tours

See how Oxnard keeps your water safe, clean and reliable.



Conservation Rebates

Save money on new indoor/outdoor appliances and devices.



Water Quality Reports

Read how your drinking water meets or exceeds strict Federal and State water quality standards.



Fix-A-Leak

Learn easy tips to stop wasteful leaks and save money.



Landscape Classes

Learn about efficient irrigation and water-wise gardening techniques.



(805) 385-8136
OxnardWater.org

CITY OF
OXNARD
CALIFORNIA



2021 Drinking Water Consumer Confidence Report

Read the annual water quality report at
www.Oxnard.org/CCR.

Informe de Confianza al Consumidor de Agua Potable de 2021

Lea el informe anual de calidad del
agua en www.Oxnard.org/CCR.

Water División
www.Oxnard.org/CCR
(805) 385-8136



City of Oxnard's water customers are invited to read the 2021 Drinking Water Consumers Confidence Report on the City's website. The report contains information about where your water comes from, what it contains, and how it compares to State standards. Also, if you would like to have a paper copy mailed or would like to speak with someone about the report, please call (805) 385-8136.

We are committed to providing you with this important information because informed customers are our best allies.

Los clientes del servicio de agua de la Ciudad de Oxnard están invitados a leer el Informe de Confianza del Consumidor de Agua Potable de 2021 en español en el sitio web de la Ciudad. El informe contiene información sobre el origen de su agua, que contiene y cómo se compara con los estándares estatales. Además, si desea que se le envíe por correo una copia impresa o desea hablar con alguien sobre el informe, llame al (805) 385-8136.

Nos comprometemos a proporcionarle esta información importante porque los clientes informados son nuestros mejores aliados.

www.Oxnard.org/CCR
(805) 385-8136



PRSR STD
U.S. POSTAGE
PAID
OXNARD, CA
PERMIT NO. 399

ECRWSS
POSTAL CUSTOMER

Postage Statement—USPS Marketing Mail

Transaction Number: 202217219465381 M1		CAPS / EPS Transaction Number:		Postage Statement Number: 490277486	
Mailing Group	Mailing Group ID 363323287			Mailing Job Number 00098645	
	Preparer V3 Corporation			Origin Mail.dat	
Job Description	City of Oxnard -- CCR Postcard				
Mailer	Permit Holder's Name and Address and Email Address, if Any CITY OF OXNARD 305 W 3RD ST OXNARD, CA 93030-5790 Contact Name: PATRICIA GARCIA, LBOERNER, MHART (805)385-7539 patricia.garcia@oxnard.org CAPS Customer Ref. No: 98645 CRID: 3393333		Name and Address of Mailing Agent (If other than permit holder) V3 Corporation 200 N ELEVAR ST OXNARD, CA 93030-7969 CRID: 1842207		Name and Address of Individual or Organization for Which Mailing Is Prepared (If other than permit holder) CITY OF OXNARD 300 W 3RD ST FL 2 OXNARD, CA 93030-5729 CRID: 3393333
Mailing	Post Office of Mailing OXNARD CA 93030-9998	Processing Category Letters	Mailer's Mailing Date 06/06/22	Federal Agency Cost Code	Statement Seq. No.
	Type of Postage Permit Imprint		SSF Transaction ID #		Total # of Pieces in Mailing 66,922
			Weight of a Single Piece 0.0200 lbs.	Combined Mailing	Total Weight 1258.1336 lbs.
	Permit # 399	For Mail Enclosed Within Another Class <input type="checkbox"/> Bound Printed Matter <input type="checkbox"/> Library Mail <input type="checkbox"/> Periodicals <input type="checkbox"/> Media Mail	<input type="checkbox"/> Mailpiece is a product sample, _____ % Samples		No. & Type of Containers Sacks: 0 1 ft. Letter Trays: 0 2 ft. Letter Trays: 0 EMM Letter Trays: 45 Flat Trays: 0 Pallets: 2 Other: 0
	For Automation Rate Pieces, Enter Date of Address Matching and Coding ____/____/____	For Carrier Route Pieces, Enter Date of Address Matching and Coding ____/____/____	For Carrier Route Pieces, Enter Date of Carrier Route Sequencing 06/16/21		For Pieces Bearing a Simplified Address Enter Date of Delivery Statistics File or Alternative Method ____/____/____
	Move Update Method: Alternative Address Format				
This is a Political Campaign Mailing No		This is Official Election Mail No		<input type="checkbox"/> Letter-size or flat mailpiece contains DVD/CD or other disc.	
Postage	Parts Completed C				
	Subtotal Postage (Add parts totals)				\$13,183.63
	Complete if the mailing includes pieces bearing metered/PC Postage or precanceled stamps. ____ pcs. x \$ _____ = Postage Affixed				\$0.000
	Rate at Which Postage Affixed (Check one) <input type="checkbox"/> Correct <input type="checkbox"/> Lowest <input type="checkbox"/> Neither				
	Incentive/Discount _____				\$0.00
	Fee _____				\$0.00
	Net Postage Due				\$13,183.63
For USPS Use Only: Additional Postage Payment (State reason)					
Total USPS Adjusted Postage					\$13,183.63
Certification	Incentive/Discount Claimed: N/A Type of Fee: N/A				
	The mailer certifies acceptance of liability for and agreement to pay any revenue deficiencies assessed on this mailing, subject to appeal. If an agent certifies that he or she is authorized on behalf of the mailer then that mailer is bound by the certification and agrees to pay any deficiencies. In addition, agents may be liable for any deficiencies resulting from matters within their responsibility, knowledge, or control. The mailer hereby certifies that all information furnished on this form is accurate, truthful, and complete; that the mail and the supporting documentation comply with all postal standards and that the mailing qualifies for the prices and fees claimed; and that the mailing does not contain any matter prohibited by law or postal regulation. I understand that anyone who furnishes false or misleading information on this form or who omits information requested on this form may be subject to criminal and/or civil penalties, including fines and imprisonment. Privacy Notice: For information regarding our Privacy Policy visit www.usps.com				

This postage statement was verified and accepted under the PostalOne! program. No postal signature or round stamp is required.

Part C

Carrier Route Letters

Letters EDDM (Automation) 3.5 oz. (0.2188 lbs.) or less

	Entry	Price Category	Price	No. of Pieces	Subtotal Postage	Discount Total	Fee Total	Total Postage
C14	None	Saturation	\$0.197	66,922	\$13,183.6340	\$0.0000	\$0.0000	\$13,183.6340
C47	Part C Total (Add lines C1-C46)							\$13,183.6340

* May contain both Full Service Intelligent Mail and other discounts