



2018 ANNUAL WATER QUALITY REPORT

THOUSAND OAKS | PWS ID: 5610040



CALIFORNIA AMERICAN WATER

WE KEEP LIFE FLOWING™





RICHARD SVINDLAND
President

A Message from California American Water President RICHARD SVINDLAND

Dear California American Water Customer,

Having easy access to safe, clean water is something that can be easily taken for granted. At California American Water, our top priority is providing safe, reliable drinking water to our more than 690,000 customers.

I am pleased to share with you our 2018 Consumer Confidence Report, which is a testament to the hard work and dedication of our employees who ensure high-quality drinking water.

QUALITY: We have rigorous safeguards in place to ensure the water we provide to you meets or surpasses increasingly stringent water quality standards. Across California, we conducted approximately 652 different tests on 25,239 water samples for 2,994 constituents last year. **We are proud and pleased to confirm that we met every primary and secondary state and federal water quality standard.**

SERVICE: Last year, we invested more than \$74 million in water infrastructure in the California communities we serve. This investment ensures and maintains the safety and reliability of the facilities and technology needed to draw, treat, and distribute water.

VALUE: While costs to provide water service continue to increase across the country, our investments help us provide high-quality water service that remains an exceptional value, costing customers about a penny per gallon.

We are proud to continue to supply water that meets or surpasses all state and federal water quality standards. If you have any questions or concerns, you can contact us by phone, email, online at www.californiaamwater.com, or in person at our local Customer Center. Please take the time to review this report. It provides details about the source and quality of your drinking water, using data from water-quality testing conducted for your local system between January and December 2018.

Sincerely,

A handwritten signature in blue ink that reads "Richard Svindland". The signature is fluid and cursive.

RICHARD SVINDLAND
President





OUR COMMITMENT TO QUALITY

Once again, we proudly present our Annual Water Quality Report, also referred to as a Consumer Confidence Report (CCR). This CCR covers compliance testing completed through December 2018. We are pleased to tell you that our compliance with state and federal drinking water regulations remains exemplary. As in the past, we are committed to delivering the best quality drinking water. To that end, we remain vigilant in meeting the challenges of source water protection, water conservation, environmental compliance, sustainability and community education while continuing to serve the needs of all our water users.

ABOUT CALIFORNIA AMERICAN WATER (CAW) AND AMERICAN WATER (AW)

California American Water, a subsidiary of American Water (NYSE: AWK), provides high-quality and reliable water and/or wastewater services to more than 690,000 people. With a history dating back to 1886, American Water is the largest and most geographically diverse U.S. publicly traded water and wastewater utility company. The company employs more than 7,100 dedicated professionals who provide regulated and market-based drinking water, wastewater and other related services to more than 14 million people in 46 states and Ontario, Canada. American Water provides safe, clean, affordable and reliable water services to our customers to make sure we keep their lives flowing. For more information, visit amwater.com and follow American Water on Twitter, Facebook and LinkedIn.

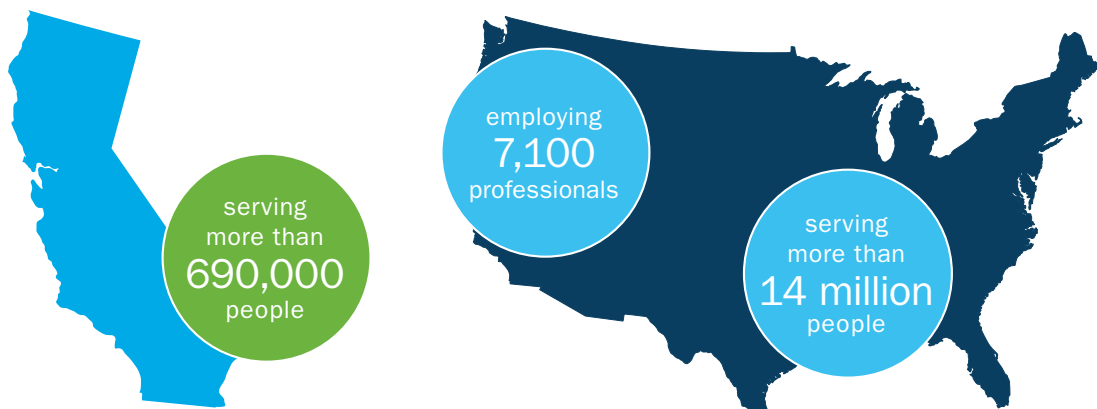

A woman with short dark hair, wearing a light blue button-down shirt, is looking down at a tablet computer she is holding. The background is a bright, sunlit outdoor setting with trees and a mountain in the distance.

WHAT IS A CONSUMER CONFIDENCE REPORT (CCR)?

The Consumer Confidence Report (CCR) is an annual water quality report containing data that California American Water and all associated water purveyors collected during the past year. CCRs let consumers know what contaminants, if any, are in their drinking water as well as any related health effects. CCRs also include details about where your water comes from and how it is treated. Additionally, they educate customers on what it takes to deliver safe drinking water and highlight the need to protect drinking water sources.

In 2018, we collected numerous samples at various sampling points in your water system. The water quality data presented is a combination of data compiled from our nationally recognized water quality laboratory and local commercial laboratories; all certified in drinking water testing by the State Board's Division of Drinking Water. If you have any questions about this report or your drinking water, please contact our Customer Service Center at (888) 237-1333.



ABOUT YOUR WATER

The Thousand Oaks/Newbury Park water system is served entirely by treated surface water purchased from the Calleguas Municipal Water District. The Calleguas Municipal Water District is an authorized wholesaler of treated surface water received from the Metropolitan Water District of Southern California's (MWDSC) Jensen and Weymouth water treatment plants. The sources of the raw surface water are the Sacramento and Colorado Rivers. These waters are conveyed to Southern California via the California Aqueduct (also known as the State Water Project) and the Colorado River Aqueduct.

Drinking water treatment technologies used for this imported water included coagulation, flocculation, sedimentation, filtration, and disinfection. California American Water purchases and distributes this treated surface water for residential and commercial use throughout Thousand Oaks and Newbury Park. In October 2007, MWDSC began adding fluoride to their treated water at an optimized target level of 0.8 mg/L. In 2017, MWDSC added fluoride to their treated water at an optimized target level of 0.7 mg/L.

For more information, please refer to the websites listed in the Water Information Sources section for California American Water, Calleguas Municipal Water District, and the Metropolitan Water District of Southern California.

NOTICE OF SOURCE WATER ASSESSMENT (SWA)

MWDSC updated its Watershed Sanitary Surveys in 2010 (Colorado River) and 2011 (State Water Project). The surveys included suggestions for how to better protect these source waters.

The EPA also requires utilities to complete one SWA that utilizes information collected in the watershed sanitary surveys. The SWA is used to evaluate the vulnerability of water sources to contamination and helps determine whether more protective measures are needed.

MWDSC's supplies are most vulnerable to urban/storm water run-off, wildlife, agriculture, recreation and wastewater. A copy of the assessments can be obtained by contacting Metropolitan at (213) 217-6850.



WHAT ARE THE SOURCES OF CONTAMINANTS?

The sources of drinking water include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and can pick up substances resulting from animal or human activity and even radioactive material. In order to ensure that tap water is safe to drink, USEPA and the State Water Resources Control Board set regulations limiting the amount of certain contaminants in water provided by public water systems. Contaminants that may be present in source water include:

ORGANIC CHEMICAL CONTAMINANTS

including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and may also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.

INORGANIC CONTAMINANTS,

such as salts and metals, which can be naturally occurring or may result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

PESTICIDES AND HERBICIDES,

which may come from a variety of sources, such as agriculture, urban stormwater runoff, and residential uses.

MICROBIAL CONTAMINANTS,

such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

RADIOACTIVE CONTAMINANTS,

which can be naturally occurring or may be the result of oil and gas production and mining activities.



FLUORIDE & UCMR

FLUORIDE

Fluoride is a naturally occurring substance. It can be present in drinking water from two sources:

1. **By nature** when groundwater comes into contact with fluoride-containing minerals naturally present in the earth; or
2. **By a water purveyor** through addition of fluoride to the water they are providing in the distribution system.

California American Water does not add fluoride to drinking water it serves. MWDSC adds fluoride to the drinking water California American Water purchases from Calleguas Municipal Water District.

UNREGULATED CONTAMINANT MONITORING RULE (UCMR)

The USEPA created the Unregulated Contaminants Monitoring Rule (UCMR) to assist them in determining the occurrence of unregulated contaminants in drinking water and whether new regulations are warranted. The first Unregulated Contaminants Monitoring Rule (UCMR1) testing was completed in 2003 for a list of contaminants specified by the USEPA. Unregulated contaminants are those for which the USEPA has not established drinking water standards. UCMR2 testing was conducted between November 2008 and August 2009, and UCMR3

assessment monitoring was conducted between January 2013 and December 2016. The fourth list of contaminants to monitor as part of the UCMR was published by the U.S. EPA in December 2016. UCMR4 testing began in 2018 and will continue until 2020. The results from the UCMR monitoring are reported directly to the USEPA. The results of this monitoring are incorporated in the data tables in this report as appropriate. For more information, contact our Customer Service Center at (888) 237-1333.



LEAD

LEAD

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. California American Water is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to two minutes before using water for drinking or cooking.

If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/lead.

TESTING LEAD IN PUBLIC SCHOOLS

To safeguard water quality in California's K-12 public schools, California Assembly Bill 746 requires community water system to test lead levels, by July 1, 2019, in drinking water at all California public, K-12 school sites that were constructed before January 1, 2010. California American Water serves 14 public school sites in the Thousand Oaks water system and has completed the testing at all 14 sites. Additional testing was completed for one private school site. California law makes school districts responsible for informing parents of lead testing results for their schools. Please contact your child's school or school district to get detailed results on lead testing at your child's school.



CHLORAMINES

CHLORAMINES

Chloramines are a California and federally approved alternative to free chlorine for water disinfection. Chloramines minimize disinfection by-product formation. Another benefit of chloramines is improved taste of the water compared to free chlorine. Chloramines are also used by many American Water systems and many other water utilities nationally. Chloramines have the same effect as chlorine for typical water uses with the exception that chloramines must be removed from water used in kidney dialysis and fish tanks or aquariums. Treatments to remove chloramines are different than treatments for removing chlorine. Please contact your physician or dialysis specialist for questions pertaining to kidney dialysis water treatment. Contact your pet store or veterinarian for questions regarding water used for fish and other aquatic life. You may also contact our Customer Service Center at (888) 237-1333 for more chloramine information.

A photograph of a young woman with long dark hair, smiling broadly and looking off to the side. She is wearing a red jacket and holding a teal water bottle. The background is a blurred outdoor setting with trees and a bright sky.

EDUCATIONAL & SPECIAL HEALTH INFORMATION

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking Water Hotline at (800) 426-4791.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants may be particularly at risk for infections. These people should seek advice about drinking water from their health care providers. USEPA/CDC guidelines on appropriate means to lessen the risk of infection by microbial contaminants are available through the USEPA's Safe Drinking Water Hotline at (800) 426-4791.



MEASUREMENTS

Water is sampled and tested consistently throughout the year to ensure the best possible quality. Contaminants are measured in:

- **Parts per million (ppm) or milligrams per liter (mg/L)**
- **Parts per billion (ppb) or micrograms per liter (µg/L)**
- **Parts per trillion (ppt) or nanograms per liter (ng/L)**
- **Grains per gallon (grains/gal)** – A measurement of water hardness often used for sizing household water softeners. One grain per gallon is equal to 17.1 mg/L of hardness.
- **MicroSiemens per centimeter (µS/cm)** – A measurement of a solution’s ability to conduct electricity.
- **Nephelometric Turbidity Units (NTU)** – A measurement of the clarity of water. Turbidity in excess of 5 NTU is noticeable to the average person.
- **PicoCuries per liter (pCi/L)** – A measurement of radioactivity in water.

PARTS PER MILLION:


1 second
in 12 days

PARTS PER BILLION:

1 second
in 32 years

PARTS PER TRILLION:

1 second
in 32,000 years

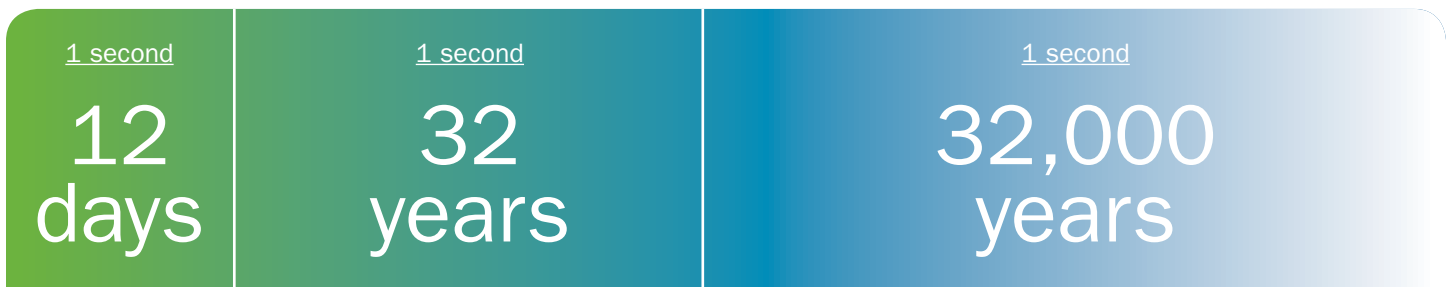



HOW TO READ THIS TABLE

California American Water conducts extensive monitoring to ensure that your water meets all water quality standards. The results of our monitoring are reported in the following tables. While most monitoring was conducted in 2018, certain substances are monitored less than once per year because the levels do not change frequently. For help with interpreting this table, see the “Definition of Terms” section.

- 1 Starting with a **Substance**, read across.
- 2 **Year Sampled** is usually in 2018 or year prior.
- 3 **MCL** shows the highest level of substance (contaminant) allowed.
- 4 **MCLG** is the goal level for that substance (this may be lower than what is allowed).
- 5 **Average Amount Detected** represents the measured amount (less is better).
- 6 **Range** tells the highest and lowest amounts measured.
- 7 A **No** under **Violation** indicates government requirements were met.
- 8 **Major Sources in Drinking Water** tells where the substance usually originates.

Unregulated substances are measured, but maximum allowed contaminant levels have not been established by the government.

Water Quality Results

Regulated Substances - Measured in CAW's Distribution System, Leaving MWDC & Calleguas Water Treatment Plants (WTPs)

Substance (Units)	Year Sampled	MCL	PHG (MCLG)	CAW's TO / NP Distribution System		MWDC 97% Jensen WTP		3% Calleguas Lake Bard WTP		Violation	Major Sources In Drinking Water
				Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High		
Aluminum (ppb)	2018	1000	600	NA	NA	ND	ND - 75	ND	ND	No	Residue from water treatment process
Arsenic (ppb)	2018	10	0.004	NA	NA	ND	ND	3.5	3 - 4	No	Erosion of natural deposits; Runoff from orchards
Fluoride (ppm)	2018 (RAA)	2	1	NA	NA	NA	NA	0.7	0.6 - 1	No	Erosion of natural deposits; Water additive which promotes strong teeth;
Nitrate (as N) (ppm)	2018	10	10	NA	NA	0.5	0.5	ND	ND	No	Runoff and leaching from fertilizer use; Leaching from septic tanks and sewage; Erosion of natural deposits
Selenium (ppb)	2018	50	30	NA	NA	ND	ND	11.5	8 - 15	No	Erosion of natural deposits; discharge from refineries
Gross Beta Particle Activity (pCi/L)	2018	15	(0)	NA	NA	ND	ND - 3	ND	ND	No	Erosion of natural deposits
Uranium (pCi/L)	2017	20	0.43	NA	NA	ND	ND - 1	ND	ND - 1.4	No	Erosion of natural deposits
Total Trihalomethanes ¹ (TTHM) (ppb)	2018 (LRAA)	80	NS	17.1	7 - 25.7	NA	NA	27.3	10 - 57	No	By-product of drinking water chlorination
Haloacetic Acids ¹ (ppb)	2018 (LRAA)	60	NS	6.1	2.7 - 8.9	NA	NA	11.3	5 - 22	No	By-product of drinking water chlorination
Total Chlorine Residual ¹ (ppm)	2018 (RAA)	MRDL=4.0	MRDL=4.0	1.81	1.57 - 1.90	NA	NA	2.3	1.5 - 2.5	No	Drinking water disinfectant added for treatment
Bromate (ppb)	2018 (RAA)	10	0.1	NA	NA	5.2	ND - 6.4	ND	ND - 5.2	No	By-product of drinking water disinfection
Total Organic Carbon (TOC) (ppm)	2018 (RAA)	TT=2 ²	NS	NA ³	NA	2.6	2 - 2.6	2	1.6 - 2.3	No	Various natural and man-made sources; TOC as a medium for formation of DBPs

¹ TTHM, HAA, and Total Chlorine Residual data were taken from the distribution system. Average amount detected is the highest RAA or LRAA.

² Treatment requirement if average TOC > 2.

³ Only surface water sources must comply with PDWS for Control of Disinfection By-Product Precursors and turbidity.

Secondary Substances - Measured on the Water Leaving MWDC and Calleguas Water Treatment Plants (WTPs)

Substance (Units)	Year Sampled	SMCL	PHG (MCLG)	MWDC 97% Jensen WTP		3% Calleguas Lake Bard WTP		Violation	Major Sources In Drinking Water
				Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High		
Aluminum (ppb)	2018	200	600	ND	ND - 75	ND	ND	No	Erosion from natural deposits; Residue from water treatment processes
Chloride (ppm)	2018	500	NS	56	54 - 57	106	105 - 109	No	Runoff/leaching from natural deposits; Seawater influence
Color (color units)	2018	15	NS	ND	ND - 1	ND	ND	No	Naturally-occurring organic material
Odor (odor units)	2018	3	NS	2	1 - 4	ND	ND	No	Naturally-occurring organic material
Specific Conductance (µmhos/cm)	2018	1600	NS	436	428 - 444	780	758 - 792	No	Substances that form ions when in water; Seawater influence
Sulfate (ppm)	2018	500	NS	44	73 - 46	96.2	92.4 - 100	No	Runoff/leaching from natural deposits; industrial waste
Total Dissolved Solids (ppm)	2018	1000	NS	243	236 - 254	430	400 - 440	No	Runoff/leaching from natural deposits

Bacterial Results (from the Thousand Oaks Distribution System)

Substance (Units)	Year Sampled	MCL	PHG (MCLG)	Highest Percentage Detected	Violation	Major Sources In Drinking Water
Total Coliform Bacteria	2018	More than 5% of monthly samples are positive	0	1.01%	No	Naturally present in the environment

Turbidity - A Measure of the Clarity of the Water Leaving MWDC and Calleguas Water Treatment Plants (WTPs)

Substance (Units)	Year Sampled	MCL	PHG (MCLG)	MWDC 97% Jensen WTP	3% Calleguas Lake Bard WTP	Violation	Major Sources In Drinking Water
				Highest Level Found	Highest Level Found		
Turbidity (NTU)	2018	TT = 1.0 NTU	NA	0	0	No	Soil runoff
		TT = 95% of samples ≤ 0.3 NTU		100%	100%		

Unregulated Substances - Measured on the Water Leaving the MWDSC and Calleguas Water Treatment Plants

Substance (Units)	Year Sampled	Notification Level	PHG (MCLG)	CAW's TO / NP Distribution System		MWDSC 97% Jensen WTP		3% Calleguas Lake Bard WTP	
				Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High
Boron (ppm)	2018	1	NA	NA	NA	0.1	0.1	0.3	0.2 - 0.3
Haloacetic Acids (ppb)	2018	60	NS	9.9	6.6 - 17	NA	NA	NA	NA
Manganese (ppb)	2018	50	500	1.1	0.74 - 1.6	ND	ND	ND	ND
Bromine (ppb)	2018	NS	NS	7.5	4.4 - 13	NA	NA	NA	NA
N-Nitrosodimethylamine (NDMA) (ppt)	2017	10	NA	NA	NA	ND	ND - 3.2	ND	ND - 3.2
Vanadium (ppb)	2017	50	NA	NA	NA	4	4	ND	ND

Lead and Copper Results - Measured on Tap Water Samples Collected Across CAW's Thousand Oaks Distribution System

Substance (Units)	Year Sampled	Action Level	PHG (MCLG)	Number of Samples	Amount Detected (90th Percentile)	Homes Above Action Level	Violation	Number of School Requesting Lead Sampling	Major Sources in Drinking Water
Copper (ppm)	2018	1.3	0.3	30	0.264	0	No	NA	Internal corrosion of household plumbing systems; Erosion of natural deposits; Leaching from wood preservatives
Lead (ppb)	2018	15	0.2	30	3	0	No	1	Internal corrosion of household plumbing systems; Erosion of natural deposits; Discharges from industrial manufacturers

Additional Water Quality Parameters of Interest

This table shows the average levels of additional water quality parameters, many of which are often of interest to consumers. Values shown are averages of operating data for 2018. Values may vary from day to day. There are no health-based limits for these substances in drinking water.

Substance (Units)	Year Sampled	MWDSC 97% Jensen WTP		3% Calleguas Lake Bard WTP	
		Average Amount Detected	Range Low-High	Average Amount Detected	Range Low-High
Alkalinity as CaCO3 (ppm)	2018	72	68 - 76	110	110
Calcium (ppm)	2018	20	19 - 21	35	32 - 38
Chlorate (ppm)	2018	29	29	ND	ND
Corrosivity (Al)	2018	12	12	12.3	12.2 - 12.3
Magnesium (ppm)	2018	13	12 - 14	16	15 - 17
pH (pH units)	2018	8.5	8.4 - 8.5	8.3	8.3
Potassium (ppm)	2018	2.4	2.4 - 2.5	4	4
Sodium (ppm)	2018	46	45 - 46	95	89 - 101
Hardness ¹ (Total Hardness) (ppm)	2018	89	84 - 94	154	142 - 165
Hardness (Total Hardness) (grains per gallon)	2018	5	5 - 6	9	8 - 10

¹Hardness is the sum of polyvalent cations present in the water, generally magnesium and calcium. The cations are usually naturally occurring.



DEFINITION OF TERMS

Action Level (AL): The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, that a water system must follow.

DDW: Division of Drinking Water

LRAA: Locational Running Annual Average

Maximum Contaminant Level (MCL): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology. Secondary MCLs (SMCL) are set to protect the odor, taste, and appearance of drinking water.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MFL: Million fibers per liter.

micromhos per centimeter ($\mu\text{mhos/cm}$): A measure of electrical conductance.

NA: Not applicable

N/A: No data available

ND: Not detected

Nephelometric Turbidity Units (NTU): Measurement of the clarity, or turbidity, of the water.

Notification Level (NL): The concentration of a contaminant, which, if exceeded, requires notification to

DDW and the consumer. Not an enforceable standard.

pH: A measurement of acidity, 7.0 being neutral.

picocuries per liter (pCi/L): Measurement of the natural rate of disintegration of radioactive contaminants in water (also beta particles).

parts per billion (ppb): One part substance per billion parts water, or micrograms per liter.

parts per million (ppm): One part substance per million parts water, or milligrams per liter.

parts per trillion (ppt): One part substance per trillion parts water, or nanograms per liter.

Primary Drinking Water Standard (PDWS): MCLs for contaminants that affect health along with their monitoring and reporting requirements and water treatment requirements.

Public Health Goal (PHG): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California EPA.

RAA: Running Annual Average

Secondary Maximum Contaminant Level (SMCL): Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.

SWRCB: State Water Resources Control Board

TON: Threshold Odor Number

Total Dissolved Solids (TDS): An overall indicator of the amount of minerals in water.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

Variations and Exemptions: State or USEPA permission not to meet an MCL or utilize a treatment technique under certain conditions.

%: Percent



HOW TO CONTACT US

If you have any questions about this report, your drinking water, or service, please call California American Water's Customer Service toll free at (888) 237-1333.

WATER INFORMATION SOURCES

California American Water

www.californiaamwater.com

State Water Resources Control Board (State Board), Division of Drinking Water (DDW)

www.waterboards.ca.gov/drinking_water/programs/index.shtml

United States Environmental Protection Agency (USEPA)

www.epa.gov/safewater

Safe Drinking Water Hotline

(800) 426-4791

Centers for Disease Control and Prevention

www.cdc.gov

Water Quality Association

www.wqa.org

National Library of Medicine/National Institute of Health

www.nlm.nih.gov/medlineplus/drinkingwater.html

Metropolitan Water District of Southern California (MWDSC)

www.mwdh2o.com

Calleguas Municipal Water District

www.calleguas.com

This report contains important information about your drinking water. Translate it, or speak with someone who understands it at (888) 237-1333.

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien al (888) 237-1333.

Ntawm no yog ib co lus qhia tseem ceeb heev txog koj cov dej seb huv npaum li cas. Yog tias koj xav tau kev pab txhais cov lus qhia no, thov hu rau peb ntawm (888) 237-1333.

這是關於您的水質的十分重要的資訊。如果您需要幫助翻譯此資訊請致電(888) 237-1333 與我們聯繫。

आपके पानी की गुणवत्ता के बारे में यह बहुत महत्वपूर्ण सूचना है। यदि इस सूचना के अनुवाद के लिए आपको सहायता की जरूरत हो, तो कृपया (888) 237-1333 पर हमें काल करें।

Это очень важная информация о качестве Вашей воды. Если Вам требуется перевод этой информации, позвоните нам по телефону (888) 237-1333.

Ito ay isang napakahalagang impormasyon tungkol sa kalidad ng iyong tubig. Kung iyong kailangan ng tulong sa pagsalin ng impormasyon na ito, mangyaring tumawag sa amin sa (888) 237-1333.

Đây là thông tin rất quan trọng về chất lượng nước của quý vị. Nếu quý vị cần thông dịch thông tin này, xin gọi chúng tôi theo số (888) 237-1333.